

VENTILATION SCHEDULE							
LABEL	AREA	OCCUPANCY RATE*	OCCUPANCY	VENTILATION RATE**	VENT. REQ.**	ADD'L AREA RATE**	ADD'L REQ.**
DINING	415 SF	70 PPL / 1000 SF	30 PPL	7.5 CFM / PPL	225 CFM	0.18 CFM / SF	75 CFM
KITCHEN	445 SF	20 PPL / 1000 SF	9 PPL	7.5 CFM / PPL	68 CFM	0.12 CFM / SF	54 CFM

NOTE: THE DINING AREA IS 415 SF. 415 / 1000 X 70 X 7.5 = 225 CFM. 415 X 0.18 = 75 CFM.  
 THE KITCHEN AREA IS 445 SF. 445 / 1000 X 20 X 7.5 = 68 CFM. 445 X 0.12 = 54 CFM.  
 THE TOTAL VENTILATION REQUIREMENT IS 225 CFM + 75 CFM + 68 CFM + 54 CFM = 442 CFM. 500 CFM IS PROVIDED AT ALL OCCUPIED TIMES. SEE AIR BALANCE SCHEDULE, THIS SHEET.  
 \* PER IMC TABLE 403.3  
 \*\* PER ASHRAE 62.1

FAN SCHEDULE			
UNIT NUMBER	EF-1	EF-2	OAF-1
AREA SERVED	RESTROOM	KITCHEN	KITCHEN
MANUFACTURER	CAPTIVE AIRE	CAPTIVE AIRE	CAPTIVE AIRE
MODEL	SIF11DD	SIF11DD	SIF11DD
CFM	150	300	200
STATIC PRESSURE, "WG	0.50	0.50	0.50
FAN HORSEPOWER	0.50	0.50	0.50
DRIVE	DIRECT INLINE	DIRECT INLINE	DIRECT INLINE
RPM	1042	1060	1042
ELECTRICAL V/PHASE/HZ	120/1/60	120/1/60	120/1/60
ACCESSORIES	B,D,E,G,H,L,M	B,D,E,G,H,L,M,N	B,D,E,G,H,L,M

NOTES/ACCESSORIES:  
 A. ALUMINIZED BIRDSCREEN  
 B. SAFETY DISCONNECT SWITCH  
 C. GRAVITY BACKDRAFT DAMPER  
 D. AMCA SEAL & U.L. CERTIFIED  
 E. SPEED CONTROL  
 F. FACTORY GRILLE  
 G. INTERLOCK WITH SALES FLOOR LIGHTS  
 H. HANGING KIT  
 J. CONTROLLED BY TEMP. PROBE IN HOOD DISCHARGE COLLAR  
 K. REFER TO KITCHEN BALANCE SCHEDULE  
 L. 10' MIN. CLEARANCE FROM AIR INTAKES TO EXHAUST  
 M. COORDINATE WITH MANUFACTURER FOR FINAL SELECTION  
 N. FILTER AND SKW INLINE DUCT HEATER, SEE PLAN THIS SHEET

GAS SPLIT SYSTEM SCHEDULE	
UNIT DESIGNATION	AHU-1 AND CU-1
UNIT TYPE	COMPONENTS ARE EXISTING AND TO REMAIN. PROVIDED BY THE LANDLORD DURING SHELL SPACE CONSTRUCTION. THE HVAC INSTALLER IS TO SET CAPACITIES PER THE 'AIR BALANCE SCHEDULE.' THIS SHEET, VERIFY PROPER WORKING OPERATION OF THE EQUIPMENT, AND IMMEDIATELY NOTIFY THE GENERAL CONTRACTOR AND NCA CONSULTANTS OF ANY PROBLEMS
AREA SERVED	
SUPPLY AIR (CFM)	
OUTSIDE AIR (CFM)	
STATIC PRESS. (E.S.P.)	
BLOWER MOTOR B.H.P	
VOLTS/PH/HZ	
TOT. COOLING CAP. (MBH)	
COOLING SENS. CAP (MBH)	
ENT. AIR TEMP. °F (DB/WB)	
MANUFACTURER	
MODEL NO. (FURNACE W/BLOWER)	
MODEL NO. (COOLING COIL)	
WEIGHT, LBS	
* HEAT (MBTUH) INPUT/OUTPUT	
MAX. UNIT AMPS	
M.O.C.P.	
CONDENSING UNIT DATA	
UNIT #	
AIR HANDLER SERVED	
REFRIGERANT	
COMPRESSOR RLA/LRA	
OUTDOOR FAN FLA	
VOLTAGE	
M.C.A. / M.O.C.P.	
MANUFACTURER	
MODEL # (CONDENSOR-INDOOR COOLING COIL)	
SEER	
WEIGHT, LBS	

"MINI-SPLIT" SYSTEM	
UNIT DESIGNATION	AHU-2 AND CU-2
UNIT TYPE	CASSETTE
AREA SERVED	SEE PLAN
SUPPLY AIR (CFM)	1483
OUTSIDE AIR (CFM)	
STATIC PRESS. (E.S.P.)	
VOLTS/PH/HZ	208/1/60
RATED COOLING CAP. (MBH)	48
ENT. AIR TEMP. °F (DB/WB)	80/67 deg
MANUFACTURER	LG
MAX. HEATING (MBH)	55.1
MODEL NO. W/COOLING COIL	LCN489HV
WEIGHT, LBS.	59/70
UNIT #	CU-2
AIR HANDLER SERVED	AHU-2
REFRIGERANT	R410A
VOLTAGE	208/1/60
MIN. CIRCUIT AMPS	32.0
MAX. FUSE BREAKER	40
MANUFACTURER	LG
MODEL NO.	LUL480HHV
S.E.E.R.	17.5
HSFP	11.7
WEIGHT, LBS.	210

ACCESSORIES, NOTES:  
 1. HANG AHU-2 FROM CEILING PER MANUFACTURERS PUBLISHED INSTRUCTION AND LOCAL CODES.  
 2. ONE YEAR COMPLETE PARTS AND LABOR WARRANTY.  
 3. ADDITIONAL 4 YEAR PARTS WARRANTY ON COMPRESSORS.  
 4. FILTER RACK AT AIR HANDLER

**ATTENTION GENERAL CONTRACTOR:**  
 "RE-ENGINEERING" DEVIATIONS FROM THE SHOWN DESIGN AND REQUIRED HVAC EQUIPMENT MUST BE APPROVED IN ADVANCE BY THE ARCHITECT AND PROFESSIONAL ENGINEER. UNAUTHORIZED SUBSTITUTIONS OR ALTERATIONS WILL VOID THE SIGNATURE AND SEAL OF THE PROFESSIONAL ENGINEER AND LEAVE VIOLATORS RESPONSIBLE FOR RESUBMISSION OF SIGNED AND SEALED DRAWINGS.

DRAWING INFORMATION		
DATE	DESCRIPTION	BY
01-24-22	FOR CONSTRUCTION	KM
03-29-22	UPDATED	KM
03-30-22	UPDATED	KM
03-31-22	UPDATED	KM

### CONTRACTORS NOTES

- HVAC CONTRACTOR
- THE HVAC CONTRACTOR IS TO FURNISH AND INSTALL THE NEW SPLIT SYSTEM, EXHAUST FAN, DUCTWORK, INSULATION WRAP, DIFFUSERS AND GRILLES, SMOKE DETECTORS, AND TEMPERATURE CONTROLS.
  - ALL FLEX DUCT IS TO BE U.L. LISTED, R-6, FOIL-BACKED, CLASSIFIED AS A CLASS 1 AIR DUCT.
  - ALL METAL DUCT AND AIR DISTRIBUTION DEVICES ARE TO BE INSULATED WITH R-6, 2" X .75 DENSITY FOIL-BACKED INSULATION, WITH FIRE AND SMOKE RATING [25]-[50].
  - ALL DUCTWORK IS TO BE INDEPENDENTLY HUNG FROM STRUCTURAL MEMBERS.
  - ALL DUCTWORK IS TO BE FABRICATED, INSTALLED, SEALED, AND EXTERNALLY INSULATED PER SMACNA LOW-VELOCITY DUCT MANUAL (LATEST ISSUE). **INTERNALLY LINED DUCTWORK IS NOT ALLOWED.**
  - UNLESS OTHERWISE NOTED, ALL SUPPLY TAKEOFFS ARE TO HAVE A MANUAL VOLUME CONTROL DAMPER.
  - THE HVAC CONTRACTOR IS TO COORDINATE DIFFUSER LOCATIONS ON SITE WITH THE MOST RECENT REFLECTED CEILING PLAN.
  - THE HVAC CONTRACTOR IS TO FURNISH A WRITTEN GUARANTEE COVERING A ONE-YEAR PERIOD FOR ALL HVAC EQUIPMENT AND PROVIDE AN ADDITIONAL FOUR-YEAR PERIOD FOR THE COMPRESSORS IN THE RTUS. ALL FANS TO BE U.L. LISTED.
  - UPON COMPLETION OF PROJECT THE HVAC CONTRACTOR IS TO HIRE AN A.A.B.C., N.E.B.B., OR N.C.I. CERTIFIED, INDEPENDENT TEST AND BALANCE COMPANY TO CONDUCT A COMPLETE, CERTIFIED TEST AND BALANCE OF ALL HVAC EQUIPMENT. PROVIDE A WRITTEN REPORT TO NCA CONSULTANTS. ALL CAPACITIES MUST BE SET TO AMOUNTS INDICATED ON THE FLOOR PLANS AND SCHEDULES.
  - THE HVAC CONTRACTOR IS TO MAKE ALL LOW-VOLTAGE WIRING FINAL CONNECTIONS FOR ALL HVAC EQUIPMENT INCLUDING TEMPERATURE CONTROLS, RTUS, AND SMOKE DETECTORS.
- GENERAL CONTRACTOR
- IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO RECEIVE, OFFLOAD, AND STORE ALL HVAC MATERIALS WHICH ARRIVE AT THE JOB SITE. ALL MATERIAL MUST BE STORED INSIDE THE BUILDING.
  - ALL ROOF, CEILING, WALL, AND STRUCTURAL FRAMING REQUIRED FOR UNIT, FAN, DUCT, DIFFUSER, AND ALL OTHER HVAC WORK IS TO BE BY THE G.C. COORDINATE ON SITE WITH HVAC CONTRACTOR. **ANY REQUIRED PAINTING OF HVAC WORK IS TO BE BY THE GENERAL CONTRACTOR.**
  - IF NECESSARY THE GENERAL CONTRACTOR IS TO REMOVE, REPLACE, AND/OR REPAIR CEILING GRID AND TILES IN ORDER FOR THE HVAC WORK TO BE PERFORMED.
  - THE GENERAL CONTRACTOR IS TO UNDERCUT THE RESTROOM DOORS 2".
- ELECTRICAL CONTRACTOR
- THE ELECTRICAL CONTRACTOR IS TO FURNISH AND INSTALL POWER AND CONTROL WIRING.
  - THE ELECTRICAL CONTRACTOR IS TO INSTALL LOW-VOLTAGE CONTROL WIRING FOR ALL AIR CONDITIONING CONTROLS.
  - THE ELECTRICAL CONTRACTOR IS TO FURNISH AND INSTALL DISCONNECTS FOR THE NEW HVAC EQUIPMENT, WIRE THE RESTROOM EXHAUST FAN TO RUN CONTINUOUSLY, WHILE THE DINING ROOM LIGHTS ARE ON, AND PROVIDE ANY ADDITIONAL WIRING/INTERLOCKING REQUIRED PER NFPA96 AND LOCAL CODES.
  - FOR EACH A/C UNIT, THE ELECTRICAL CONTRACTOR IS TO PROVIDE ONE SINGLE-GANG RECEPTACLE TEST STATION FOR THE REMOTE SENSOR AND/OR T-STAT, AND ONE DOUBLE-GANG RECEPTACLE TEST STATION FOR THE ANNUNCIATOR, WITH GREEN AND RED LIGHT INDICATORS. THE FIRE AND MECHANICAL INSPECTORS WILL DETERMINE SUITABLE LOCATION FOR TEST STATIONS. ANNUNCIATORS AND TEST STATION WILL BE LOOPED IN THE CIRCUITRY OF THE SMOKE DETECTION DEVICES. WIRING WILL BE INSTALLED BY ELECTRICAL CONTRACTOR.
  - MARKEL (OR EQUIVALENT) FAN-FORCED WALL HEATER WITH INTEGRAL THERMOSTAT PROVIDED BY ELECTRICAL CONTRACTOR. USE MODEL# HF3326TD-RP 3KW, 208V. COORDINATE LOCATION ON SITE WITH GC.
- PLUMBING CONTRACTOR
- THE PLUMBING CONTRACTOR IS TO PROVIDE AND INSTALL CONDENSATE DRAINS/GAS PIPING FOR ALL HVAC EQUIPMENT.
  - THE PLUMBING CONTRACTOR IS TO COORDINATE PLUMBING VENT STACKS AND WATER HEATER FLUES WITH OUTSIDE AIR INTAKES OF A/C UNITS. 10"-0" MINIMUM CLEARANCE REQUIRED OR PER LOCAL CODE.
  - THE PLUMBING CONTRACTOR IS TO PROVIDE AND INSTALL FLUE GAS EXHAUST VENT FOR WATER HEATER. MAINTAIN 10"-0" MINIMUM CLEARANCE TO AIR INTAKES, OR PER LOCAL CODE. COORDINATE ON SITE WITH G.C. AND HVAC CONTRACTOR.

### KEYED NOTES

- THERMOSTAT 66" A.F.F. IN A WALL NEAR LOCATION SHOWN. SEAL WALL OPENINGS WITH CAULK. AUDIO-VISUAL ANNUNCIATOR TIED INTO SMOKE DETECTOR. COORDINATE LOCATION ON SITE WITH G.C. AND EQUIPMENT. AVOID SOURCES OF HEAT. INSULATE BACKS OF STATS.
- ELECTRIC WATER HEATER - NO REQUIRE FLUE.
- PROVIDE EXHAUST GRILLES IN RESTROOM CEILINGS. RUN ROUND, SHEETMETAL DUCT FROM GRILLE TO INLINE EXHAUST FAN, TO EXTERIOR WALL DISCHARGE LOUVER AS SHOWN. OFFSET AND TRANSITION AT CONNECTIONS AS NEEDED. USE FACTORY-MANUFACTURED PIPE AND FITTINGS ONLY. CONFIRM LOCATION ON SITE WITH MOST RECENT KITCHEN PLANS.
- PROVIDE EXHAUST GRILLE IN KITCHEN CEILING. RUN ROUND, SHEETMETAL DUCT FROM GRILLE TO INLINE EXHAUST FAN, TO EXTERIOR WALL DISCHARGE LOUVER AS SHOWN. OFFSET AND TRANSITION AT CONNECTIONS AS NEEDED. USE FACTORY-MANUFACTURED PIPE AND FITTINGS ONLY. CONFIRM LOCATION ON SITE WITH MOST RECENT KITCHEN PLANS.
- PROVIDE OUTSIDE AIR SUPPLY GRILLE IN KITCHEN CEILING WITH INLINE DUCT HEATER AND THERMOSTAT. RUN ROUND, SHEETMETAL DUCT FROM GRILLE TO INLINE SUPPLY FAN, TO EXTERIOR WALL INTAKE LOUVER AS SHOWN. OFFSET AND TRANSITION AT CONNECTIONS AS NEEDED. USE FACTORY-MANUFACTURED PIPE AND FITTINGS ONLY. CONFIRM LOCATION ON SITE WITH MOST RECENT KITCHEN PLANS.
- PROVIDE NEW SHEETMETAL DUCTWORK AS SHOWN. VERIFY LOCATION AND ROUTING ON SITE PRIOR TO FABRICATION. ALL NEW DUCTWORK FABRICATED, INSTALLED, SEALED, AND EXTERNALLY INSULATED PER SMACNA AND LOCAL CODES.
- PROVIDE SUPPLY AIR CASSETTE AND EXTERIOR CONDENSING UNIT PER "MINI SPLIT SYSTEM" SCHEDULE. THIS SHEET. ALL WORK PER MANUFACTURERS PUBLISHED RECOMMENDATIONS, ASHRAE, IMC, AND LOCAL CODES. **NOTE: CONDENSER NOT SHOWN - VERIFY LOCATION ON SITE WITH GENERAL CONTRACTOR AND EXISTING CONDITIONS.**
- MARKEL (OR EQUIVALENT) FAN-FORCED WALL HEATER WITH INTEGRAL THERMOSTAT PROVIDED BY ELECTRICAL CONTRACTOR. USE MODEL# HF3326TD-RP 3KW, 208V. COORDINATE LOCATION ON SITE WITH GC.
- EXISTING AIR HANDLER AND CONDENSING UNIT (NOT SHOWN) TO REMAIN. VERIFY PROPER WORKING CONDITION IN FIELD. PROVIDE NEW DUCTWORK AS SHOWN.
- ROUTE REFRIGERANT GAS LINES TO CONDENSING UNIT EXTERIOR OF BUILDING PER MANUFACTURERS PUBLISHED RECOMMENDATIONS. **CONFIRM LOCATIONS ON SITE WITH GENERAL CONTRACTOR.**

### THERMOSTATIC CONTROLS

- A. GENERAL:  
 THE SUPPLY OF HEATING AND COOLING ENERGY TO EACH ZONE SHALL BE INDIVIDUALLY CONTROLLED BY THERMOSTATIC CONTROLS RESPONDING TO TEMPERATURE WITHIN THE ZONE. FOR THE PURPOSES OF SECTION C403.2.4 A DWELLING UNIT SHALL BE PERMITTED TO BE CONSIDERED A SINGLE ZONE.
- B. DEAD BAND:  
 WHERE USED TO CONTROL BOTH HEATING AND COOLING, ZONE THERMOSTATIC CONTROLS SHALL BE CAPABLE OF PROVIDING A TEMPERATURE RANGE OR DEAD BAND OF AT LEAST 5°F WITHIN WHICH THE SUPPLY OF HEATING AND COOLING ENERGY TO THE ZONE IS SHUT OFF OR REDUCED TO A MINIMUM.  
 EXCEPTIONS:  
 THERMOSTATS THAT REQUIRE MANUAL CHANGEOVER BETWEEN HEATING AND COOLING MODES.
- C. SETBACK CONTROLS:  
 HEATING SYSTEMS LOCATED IN CLIMATE ZONES 2-8 SHALL BE EQUIPPED WITH CONTROLS THAT HAVE THE CAPABILITY TO AUTOMATICALLY RESTART AND TEMPORARILY OPERATE THE SYSTEM AS REQUIRED TO MAINTAIN ZONE TEMPERATURES ABOVE A HEATING SETPOINT ADJUSTABLE DOWN TO 55°F OR LOWER. COOLING SYSTEMS LOCATED IN CLIMATE ZONES 1B, 2B, AND 3B SHALL BE EQUIPPED WITH CONTROLS THAT HAVE THE CAPABILITY TO AUTOMATICALLY RESTART AND TEMPORARILY OPERATE THE SYSTEM AS REQUIRED TO MAINTAIN ZONE TEMPERATURES BELOW A COOLING SETPOINT ADJUSTABLE UP TO 90°F OR HIGHER OR TO PREVENT HIGH SPACE HUMIDITY LEVELS.
- D. AUTOMATIC SHUTDOWN:  
 HVAC SYSTEMS SHALL BE EQUIPPED WITH AT LEAST ONE OF THE FOLLOWING CONTROLS THAT CAN START AND STOP THE SYSTEM UNDER DIFFERENT TIME SCHEDULES FOR SEVEN DIFFERENT DAY-TYPES PER WEEK, ARE CAPABLE OF RETAINING PROGRAMMING AND TIME SETTING DURING LOSS OF POWER FOR A PERIOD OF AT LEAST TEN HOURS, AND INCLUDE AN ACCESSIBLE MANUAL OVERRIDE, OR EQUIVALENT FUNCTION, THAT ALLOWS TEMPORARY OPERATION OF THE SYSTEM FOR UP TO TWO HOURS.
- E. SETPOINT OVERLAP RESTRICTION:  
 WHERE HEATING AND COOLING TO A ZONE ARE CONTROLLED BY SEPARATE ZONE THERMOSTATIC CONTROLS LOCATED WITHIN THE ZONE, MEANS (SUCH AS LIMIT SWITCHES, MECHANICAL STOPS, OR, FOR DDC SYSTEMS, SOFTWARE PROGRAMMING) SHALL BE PROVIDED TO PREVENT THE HEATING SETPOINT FROM EXCEEDING THE COOLING SETPOINT MINUS ANY APPLICABLE PROPORTIONAL BAND.
- F. HEAT PUMP SUPPLEMENTARY HEAT :  
 HEAT PUMPS HAVING SUPPLEMENTARY ELECTRIC RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST, PREVENT SUPPLEMENTARY HEAT OPERATION WHERE THE HEAT PUMP CAN PROVIDE THE HEATING LOAD.


AIR BALANCE SCHEDULE						
TAG	SUPPLY AIR	OUTSIDE AIR	RETURN AIR	EXHAUST AIR	BLDG. PRESSURE	% OUTSIDE AIR
AHU-2	1480 CFM	---	1480 CFM	---	---	---
AHU-1	1400 CFM	300 CFM	1100 CFM	---	+ 300 CFM	22
OAF-1	---	200 CFM	---	---	+ 200 CFM	100
EF-1	---	---	---	150 CFM	- 150 CFM	---
EF-2	---	---	---	300 CFM	- 300 CFM	---
TOTAL	2880 CFM	500 CFM	2580 CFM	450 CFM	+ 50 CFM	17

\* EXISTING, TO REMAIN. SET CAPACITIES AS SHOWN - V.L.F.


AIR DEVICE SCHEDULE								
SYM	SIZE	TYPE	DUCT SIZE	MODEL#	FINISH	BOOT SIZE	OPENING SIZE	QTY.
A*	24X24	SUPPLY 4 WAY	12"	NCA12	WHITE	12"	T-BAR	1
B**	18X12	SUPPLY SIDEWALL	---	FB20DF-1812	WHITE	12"	---	4
C**	24X24	SUPPLY PERF.	10"	APDF3-1024	WHITE	---	T-BAR	1
D	12X12	EXHAUST	6"	630	WHITE	12X12	SIZE + 1/4"	2
E	24X24	RETURN	16"	630TB	WHITE	22X22	T-BAR	1
F	18X18	EXHAUST	10"	630	WHITE	18X18	SIZE + 1/4"	1
G***	18X10	EXTERIOR LOUVER	---	GJL800D-1810	MILL	---	---	1

ALL DEVICES SHALL BE MANUFACTURED BY METALAIR OR EQUIVALENT AND 100% ALUMINUM CONSTRUCTION PUBLISHED INSTRUCTION AND LOCAL CODES.  
 \* PROVIDE WITH PVC99 SLIDING-BLADE DAMPER AND 24X24 LAY-IN FRAME FOR INSTALLATION  
 \*\* PROVIDE WITH 10" TO 8" REDUCER FOR TOP OF REDUCER  
 \*\*\* PROVIDE WITH INSECT SCREEN. **PENETRATION BY GC - VIF**  
 PROVIDE WITH TWO 24X24 LAY-IN FRAMES FOR INSTALLATION IN SHEETROCK CEILING

NOTE: ALL EXPOSED DUCTWORK IS TO BE DOUBLE-WALLED, INSULATED SPIRAL PIPE. COORDINATE ON SITE WITH G.C. AND EXISTING CONDITIONS. ENSURE THAT NO DUCT SEALER IS VISIBLE ON OUTSIDE OF DUCTWORK.

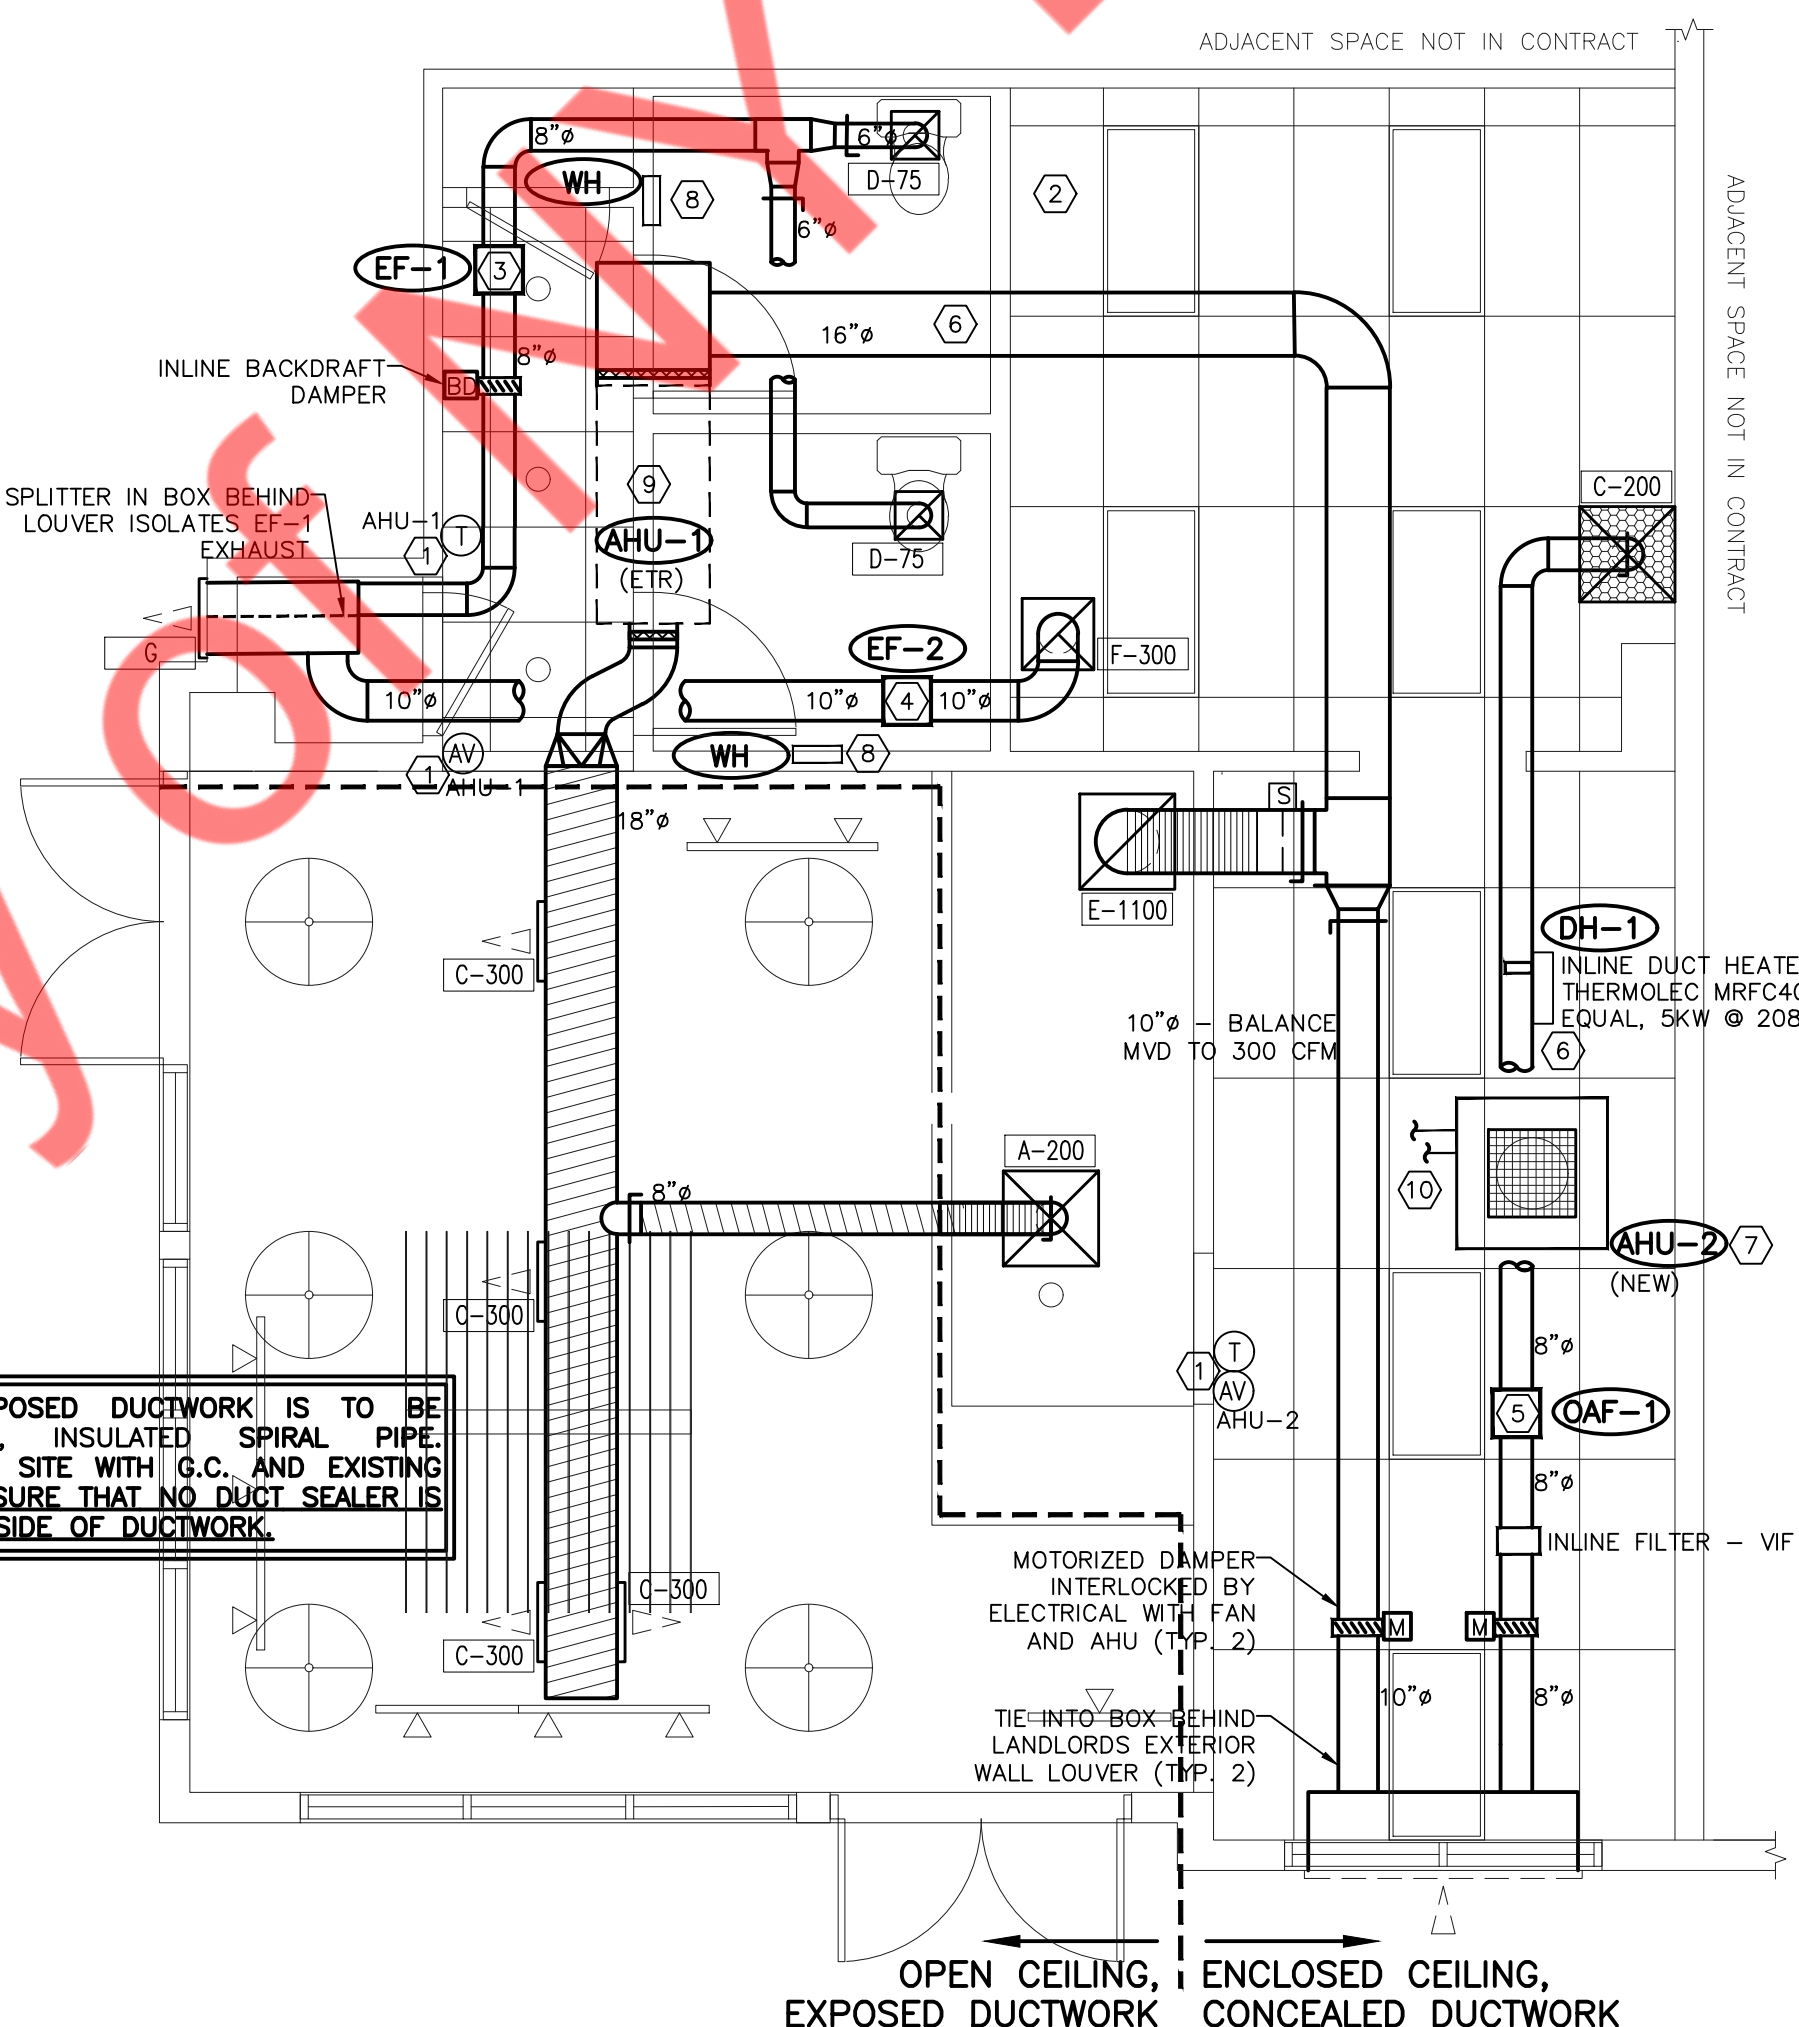

FLOOR PLAN - HVAC  
 SCALE 1/4" = 1' - 0" WHEN PLOTTED 36" X 24" 221081

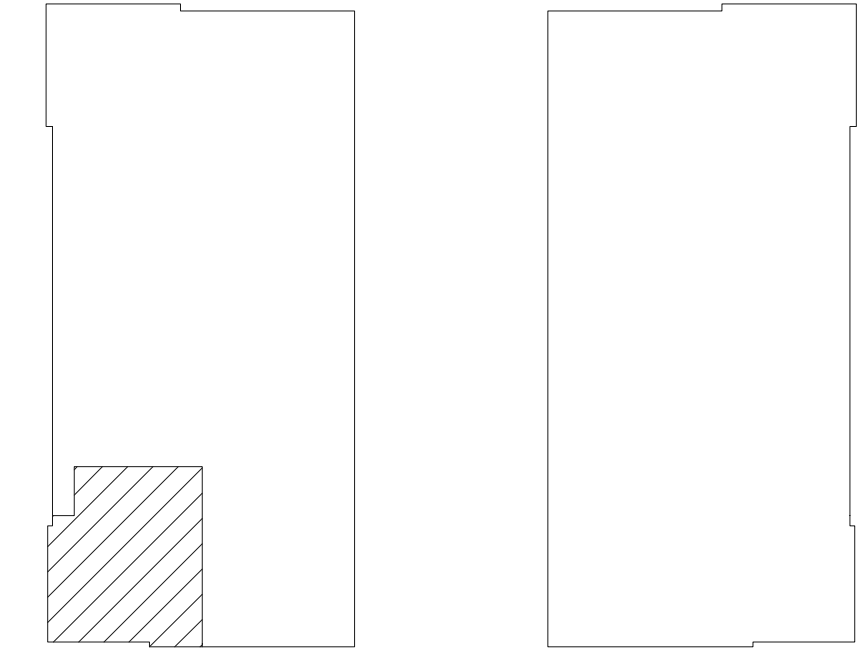

BUILDING KEY  
 SCALE 1/4" = 1' - 0"

SALT 2.0

HVAC FLOOR PLAN, NOTES, AND SCHEDULES

SHEET No.





M-1

© Copyright 2022- Drawings, specifications, notes, database, computer files, field data, and reports as instruments of service prepared by the Design of Record. As instruments of services, these items remain the property of the Design of Record, who shall retain all statutory and other reserved rights, including the copyright thereto. Any use, reproduction or changes to these documents without written consent of NCA Consultants is a violation of federal copyright laws.




DRAWING INFORMATION		
DATE	DESCRIPTION	BY
01-24-22	FOR CONSTRUCTION	KM
03-29-22	UPDATED	KM

NOTE: FOR AHU-2 AND CU-2 SEE MANUFACTURERS PUBLISHED LITERATURE THAT SHIPS WITH THE EQUIPMENT

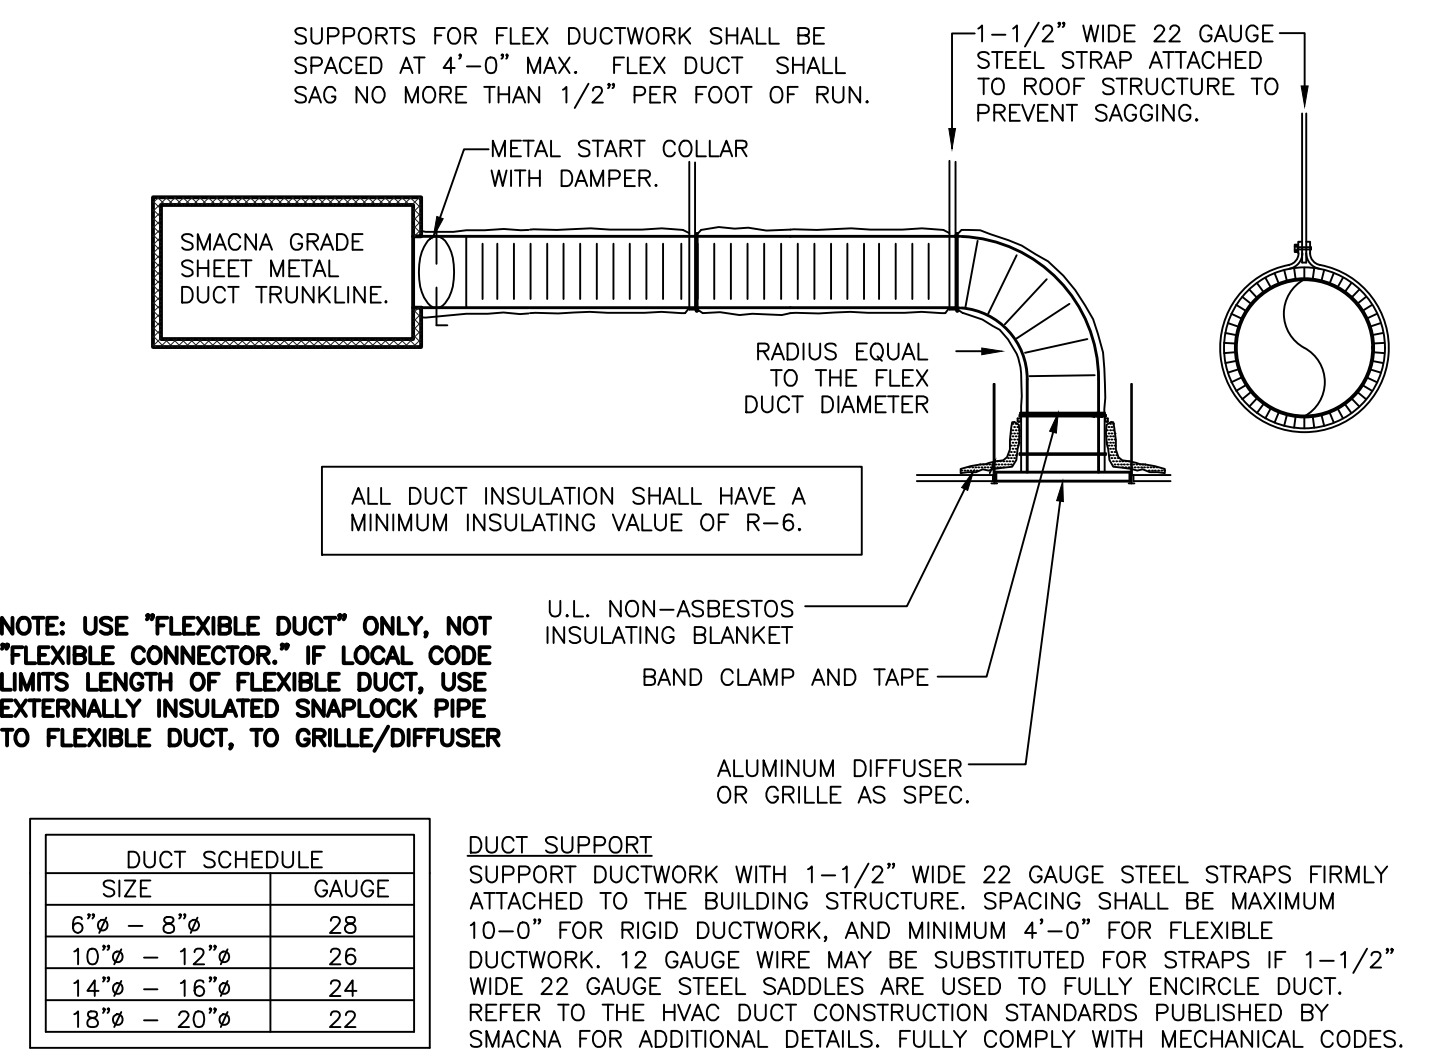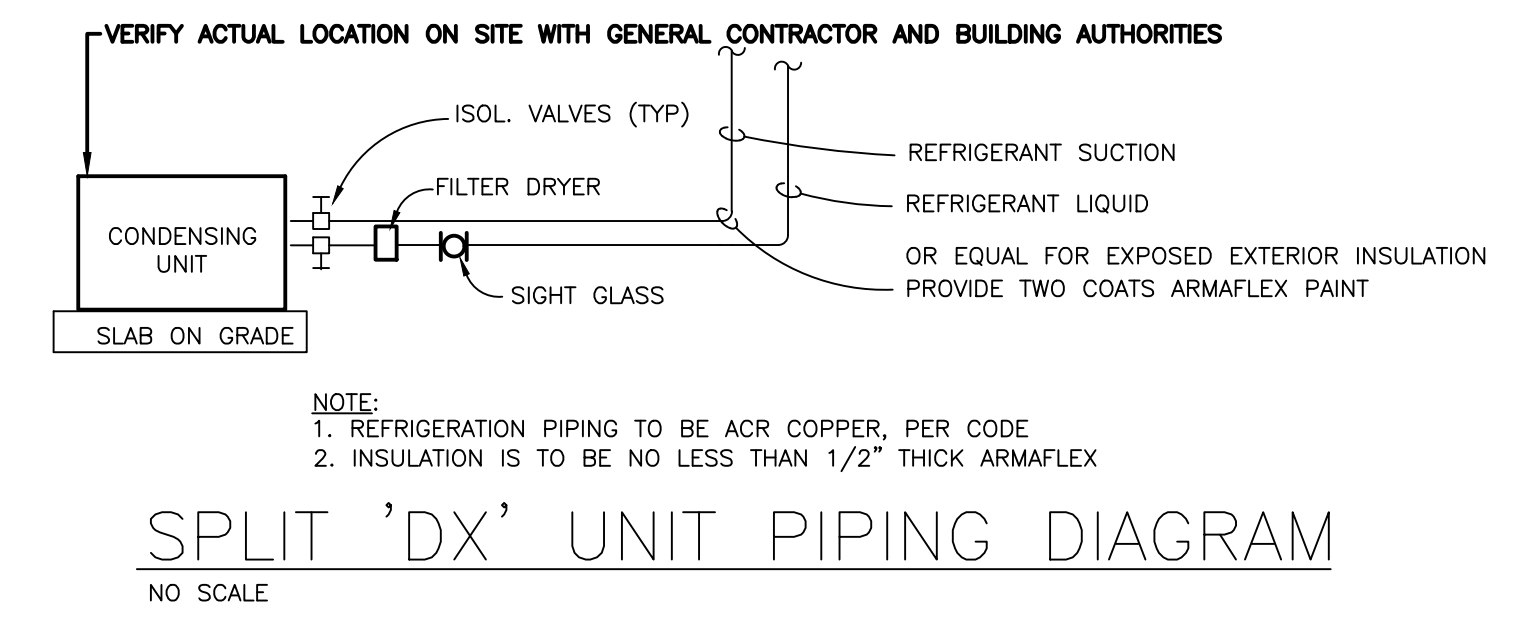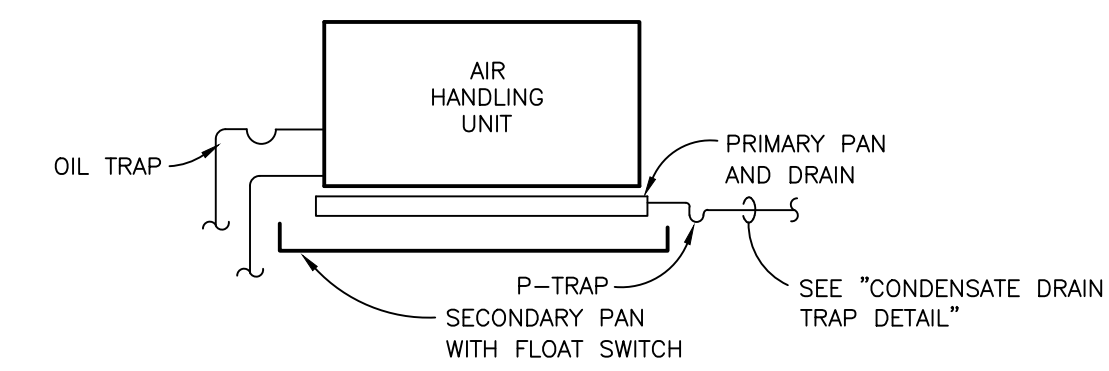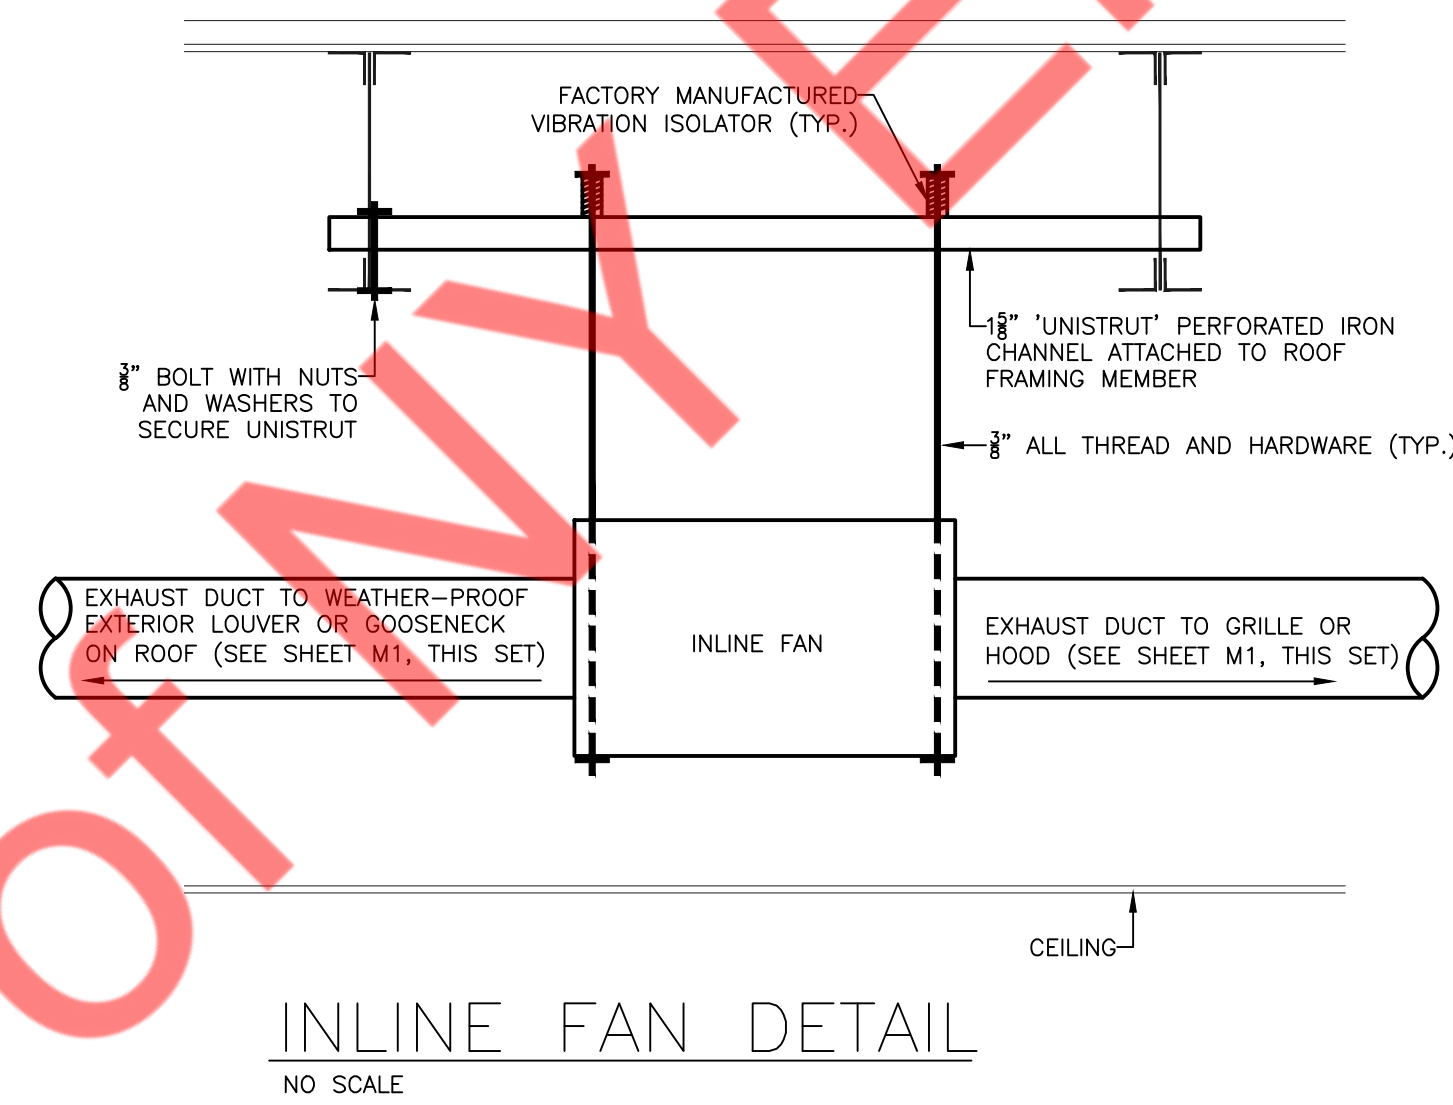

DUCT SCHEDULE	GAUGE
6" - 8"	28
10" - 12"	26
14" - 16"	24
18" - 20"	22

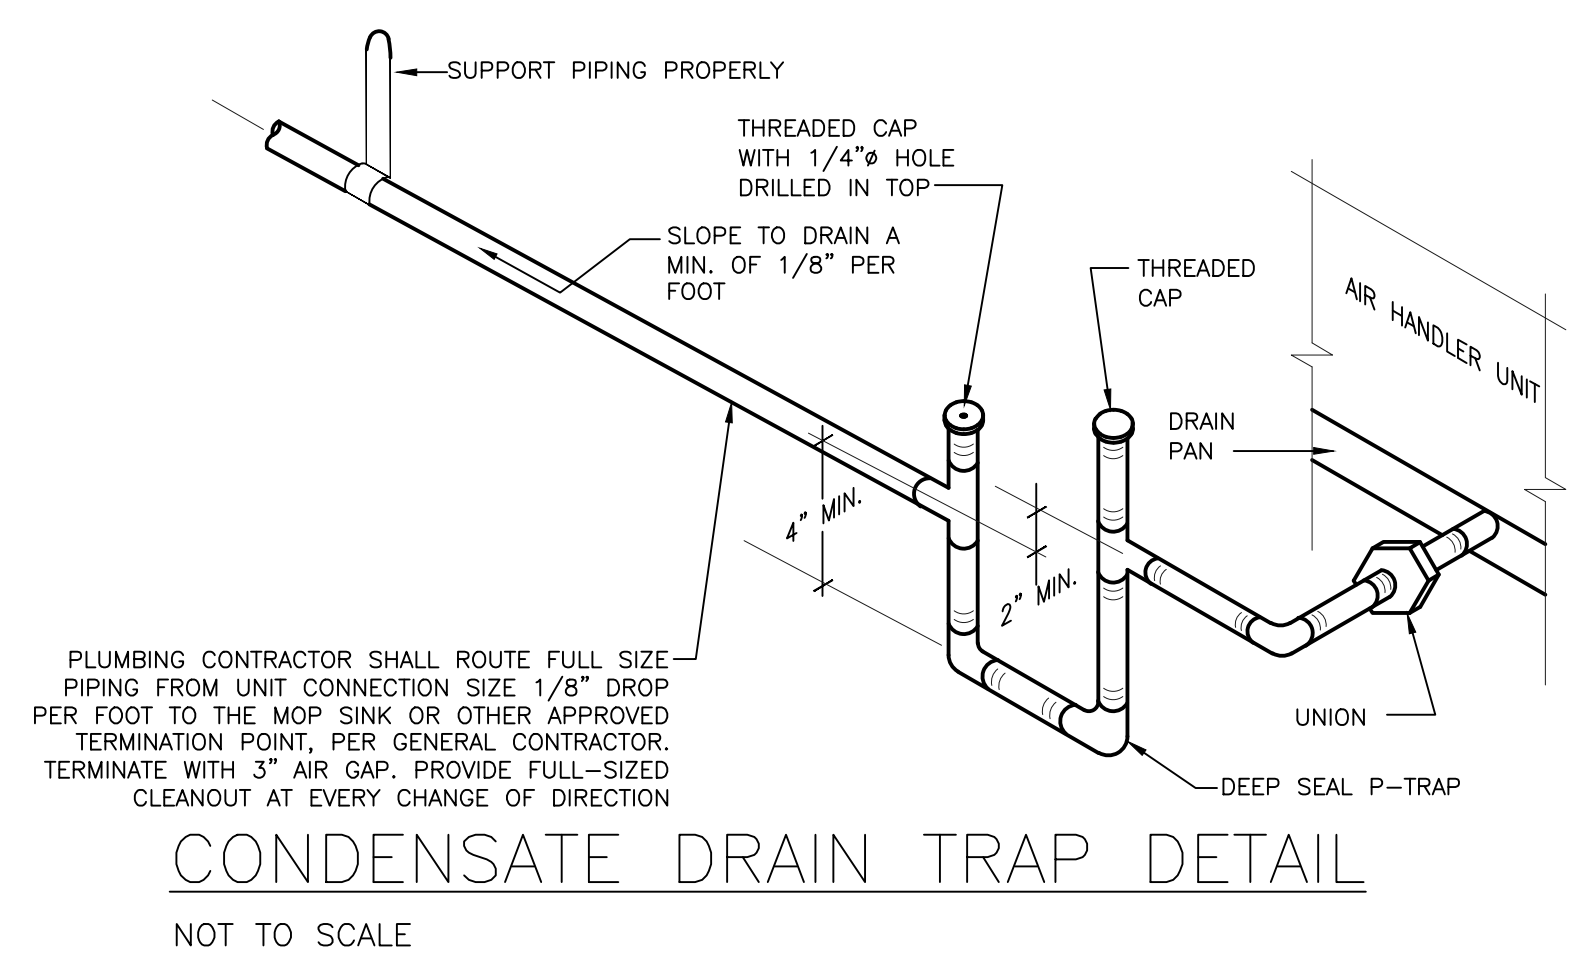

RIGID/FLEXDUCT CONNECTION/INSTALL DETAIL  
NOT TO SCALE

CONDENSATE DRAIN TRAP DETAIL  
NOT TO SCALE

© Copyright 2022- Drawings, specifications, notes, database, computer files, field data, and reports as instruments of service prepared by the Design of Record. As instruments of services, these items remain the property of the Design of Record, who shall retain all statutory and other reserved rights, including the copyright thereto. Any use, reproduction or changes to these documents without written consent of NCA Consultants is a violation of federal copyright laws.

SALT 2.0

DWG TITLE:  
HVAC DETAILS

SHEET No.  
M-2



# ELECTRICAL SYMBOLS LIST

# GENERAL NOTES

LIGHTING	
	LIGHTING FIXTURE AND OUTLET BOX. HALF SHADED FIXTURE OR "EM" INDICATES FIXTURES WITH INTEGRAL BATTERY PACK FOR EMERGENCY SERVICE, U.O.N.
	LUMINAIRE TYPE : INDICATE BY LIPPERCASE LETTER SEE LIGHTING EXTURE SCHEDULE.
	CIRCUIT NUMBER : INDICATED BY NUMBER
	SWITCHING INDICATED BY LOWER CASE LETTERS.
	EM DENOTES LUMINAIRE ON EMERGENCY CIRCUIT.
	NL DENOTES FIXTURES DESIGNATED AS NIGHTLIGHT, WIRED TO 24 HOURS UNSWITCHED CIRCUIT.
	CEILING/WALL MOUNTED SELF POWERED EXIT LIGHT FIXTURE WITH DIRECTIONAL ARROWS AS INDICATED. SHADED AREA DENOTES FACE(S). ISOLITE ELITE SERIES LED EXIT SIGN

POWER AND TELECOMMUNICATION	
	JUNCTION BOX WITH BLANK COVER PLATE, CEILING MOUNTED..
	DUPLEX CONVENIENCE RECEPTACLE, +12" AFF OR AS NOTED.
	DOUBLE DUPLEX RECEPTACLE - 20A-1P, 125V, NEMA 5-20R.
	TELEPHONE/DATA OUTLET, 4" SQUARE OUTLET BOX WITH SINGLE GANG COLLAR AND BLANK PLATE. RUN (2) COMPOSITE CABLES FROM EACH OUTLET TO NID BOX.
	DATA OUTLET - (1) PORT UNO, +18" AFF, UNO TEL / DATA OUTLET TO BE RUN (2) COMPOSITE CABLES FROM EACH OUTLET TO NID BOX

ELECTRICAL ABBREVIATIONS			
A	AMPERES	EA	EACH
A/C, AC	AIR CONDITIONING UNIT	EM	EMERGENCY
AF	AMPERE FRAME/AMP FUSE	EMT	ELECTRICAL METALLIC TUBING
AFF	ABOVE FINISHED FLOOR	EQUIP	EQUIPMENT
AS	AMP SWITCH	ER	EXISTING TO BE RELOCATED
AIC	AMPS INTERRUPTING CAPACITY	FA	FIRE ALARM
AT	AMP TRIP	E	EXISTING
ATS	AUTOMATIC TRANSFER SWITCH	FL	FLOOR
AUTO	AUTOMATIC	G	GROUND
AWG	AMERICAN WIRE GAUGE	GFI	GROUND FAULT INTERRUPTER
C	CONDUIT	GP	GENERAL PURPOSE
C/B,CB	CIRCUIT BREAKER	HP	HORSEPOWER
CKT	CIRCUIT	HWH	HOW WATER HEATER
CLG	CEILING	HZ	HERTZ
COMM	COMMUNICATION	IC	INTERRUPTING CAPACITY
CT	CURRENT TRANSFORMER	PP	POWER PANEL
CU	COPPER	PWR	POWER
DIA	DIAMETER	R	REMOVE
DISC	DISCONNECT	RE	RELOCATED EXISTING
DN	DOWN	REC	RECEPTACLE
DP	DISTRIBUTION PANEL	RGS	RIGID GALVANIZED STEEL
DWG	DRAWING	RR	REMOVE & RELOCATE
JB	JUNCTION BOX	SECT	SECTION
KCMIL	ONE THOUSAND CIRCULAR MILS	SPDT	SINGLE POLE DOUBLE THROW
KV	KILOVOLT	SPST	SINGLE POLE SINGLE THROW
KVA	KILOVOLT-AMPERES	SPEC	SPECIFICATION
KW	KILOWATTS	SW	SWITCH
LTG	LIGHTING	SWBD	SWITCHBOARD
MAX	MAXIMUM	SYM	SYMMETRICAL
MC	MOTOR CONTROLLER	SYS	SYSTEMS
MCB	MAIN CIRCUIT BREAKER	TELE	TELEPHONE
MLO	MAIN LUGS ONLY	TEMP	TEMPERATURE
MTD	MOUNTED	TXF	TOILET EXHAUST FAN
MTS	MANUAL TRANSFER SWITCH	TYP	TYPICAL
N	NEUTRAL	UON	UNLESS OTHERWISE NOTED
NIC	NOT IN CONTRACT	V	VOLT/VOLTAGE
NTS	NOT TO SCALE	VA	VOLT AMPERE
PNL	PANEL	WP	WEATHER PROOF
W	WATT	Ø	PHASE
RH	RANGE HOOD	DW	DISHWASHER
WA	WASHER	REF	REFRIGERATOR
DR	DRYER	MW	MICROWAVE

MOTORS AND CONTROLS	
	AC INDOOR UNIT MOTOR AS NOTED WITH LIQUID TIGHT FLEXIBLE CONNECTION WITH JUNCTION BOX AND MOTOR SWITCH.
	AC OUTDOOR UNIT MOTOR AS NOTED WITH CONTROLLER AND DISCONNECT SWITCH WITH WEATHER PROOF.
	NON FUSED DISCONNECT SWITCH AMPERAGE, AND NUMBER OF POLES AS NOTED.
	30A/240V NON FUSED DISCONNECT SWITCH
	60A/240V NON FUSED DISCONNECT SWITCH
	100A/240V NON FUSED DISCONNECT SWITCH
	200A/240V NON FUSED DISCONNECT SWITCH
	400A/240V NON FUSED DISCONNECT SWITCH
	MOTORIZED DAMPER.
	FIRE SMOKE DAMPER
	THERMAL OVERLOAD SWITCH AT MOTOR. PROVIDE THERMAL ELEMENTS AS PER MOTOR RATING.
	MANUAL MOTOR SWITCH
	ELECTRICAL HEATER, NUMBER DENOTES HEATER RATING
	DUPLEX PUMP. NUMBER INDICATES HP RATING OF PUMP.

SWITCHES AND CONTROLS	
	20A SPST TOGGLE SWITCH U.O.N. "a" DENOTES LIGHTING FIXTURE/SWITCHED RECEPTACLE CONTROLLED.
	20A 3-WAY TOGGLE SWITCH U.O.N. "a" DENOTES LIGHTING FIXTURE CONTROLLED
	CEILING OCCUPANCY SENSOR, NUMBER INDICATES TYPE; SEE OCCUPANCY SENSOR SCHEDULE. 'A' LETTER REFERES TO WIRING DIAGRAM.
	WALL MOUNTED PHOTOCCELL MOUNTED IN NEMA 3R ENCLOSURE.
	WALL OCCUPANCY SENSOR, NUMBER INDICATES TYPE.

ELECTRICAL DRAWING LIST	
E-1	ELECTRICAL SYMBOL LIST, ABBREVIATIONS & GENERAL NOTES
E-2	ELECTRICAL SPECIFICATIONS SHEET 1 OF 2
E-3	ELECTRICAL SPECIFICATIONS SHEET 2 OF 2
E-4	ELECTRICAL LIGHTING PLAN AND POWER PLAN
E-5	ELECTRICAL DETAILS
E-6	ELECTRICAL RISER DIAGRAM AND PANEL SCHEDULES

ANNOTATION	
	INDICATES MOUNTING HEIGHT, CENTER LINE TO FINISHED FLOOR.
	KEYED NOTE REFERENCE
	DETAIL REFERENCE: DETAIL NUMBER INDICATED ON TOP; DRAWING NUMBER INDICATED ON BOTTOM

POWER DISTRIBUTION	
	POWER PANELBOARD, 208Y/120V-SURFACE MOUNTED.

- ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE CURRENT VERSION OF THE LOCAL ELECTRICAL CODE, 2017 NEC, LOCAL JURISDICTION REQUIREMENTS, AND ALL GOVERNING LOCAL CODES, LAWS, AND REGULATIONS.
- CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH ALL EXISTING CONDITIONS THAT MAY AFFECT THE WORK. NO ADDITIONAL COMPENSATION WILL BE CONSIDERED FOR FAILURE TO DO SO.
- CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, TEST REPORTS, AND CERTIFICATIONS FOR TEMPORARY AND FINAL CERTIFICATE OF OCCUPANCY.
- FIRE STOP ALL PENETRATIONS OF FIRE RATED CONSTRUCTION IN A CODE APPROVED MANNER IN ORDER TO MAINTAIN FIRE RATING. ALL PENETRATIONS SHALL BE SLEEVED AND SEALED WATERTIGHT.
- SECURE ALL SUPPORTS TO BUILDING STRUCTURE UTILIZING TOGGLE BOLTS (HOLLOW MASONRY), EXPANSION SHIELDS OR INSERTS (CONCRETE AND BRICK), MACHINE SCREWS (METAL), BEAM CLAMPS (FRAMEWORK), WOOD SCREWS (WOOD) OR PAN THRU STRAPS (METAL DECK). NAILS, RAWL PLUGS AND WOOD PLUGS ARE NOT PERMITTED. WHERE REQUIRED BY STRUCTURE, PROVIDE THRU BOLTS AND FISH PLATES. SUPPORT HORIZONTAL RUNS OF METALLIC RACEWAYS NOT MORE THAN 10 FT APART. SUPPORT RACEWAY RISERS AT EACH FLOOR LEVEL. RUN EXPOSED RACEWAYS PARALLEL WITH OR AT RIGHT ANGLES TO WALLS.
- LEAVE WIRES WITH SUFFICIENT SLACK TO PERMIT MAKING FINAL CONNECTIONS. RACEWAYS OVER 10 FT LONG IN WHICH WIRING IS NOT INSTALLED: FURNISH FISH WIRE.
- VERIFY LOCATIONS OF OUTLETS AND SWITCHES IN FINISHED ROOMS WITH ARCHITECTURAL DRAWINGS OF INTERIOR DETAILS AND FINISH. IN CENTERING OUTLETS AND LOCATING BOXES AND OUTLETS, ALLOW FOR OVERHEAD PIPES, DUCTS AND MECHANICAL EQUIPMENT, EQUIPMENT, VARIATIONS IN FIREPROOFING AND PLASTERING, WINDOW AND DOOR TRIM, PANELING, HUNG CEILINGS AND THE LIKE. CORRECT ANY INACCURACY RESULTING FROM FAILURE TO DO SO WITHOUT EXPENSE TO OWNER.
- CONTRACTOR SHALL PROVIDE A WARRANTY ON ALL MATERIALS, EQUIPMENT, AND WORKMANSHIP FOR A PERIOD OF ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE.
- ALL UNUSED MATERIALS AND DEBRIS SHALL BE LEGALLY REMOVED AND DISPOSED OF AWAY FROM THE PREMISES ON A DAILY BASIS.
- CONTRACTOR SHALL PATCH, PAINT, AND RESTORE EXISTING SURFACES DAMAGED DURING THE COURSE OF THIS CONSTRUCTION TO PRE-EXISTING CONDITIONS OR BETTER.
- MINIMUM SIZE OF CONDUIT SHALL BE 3/4", AND TYPE SHALL BE ELECTRICAL METALLIC TUBING (EMT), UNLESS OTHERWISE NOTED. PROVIDE NYLON DRAG LINE AND CONDUIT CAP FOR ALL EMPTY CONDUITS.
- CONNECT CONDUIT TO MOTOR CONDUIT TERMINAL BOXES WITH FLEXIBLE CONDUIT (MINIMUM 18 IN. LENGTH AND 50% SLACK). DO NOT TERMINATE IN OR FASTEN RACEWAYS TO MOTOR FOUNDATION.
- PULL AND JUNCTION BOXES WHERE INDICATED ON THE DRAWINGS, SHALL BE CONSIDERED SHOWN AT THEIR APPROXIMATE LOCATION. THE CONTRACTOR SHALL LOCATE THEM AS FIELD CONDITIONS DICTATE. ADDITIONAL PULL AND JUNCTION BOXES NOT SHOWN ON DRAWINGS SHALL BE PROVIDED WHERE REQUIRED BY APPLICABLE CODE PROVISIONS OR WHERE CALLED FOR BY FIELD CONDITIONS. PULL AND JUNCTION BOXES SHALL BE SURFACE TYPE IN UNFINISHED AREAS AND INSTALLED CONCEALED IN FINISHED AREAS, AND ALL COVERS TO PULL & JUNCTION BOXES SHALL BE READILY ACCESSIBLE.
- SUPPORT PANEL, JUNCTION AND PULLBOXES INDEPENDENTLY TO BUILDING STRUCTURE WITH NO WEIGHT BEARING ON RACEWAYS.
- FOR EXACT LOCATION AND MOUNTING HEIGHT OF LIGHTING FIXTURES AND SWITCH/RECEPTACLE OUTLETS, REFER TO ARCHITECTURAL REFLECTED CEILING AND POWER PLANS.
- ALL ELECTRICAL ACCESSORIES AND EQUIPMENT INSTALLED OUTSIDE OR EXPOSED TO WEATHER SHALL HAVE NEMA 3R ENCLOSURES AND SHALL BE TIGHTLY GASKETED FOR A COMPLETE RAIN/TIGHT INSTALLATION. ALL BUILDING EXTERIOR MOUNTED RECEPTACLES SHALL BE GFCI RATED AND MOUNTED IN WEATHERPROOF ENCLOSURE.
- ALL ACCESS PANEL LOCATIONS SHALL BE REVIEWED BY ARCHITECT PRIOR TO INSTALLATION.
- ELECTRICAL CONTRACTOR SHALL COORDINATE THE LOCATION AND INSTALLATION OF NEW WORK WITH THE GENERAL CONTRACTOR AND OTHER ASSOCIATED TRADES IN A TIMELY MANNER. THE CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFYING ALL DIMENSIONS AND CONDITIONS PRIOR TO CONSTRUCTION. REFER TO ALL GENERAL, MECHANICAL, AND ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR THIS PROJECT.
- ALL CONDUITS AND EQUIPMENT TO BE CONCEALED IN FINISHED SPACES UNLESS OTHERWISE NOTED. CONDUITS SHALL BE ENCASED IN THE CONCRETE FLOOR SLAB.
- ALL EQUIPMENT AND MATERIALS INSTALLED IN PLENUM CEILINGS SHALL BE APPROVED FOR THAT APPLICATION.
- OUTLET BOXES AND JUNCTION BOXES ON OPPOSITE SIDES OF FIRE-RATED WALLS SHALL BE SEPARATED BY A HORIZONTAL DISTANCE OF NOT LESS THAN 24" INCHES, UNLESS FIRE-RATED BOXES OR PUTTY PADS ARE UTILIZED.
- COORDINATE ALL FLOOR PENETRATIONS WITH THE STRUCTURAL AND ARCHITECTURAL DRAWINGS. CONFIRM PENETRATION LOCATIONS WITH THE ENGINEER AND OWNER BEFORE INSTALLATION.
- COORDINATE THE MOUNTING HEIGHT AND LOCATION OF RACEWAYS, COMMUNICATIONS OUTLETS, AND RECEPTACLES WITH THE ARCHITECTURAL CASEWORK DRAWINGS AND DETAILS. COORDINATE LOCATIONS OF LIGHT FIXTURES, SWITCHES, AND RELATED DEVICES WITH THE ARCHITECTURAL DRAWINGS AND DETAILS.
- REFER TO ARCHITECTURAL PLANS FOR FINAL LOCATIONS OF ALL LUMINAIRES AND SWITCHES, AND FOR ALL FINISHED CEILING HEIGHTS.
- REFER TO ARCHITECTURAL PLANS FOR FINAL LOCATIONS OF ALL ELECTRICAL DEVICES, AND FOR FINAL CEILING AND WALL HEIGHTS AND LAYOUTS.
- LIGHTING FIXTURES PROVIDED WITH EMERGENCY BATTERY PACKS AND INDICATED WITH SWITCH CONTROL SHALL BE WIRED WITH BATTERY CHARGING/SENSING CIRCUIT WIRED AHEAD OF SWITCH CONTROL.
- NUMBER(S) SHOWN AT RECEPTACLES, JUNCTION BOXES AND EQUIPMENT INDICATES CIRCUIT NUMBERS IN PANELBOARD. PROVIDE WIRE AND CONDUIT TO INTERCONNECT EQUIPMENT AND DEVICES WITH SAME CIRCUIT NUMBERS AND RUN TO PANELBOARD.

Property of SALT 2.0

SALT 2.0

DWG TITLE:  
ELECTRICAL  
SYMBOLS LIST,  
ABBREVIATIONS &  
GENERAL NOTES

SHEET No.  
**E-1**



ELECTRICAL SPECIFICATIONS

- 1. GENERAL:
A. THE "GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION," AIA DOCUMENT A201, LATEST EDITION, AND THESE SPECIFICATIONS AS APPLICABLE ARE PART OF THIS CONTRACT.
B. DRAWING ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS AND WORK. CONDUIT ROUTING IS SHOWN DIAGRAMMATICALLY AND DOES NOT SHOW ALL OFFSETS, DROPS AND RISES OF RUNS. THE CONTRACTOR SHALL ALLOW IN HIS PRICE FOR ROUTING OF CONDUIT TO AVOID OBSTRUCTIONS. COORDINATION WITH EXISTING SERVICES, INCLUDING THOSE OF OTHER TRADES, IS REQUIRED, MAINTAIN HEADROOM AND SPACE CONDITIONS.
C. BIDDERS, BEFORE SUBMITTING PROPOSALS, SHALL VISIT AND CAREFULLY EXAMINE THE AREA AFFECTED BY THIS WORK TO FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS AND THE DIFFICULTIES THAT WILL ATTEND THE EXECUTION OF THIS WORK. SUBMISSION OF A PROPOSAL WILL BE CONSTRUED AS EVIDENCE THAT SUCH AN EXAMINATION HAS BEEN MADE, AND LATER CLAIMS WILL NOT BE RECOGNIZED FOR EXTRA LABOR, EQUIPMENT, OR MATERIALS, REQUIRED BECAUSE OF DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN HAD SUCH AN EXAMINATION BEEN MADE.
D. INSTALL WORK SO AS TO BE READILY ACCESSIBLE FOR OPERATION, MAINTENANCE AND REPAIR. MINOR DEVIATIONS FROM DRAWING MAY BE MADE TO ACCOMPLISH THIS, BUT CHANGES WHICH INVOLVE EXTRA COST SHALL NOT BE MADE WITHOUT APPROVAL.
E. REMOVAL AND RELOCATION OF CERTAIN EXISTING WORK MAY BE NECESSARY FOR THE PERFORMANCE OF THE GENERAL WORK, ALL EXISTING CONDITIONS CANNOT BE COMPLETELY DETAILED ON THE DRAWINGS. THE CONTRACTOR SHALL SURVEY THE SITE AND INCLUDE ALL CHANGES AND CHARGES IN MAKING UP THE WORK PROPOSAL.
F. CONNECTIONS TO EXISTING WORK: INSTALL NEW WORK AND CONNECT TO EXISTING WORK WITH MINIMUM INTERFERENCE TO EXISTING FACILITIES. TEMPORARY SHUTDOWNS OF EXISTING SERVICES SHALL BE PERFORMED AT NO ADDITIONAL CHARGES. AT TIMES NOT TO INTERFERE WITH NORMAL OPERATION OF EXISTING FACILITIES AND ONLY WITH WRITTEN CONSENT OF OWNER, ALARM AND EMERGENCY SYSTEMS SHALL NOT BE INTERRUPTED. MAINTAIN CONTINUOUS OPERATION OF EXISTING FACILITIES AS REQUIRED WITH NECESSARY TEMPORARY CONNECTIONS BETWEEN NEW AND EXISTING WORK. CONNECT NEW WORK TO EXISTING WORK IN NEAT AND ACCEPTABLE MANNER. RESTORE EXISTING DISTURBED WORK TO ORIGINAL CONDITION, INCLUDING MAINTENANCE OF WIRING CONTINUITY AS REQUIRED.
G. DISCONNECT, REMOVE AND/OR RELOCATE EXISTING MATERIAL, EQUIPMENT AND OTHER WORK AS NOTED OR REQUIRED FOR PROPER INSTALLATION OF NEW WORK.
H. THE CONTRACTOR SHALL KEEP ALL EQUIPMENT AND MATERIALS, AND ALL PARTS OF THE BUILDING EXTERIOR SPACES AND ADJACENT STREETS, SIDEWALKS AND PAVEMENTS, FREE FROM MATERIAL AND DEBRIS RESULTING FROM THE EXECUTION OF THIS WORK. EXCESS MATERIALS WILL NOT BE PERMITTED TO ACCUMULATE EITHER ON THE INTERIOR OR THE EXTERIOR.
I. SEAL OPENINGS THROUGH PARTITIONS, WALLS AND FLOORS WITH MINERAL WOOL OR OTHER NONCOMBUSTIBLE MATERIAL, UNLESS OTHERWISE NOTED.
J. PROVIDE ALL NECESSARY FLASHING AND COUNTER FLASHING TO MAINTAIN THE WATERPROOFING INTEGRITY OF THE BUILDING AS REQUIRED BY THE INSTALLATION OR REMOVAL OF CONDUIT AND EQUIPMENT, PROVIDE EQUIPMENT CURBS AS REQUIRED.
K. ALL EXISTING MATERIAL, EQUIPMENT AND CONSTRUCTION DEBRIS TO BE REMOVED UNDER THIS CONTRACT SHALL BECOME THE PROPERTY OF THE CONTRACTOR WITH THE EXCEPTION OF SPECIFIC EQUIPMENT AND APPARATUS REQUESTED BY THE BUILDING REPRESENTATIVE, ARCHITECT OR AS NOTED TO BE RELOCATED ON THE DRAWINGS. REMOVED EQUIPMENT SHALL BE PROPERLY DISPOSED OF BY THIS CONTRACTOR.
L. THE CONTRACTOR'S PROPOSAL FOR ALL WORK SHALL BE PREDICATED ON THE PERFORMANCE OF THE WORK DURING REGULAR WORKING HOURS. WHEN SO DIRECTED, HOWEVER, THE CONTRACTOR SHALL INSTALL WORK DURING OVERTIME HOURS AND THE ADDITIONAL COST TO BE CHARGED THEREFORE SHALL BE ONLY THE "PREMIUM" PORTION OF THE WAGES PAID.
M. UNLESS OTHERWISE SPECIFICALLY NOTED OR SPECIFIED, INCLUDE ALL CUTTING AND PATCHING OF EXISTING FLOORS, WALLS, PARTITIONS AND OTHER MATERIALS IN THE EXISTING BUILDING. THE CONTRACTOR SHALL RESTORE THESE AREAS TO ORIGINAL CONDITION.
N. ALL MATERIAL AND EQUIPMENT SHALL BE NEW UNLESS OTHERWISE NOTED AND SHALL BE IN ACCORDANCE WITH BUILDING STANDARDS.
O. INSURANCE: PROVIDE IN ACCORDANCE WITH OWNER/BUILDING REQUIREMENTS AND SHALL INCLUDE A HOLD HARMLESS CLAUSE FOR OWNER AND ENGINEER.
P. THE FINAL ACCEPTANCE SHALL BE MADE AFTER THE CONTRACTOR HAS ADJUSTED HIS EQUIPMENT, TESTED THE VARIOUS SYSTEMS, DEMONSTRATED THAT IT FULFILLS THE REQUIREMENTS OF THE DRAWINGS AND SPECIFICATIONS AND HAS FURNISHED ALL THE REQUIRED CERTIFICATED OF INSPECTION AND APPROVAL.
2. GENERAL PROVISIONS FOR ELECTRICAL WORK:
A. DEFINITIONS:
1) "PROVIDE": TO FURNISH, INSTALL AND CONNECT UP COMPLETE AND READY FOR SAFE AND REGULAR OPERATION THE PARTICULAR WORK REFERRED TO UNLESS SPECIFICALLY OTHERWISE NOTED.
2) "INSTALL": TO ERECT, MOUNT AND CONNECT COMPLETE WITH RELATED ACCESSORIES.
3) "FURNISH" OR "SUPPLY": TO PURCHASE, PROCURE, ACQUIRE, AND DELIVER COMPLETE WITH RELATED ACCESSORIES.
4) "WORK": LABOR, MATERIALS, EQUIPMENT, APPARATUS, CONTROLS, ACCESSORIES AND OTHER ITEMS REQUIRED FOR PROPER AND COMPLETE INSTALLATION.
5) "WIRING": RACEWAY, FITTINGS, WIRE, BOXES, AND RELATED ITEMS.
6) "CONCEALED": EMBEDDED IN MASONRY OR OTHER CONSTRUCTION, INSTALLED IN FURRED SPACES, WITHIN DOUBLE PARTITIONS OR HUNG CEILINGS, IN TRENCHES, IN CRAWL SPACES, OR IN ENCLOSURES.
7) "EXPOSED": NOT INSTALLED UNDERGROUND OR "CONCEALED" AS DEFINED ABOVE.
8) "SIMILAR" OR "EQUAL": EQUAL IN MATERIALS, WEIGHT, SIZE, DESIGN AND EFFICIENCY OF SPECIFIED PRODUCT.
B. TEMPORARY LIGHT AND POWER: PROVIDE TEMPORARY LIGHT AND POWER SYSTEMS AT EARLIEST POSSIBLE DATE WITHIN THE CONSTRUCTION AREAS FOR THE REQUIREMENTS OF ALL TRADES AS HEREIN DESCRIBED. EXTEND SYSTEMS TO NEW CONSTRUCTION AS SOON AS PHYSICALLY POSSIBLE. MAINTAIN SYSTEM DURING WORKING OWNER. PROVIDE ALL REQUIRED MAINTENANCE, INCLUDING LAMPS AND SOCKETS.
C. QUALITY ASSURANCE
1) QUALITY OF MATERIALS: ALL EQUIPMENT SHALL BE NEW SPECIFICATION GRADE, FREE FROM DEFECTS AND LISTED BY APPROVED TESTING AGENCY AND BEARING THEIR LABEL MATERIALS AND EQUIPMENT OF SIMILAR APPLICATION SHALL BE OF SAME MANUFACTURER, EXCEPT AS NOTED.
2) GUARANTEE: ALL MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED AS DEFINED IN PARAGRAPH 2.C.
3) CURRENT CHARACTERISTICS:
a. SERVICE: 120/208 VOLT, 3 PHASE, 4 WIRE, 60 HERTZ WITH GROUNDED NEUTRAL.
b. DISTRIBUTION: 120/208 VOLT, 3 PHASE, 4 WIRE, 60 HERTZ WITH GROUNDED NEUTRAL.

- 4) HEIGHTS OF OUTLETS:
a. FROM FINISHED FLOOR TO CENTERLINE OF OUTLETS FOR:
- RECEPTACLES AND TELEPHONES: 1 FT-6 IN.
- WALL SWITCHES: 4 FT-0 IN.
- WALL FIXTURES: 7 FT-0 IN.
- MOTOR CONTROLLERS: 5 FT-0 IN.
- CLOCKS: 7 FT 6 IN.
b. EXCEPTIONS: AT JUNCTION OF DIFFERENT WALL FINISH MATERIALS, ON MOLDING OR BREAK IN WALL SURFACE, IN VIOLATION OF CODE, OR AS NOTED OR DIRECTED.
D. PRODUCT DELIVERY, STORAGE AND HANDLING
1) MOVING OF EQUIPMENT: WHERE NECESSARY, SHIP IN CARTED SECTIONS OF SIZE TO PERMIT PASSING THROUGH AVAILABLE SPACES.
2) ACCESSIBILITY: FOR OPERATION, MAINTENANCE AND REPAIR, MINOR DEVIATIONS SHALL BE PERMITTED, CHANGES OF MAGNITUDE OR INVOLVING EXTRA COST ARE NOT PERMISSIBLE WITHOUT REVIEW. GROUP CONCEALED ELECTRICAL EQUIPMENT REQUIRING ACCESS WITH EQUIPMENT FREELY ACCESSIBLE THROUGH ACCESS DOORS.
E. MATERIALS
1) NAMEPLATES: PROVIDE BLACK LAMICOID SHEET WITH 3/4 IN. WHITE LETTERING, FASTENED WITH EPOXY CEMENT FOR EACH DISCONNECT SWITCH, CIRCUIT BREAKER, PANEL, CABINET, TRANSFORMER, ENCLOSURE, MOTOR CONTROLLER AND THE LIKE. NAMEPLATES SHALL DESCRIBE THE NAME AND NUMBER OF EACH COMPONENT.
2) CABLE TAGS: TAG EACH CONDUCTOR PASSING THROUGH SPLICE OR PULLBOX WITH A WHITE LINEN TAG, INDICATING POINT OF ORIGIN AND TERMINATION OF THE CIRCUIT.
3) INSERTS AND SUPPORTS:
a. INSERTS: STEEL, SLOTTED TYPE, FACTORY PAINTED.
- SINGLE ROD: SIMILAR TO GRINNELL FIG. 281.
- MULTI-ROD: SIMILAR TO FEE AND MASON SERIES 9000 WITH END CAPS AND CLOSURE STRIPS.
- CLIP FORM NAILS FLUSH WITH INSERTS.
- MAXIMUM LOADING 75 PERCENT OF RATING.
b. SUPPORTS FROM BUILDING CONSTRUCTION: INSERTS, BEAM CLAMPS, STEEL FISHPLATES (IN CONCRETE FILL ONLY), CANTILEVER BRACKETS OR OTHER MEANS. SUBMIT FOR REVIEW.
c. GROUPED LINES AND SERVICES: TRAPEZOID HANGERS OF BOLTED ANGLES OR CHANNELS.
d. WHERE BUILDING CONSTRUCTION IS INADEQUATE: PROVIDE ADDITIONAL FRAMING. SUBMIT FOR REVIEW.
F. PAINT SHALL BE THE BEST GRADE FOR ITS PURPOSE. DELIVER IN ORIGINAL SEALED CONTAINERS AND APPLY IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. COLORS SHALL BE AS SELECTED BY ARCHITECT OR ENGINEER. UTILIZE GALVANIZED IRON PRIMER ON PANEL AND PULL BOXES, AFTER FABRICATION. UTILIZE NOT DIPPED GALVANIZED OR DIPPED IN ZINC BASED PRIMER FOR: OUTLET BOXES, JUNCTION BOXES, CONDUIT HANGERS, RODS, INSERTS AND SUPPORTS. ZINC-BASED PRIMER WITH FINISH TO MATCH SURROUNDINGS SHALL BE USED FOR MARRED SURFACES OF STEEL EQUIPMENT AND RACEWAYS. A FIELD-APPLIED ZINC BASED PRIME COAT SHALL BE UTILIZED FOR STEEL OR IRONWORK.
G. BRUSH AND CLEAN WORK PRIOR TO CONCEALING, PAINTING AND ACCEPTANCE. PAINTED EXPOSED WORK SOILED OR DAMAGED; CLEAN AND REPAIR TO MATCH ADJOINING WORK BEFORE FINAL ACCEPTANCE. REMOVE DEBRIS FROM INSIDE AND OUTSIDE OF MATERIAL AND EQUIPMENT.
H. FINAL LOCATIONS AND MOUNTING ORIENTATIONS OF ALL SWITCHES, RECEPTACLES AND LIGHT FIXTURES SHALL BE VERIFIED WITH ARCHITECT.
I. ALL ACCESS DOOR LOCATIONS SHALL BE REVIEWED BY ARCHITECT PRIOR TO INSTALLATION.
3. SCOPE OF WORK:
A. SCOPE OF WORK SHALL CONSIST OF PROVIDING LABOR, MATERIALS, EQUIPMENT, SERVICES AND FEES NECESSARY FOR COMPLETE AND SAFE INSTALLATION IN CONFORMING WITH THE 2017 NATIONAL ELECTRICAL CODE (NEC) WITH AMENDMENTS, AND ALL OTHER APPLICABLE INDUSTRY, NATIONAL AND LOCAL CODES AND AUTHORITIES HAVING JURISDICTION, AS INDICATED ON DRAWINGS AND HEREIN SPECIFIED.
B. ALL DRAWINGS, PLANS, DETAILS, SPECIFICATIONS AND SPECIFICATION ADDENDA ARE MADE PART OF THIS CONTRACT AND SHALL APPLY TO ALL WORK UNDER THE CONTRACT UNLESS OTHERWISE AMENDED, MODIFIED, SUPPLIED OR SPECIFIED HEREIN.
C. THE CONTRACTOR SHALL FURNISH A WRITTEN GUARANTEE TO REPLACE OR REPAIR PROMPTLY AND ASSUME RESPONSIBILITY FOR ALL EXPENSES INCURRED FOR ANY WORKMANSHIP AND EQUIPMENT IN WHICH DEFECTS DEVELOP WITHIN ONE YEAR FROM THE DATE OF FINAL CERTIFICATE FOR PAYMENT AND/OR FROM DATE OF ACTUAL USE OF EQUIPMENT OR OCCUPANCY OF SPACES BY OWNER INCLUDED UNDER THE VARIOUS PARTS OF THE WORK, WHICHEVER, DATE IS EARLIER, THIS WORK SHALL BE DONE AS DIRECTED BY THE OWNER. THIS GUARANTEE SHALL ALSO PROVIDED THAT WHERE DEFECTS OCCUR, THE CONTRACTOR WILL ASSUME RESPONSIBILITY OF OTHER TRADES AFFECTED BY DEFECTS, REPAIRS OR REPLACEMENTS IN EQUIPMENT SUPPLIED BY THE CONTRACTOR.
D. THE CONTRACTOR SHALL GIVE NECESSARY NOTICE, FILE DRAWINGS AND SPECIFICATIONS WITH ALL DEPARTMENTS HAVING JURISDICTION, WORK AND PAY ALL FEES THEREFORE. THE CONTRACTOR SHALL ARRANGE FOR INSPECTION AND TESTS OF ANY OR ALL PARTS OF THE WORK IF SO REQUIRED BY AUTHORITIES AND PAY ALL CHARGES FOR SAME. THE CONTRACTOR SHALL PAY ALL COSTS FOR, AND FURNISH TO THE OWNER BEFORE FINAL BILLING, ALL CERTIFICATES NECESSARY AS EVIDENCE THAT THE WORK INSTALLED CONFORMS WITH ALL REGULATIONS WHERE THEY APPLY TO THIS WORK.
E. CONTRACTOR SHALL PERFORM ALL CONTROLLED INSPECTIONS IN ACCORDANCE WITH THE STATE BUILDING CODE. SECURE ALL REQUIRED PERMITS AND APPROVALS AND TRANSMIT SAME TO OWNER. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FEES.
F. AREAS WITH NO ELECTRICAL WORK SHALL REMAIN AS IS. CONTRACTOR SHALL MAINTAIN CONTINUITY OF ALL ELECTRICAL SYSTEMS TO ALL AREAS NOT COVERED BY THIS RENOVATION AND SHALL PROVIDE 48 HOUR NOTICE TO LANDLORD OF ANY PLANNED POWER INTERRUPTIONS OR SIGNAL SYSTEM OUTAGES.
4. SHOP DRAWINGS
A. PRIOR TO THE INSTALLATION OF ANY WORK AND PROCUREMENT OF EQUIPMENT, CONTRACTOR SHALL PROVIDE COMPLETE SETS OF COORDINATED SHOP DRAWINGS OF ALL NEW AND EXISTING EQUIPMENT, INDICATING CAPACITY, DIMENSIONS AND SEQUENCE OF OPERATION FOR WRITTEN APPROVAL BY THE ARCHITECT AND ENGINEER.
B. INDICATE ON EACH SHOP DRAWINGS SUBMITTED:
1) PROJECT NAME AND LOCATION
2) NAME OF ARCHITECT AND ENGINEER
3) ITEM IDENTIFICATION
4) APPROVAL STAMP OF PRIME CONTRACTOR

- C. SUBMISSIONS:
1) SUBMISSIONS 11 IN. X 17 IN. OR SMALLER: IF THE SUBMISSION IS A CATALOG CUT, THEN THE CONTRACTOR SHALL SUBMIT ONE ORIGINAL AND TWO COPIES. OTHERWISE, HE SHALL SUBMIT THREE COPIES. THE ARCHITECT WILL FORWARD THE ORIGINAL AND ONE COPY (TWO COPIES WHEN NO ORIGINAL IS RECEIVED) TO THE ENGINEER. ALL CATALOG CUTS SHALL BE COMPLETE.
2) SUBMISSIONS LARGER THAN 11 IN. X 17 IN.: SUBMIT TWO PRINTS AND ONE PAPER SEPIA TO THE ARCHITECT. THE ARCHITECT WILL FORWARD ONE PRINT AND THE PAPER SEPIA TO THE ENGINEER.
D. SUBMIT SHOP DRAWINGS FOR THE FOLLOWING:
1) SAFETY/DISCONNECT SWITCHES
2) FUSES
3) CIRCUIT BREAKERS
4) PANELBOARDS/LOADCENTER (INCLUDING DIMENSIONS, SCHEDULES, AND CATALOG CUTS).
5) RACEWAYS
6) WIRE AND CABLE
7) WALL SWITCHES
8) INSERTION RECEPTACLES
9) MOMENTARY CONTACT SWITCHES
10) TIME SWITCHES
11) LIGHTING FIXTURES.
E. ASSIST AND PROVIDE ALL NECESSARY INFORMATION, DIAGRAMS, SKETCHES, ETC. TO THE HVAC CONTRACTOR, FOR THE PREPARATION OF COORDINATED SHOP DRAWINGS INDICATING ROUTING OF FEEDERS, CONTROL CONDUITS, RECESSED FIXTURES AND ADJACENT NEARBY PIPING AND DUCTWORK WHERE APPLICABLE, CERTIFIED BY ALL TRADES THAT COORDINATION HAS BEEN ESTABLISHED. SUBMIT FOUR(4) BOOKBOUND OPERATING AND SERVICE MANUALS WHICH SHALL INCLUDE COPIES OF ALL SHOP DRAWING, PROVIDE SHOP DRAWINGS FOR PANELS, FIXTURES, WIRING DEVICES, CONDUIT, CABLE, DISCONNECT SWITCH, RELAYS, CONTRACTORS, AND OTHER SYSTEMS AS DIRECTED BY THE ENGINEER.
5. AS-BUILT DRAWINGS AND EQUIPMENT OPERATIONAL INSTRUCTIONS
A. UPON COMPLETION AND ACCEPTANCE OF WORK, CONTRACTOR SHALL FURNISH WRITTEN INSTRUCTIONS AND EQUIPMENT MANUALS AND DEMONSTRATE TO THE OWNER THE PROPER OPERATION AND MAINTENANCE OF ALL EQUIPMENT AND APPARATUS FURNISHED UNDER THIS CONTRACT.
B. THESE INSTRUCTIONS SHALL BE TYPED ON 8-1/2" IN. X 11 IN. PAPER AND BOUND IN THREE RING BINDERS WITH CLEAR ACETATE COVERS. CONTRACTOR SHALL GIVE THREE COPIES OF THE INSTRUCTIONS TO THE OWNER AND ONE COPY TO THE ENGINEER.
C. THE INSTRUCTION BOOKLET SHALL BEAR THE NAME, ADDRESS AND TELEPHONE NUMBER OF THE PROJECT, ARCHITECT AND ENGINEER.
D. REPRODUCIBLE "AS-BUILT" DRAWINGS SHALL BE PROVIDED INDICATING THE AS INSTALLED CONDITIONS OF THE WORK. "AS-BUILT" DRAWINGS SHALL BE PROVIDED TO THE ARCHITECT AFTER COMPLETION OF THE INSTALLATION.
6. LOW-VOLTAGE DISTRIBUTION EQUIPMENT:
A. PROVIDE COMPLETE EQUIPMENT INCLUDING: SWITCHES, FUSES, CIRCUIT BREAKERS, PANELS AND TRANSFORMERS.
B. ALL EQUIPMENT SHALL CONFORM TO NEMA, ANSI AND IEEE STANDARDS.
C. DISCONNECT SWITCHES SHALL BE FUSED OR NONFUSED AS NOTED. VOLTAGE SHALL BE AS REQUIRED. SWITCHES SHALL BE HEAVY DUTY, EXCEPT AS NOTED, AND HORSEPOWER RATED FOR MOTOR LOADS. TOGGLE TYPE SWITCHES SHALL BE NONFUSED, LOAD BREAK, HAVING MAXIMUM RATINGS OF 20 AMP AT 600 VOLTS AND 30 AMP AT 240 VOLTS. TWO-POLE SWITCHES SHALL BE SIMILAR TO HART AND HEGEMAN NO. 6808F. THREE-POLE SWITCHES SHALL BE SIMILAR TO HART AND HEGEMAN NO. 7810F. KNIFE-BLADE TYPE SWITCHES SHALL BE LOAD BREAK, QUICK-MAKE- QUICK-BREAK, UL CLASS R UP TO 600 AMP. MAXIMUM RATING EXCEPT AS NOTED SHALL BE 800 AMP. ARC QUENCHERS SHALL BE PROVIDED. SWITCHES SHALL BE SIMILAR TO GENERAL ELECTRIC QMR. ALL SWITCH ENCLOSURES SHALL BE DEAD FRONT, NEMA TYPE 1, EXCEPT AS NOTED.
7. FUSES:
A. CIRCUITS 0 TO 600 AMPERES SHALL BE PROTECTED BY FUSES SIMILAR TO CURRENT LIMITING BUSSMAN LOW-PEAK DUAL-ELEMENT TIME-DELAY LPN-RK (AMP)SP (250V) /LPS-RK (AMP)SP (600V) OR LPJ (AMP)SP (600V) (UL CLASS RK1 OR CLASS J), AND BE LISTED BY UL WITH AN INTERRUPTING RATING OF 300,000 AMPERES RMS SYMMETRICAL.
B. MOTOR CIRCUITS - ALL INDIVIDUAL MOTOR CIRCUITS WITH FULL LOAD AMPERE RATINGS (FLA) OF 480 AMPERES OR LESS SHALL BE PROTECTED BY FUSES SIMILAR TO CURRENT LIMITING BUSSMAN LOW-PEAK DUAL-ELEMENT TIME-DELAY LPN-RK (AMP)SP (250V) /LPS-RK (AMP)SP (600V) OR LPJ (AMP)SP (600V) (UL CLASS RK1 OR CLASS J), AND BE LISTED BY UL WITH AN INTERRUPTING RATING OF 300,000 AMPERES RMS SYMMETRICAL.
C. ALL FUSES SHALL BE PROVIDED BY SAME MANUFACTURER.
D. PROVIDE 1 SPACE MATCHING FUSE FOR EACH SET OF 3.
E. CIRCUIT BREAKERS: MOLDED CASE BREAKERS SHALL BE THERMAL-MAGNETIC, QUICK-MAKE-QUICK-BREAK, BOLT-ON TYPE, MANUALLY OPERATED WITH INSULATED TRIP-FREE HANDLE. MULTI-POLE TYPE BREAKERS SHALL CONTAIN INTERNAL TRIP BAR. TERMINALS SHALL BE SUITABLE FOR COPPER OR ALUMINUM CABLE. FURNISH AUXILIARY DEVICES WHERE REQUIRED FOR SHUNT-TRIPPING, OPEN A ND CLOSE MOTOR OPERATOR AND ALARM INDICATION. ENCLOSURES SHALL BE DEAD FRONT, NEMA TYPE 1, EXCEPT AS NOTED. FRAMES, IC AND INTERCHANGEABLE TRIPS SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED:
1) 120 VOLTS, 100-AMP FRAME: 10,000 AMPS, 1 POLE.
2) 120/240 VOLTS, 225-AMP FRAME: 22,000 AMPS MINIMUM
8. DISTRIBUTION PANELBOARDS, SWITCH AND FUSE:
A. THREE PHASE, 3 OR 4 WIRE WITH COPPER BUS BARS. ALL THROUGH BUS SHALL BE INSULATED.
B. NEMA CLASS 1 CONSTRUCTION TO ACCOMMODATE FUSIBLE, INDIVIDUALLY ENCLOSED SWITCHES, FRONT REMOVABLE, SWITCH AND DOOR INTERLOCKS. COVERS TO BE PAD-LOCKABLE.
C. PANELBOARD SHALL BE CONSTRUCTED OF CODE-GAUGE STEEL, GRAY FINISH OVER RUST INHIBITOR, FOR SURFACE MOUNTING. BOX AND PANEL FRAME SHALL BE FLANGED AND REINFORCED FOR RIGID SUPPORT OF INTERIOR AND ACCURATE ALIGNMENT OF INTERIOR WITH FRONT. TRIMS TO BE FASTENED TO BACK BOX WITH SCREWS.
D. ALL BRANCH SWITCHES SHALL HAVE INDIVIDUAL ENGRAVED LAMICOID NAMEPLATES (BLACK WITH WHITE CORE).
E. DISTRIBUTION PANELBOARD CONSTRUCTION MINIMUM SHORT CIRCUIT RATING 25,000 AMPERES, REMS SYMMETRICAL FOR ALL 120/208V APPLICATIONS. APPLICATIONS.
F. DISCONNECTS
1) DISCONNECT SWITCHES SHALL CONFORM TO NEMA AND UL STANDARDS, AND SHALL BE HORSEPOWER RATED.

- 2) SWITCHING MECHANISM SHALL BE QUICK-MAKE, QUICK-BREAK, SINGLE THROW WITH EXTERNAL OPERATING HANDLE MECHANICALLY INTERLOCKED WITH ENCLOSURE COVER TO PROVIDE ACCESS TO INTERIOR WHEN DISCONNECT IS IN OFF POSITION ONLY. PROVIDE MEANS TO LOCK OPERATING HANDLE IN THE OPEN AND CLOSED POSITION. DESIGNATE ON THE ENCLOSURE THE OPEN AND CLOSED POSITION OF THE OPERATING HANDLE.
3) SWITCHES SHALL BE OF THE DOUBLE STATIONARY CONTACT TYPE.
4) SWITCHES SHALL BE EQUIPPED WITH REJECTION TYPE FUSE HOLDERS, FUSIBLE AS SHOWN ON THE DRAWINGS; PROVIDE COMPLETE WITH FUSES AS SCHEDULED.
G. INSTALLATION
1) DISTRIBUTION PANELBOARD SHALL BE MOUNTED TO STRUCTURAL STEEL CHANNEL (KINDORF) WHICH SHALL BE BOLTED TO THE WALL USING EXPANSION ANCHORS FOR LARGE PANELS.
H. IDENTIFICATION
1) PROVIDE NAMEPLATE AT EACH SWITCH IDENTIFYING THE LOAD SERVED.
2) NAMEPLATES SHALL BE MOUNTED ON THE FRONT COVER SECURED WITH SELF-TAPPING SCREWS OR NUTS AND BOLTS. NAMEPLATES SHALL BE LAMINATED PHENOLIC, BLACK WITH A MINIMUM OF 1/4" HIGH WHITE LETTERING.
I. DISTRIBUTION AND SUB-DISTRIBUTION PANELBOARDS SHALL BE A MINIMUM OF 30" WIDE AND 10" DEEP.
J. POWER PANELBOARDS SHALL BE SIMILAR TO GENERAL ELECTRIC TYPE "QMR" AS MANUFACTURED BY ATLAS SWITCH COMPANY, ELECTRIC SWITCHBOARD COMPANY OR APPROVED EQUAL.
K. PANELBOARD SHALL HAVE MAIN CIRCUIT BREAKER OR MAIN LUGS AS INDICATED ON THE DRAWINGS. QUANTITY, POLES AND TRIP RATINGS OF BRANCH CIRCUIT BREAKERS TO BE AS INDICATED ON DRAWINGS.
L. PANELBOARD SHALL HAVE ENGRAVED WHITE CORE, BLACK LAMICOID NAMEPLATE SCREWED ONTO PANE TRIM WITH DESIGNATION LISTED (PANELBOARD NAME, VOLTAGE, RATING OR MAINS IN AMPS).
B. MATERIALS
1) RACEWAYS:
a. RIGID STEEL CONDUIT: FULL-WEIGHT PIPE, GALVANIZED, THREADED.
b. ELECTROMETALLIC TUBING (EMT): THIN WALL PIPE, GALVANIZED, THREADED.
c. FLEXIBLE STEEL CONDUIT: CONTINUOUS SINGLE STRIP, GALVANIZED.
d. WIREWAYS: WIRE SHALL BE AS NOTED, MINIMUM NO. 16 GAUGE STEEL WITH GROUND CONTINUITY. FINISH SHALL BE BAKED ENAMEL. COVERS SHALL BE SCREW-ON.
e. SURFACE METAL RACEWAY: SIZE AS NOTED. BASE 0.04 IN., COVER 0.25 IN. MATERIAL SHALL BE STEEL. FINISH SHALL BE BAKED ENAMEL. COVERS SHALL BE SCREW-ON.
2) FITTINGS AND ACCESSORIES:
a. RIGID STEEL: NONSPLT, THREADED, STEEL OR MALLEABLE IRON. ZINC DIE CAST NOT PERMITTED.
b. ELECTROMETALLIC TUBING: COMPRESSION TYPE, GALVANIZED RIGID STEEL BOWBS, 2 IN. OR LARGER.
c. FLEXIBLE METALLIC CONDUIT: ANGLE WEDGE TYPE WITH INSULATED THROAT.
d. BUSHINGS: METALLIC INSULATED TYPE.

SALT 2.0



ELECTRICAL SPECIFICATIONS (CONT.)

3) BOXES:

- a. OUTLET BOXES: EXCEPT AS OTHERWISE REQUIRED BY CONSTRUCTION, DEVICES OR WIRING, BOXES SHALL BE STAMPED STEEL, 4 IN. SQUARE OR OCTAGON FOR FIXTURES. BOXES ABOVE CEILING SHALL BE 1-1/2 IN. DEEP. BOXES IN CEILING OR SLAB SHALL BE 3 IN. DEEP. BOXES IN WALL FOR FIXTURES SHALL BE 2-3/4 IN. DEEP. BOXES IN WALL FOR RECEPTACLES AND SWITCHES SHALL BE 1-1/2 IN. DEEP. FURNISH WITH RAISED COVERS AND FIXTURE STUDS WHERE REQUIRED. WITHOUT FIXTURE OR DEVICE: FURNISH BLANK COVER, OFFSET BACK-TO-BACK OUTLETS WITH MINIMUM 6 IN. SEPARATION.
b. JUNCTION AND PULL BOXES: GALVANIZED SHEET STEEL WITH SCREW-ON COVERS, EXCEPT AS NOTED. FURNISH WITH INSULATED SUPPORTS FOR CABLES. LOCATIONS SHALL BE AS NOTED OR REQUIRED AND ACCESSIBLE. PROVIDE BARRIERS IN NEW AND RENOVATED BOXES BETWEEN 120/208 VOLT AND 265/460 VOLT WIRING AND BETWEEN EMERGENCY AND NORMAL WIRING. FLOOR BOXES SHALL BE SUITABLE FOR CONDUIT AND DEVICES NOTED. RAISED OUTLETS SHALL BE HUBBELL #82414 SERIES WITH ABOVE FLOOR FITTING. TELEPHONE, BUSHED HOLE. POWER: DUPLEX RECEPTACLE OR OTHER AS NOTED. INCREASE SIZE TO SUIT AS NECESSARY. FLUSH OUTLETS SHALL BE HUBBELL #82414 SERIES WITH FLUSH FLOOR FITTING FOR TELEPHONE AND FLUSH DUAL FLAP COVER WITH DUPLEX RECEPTACLE FOR POWER AS NOTED. INCREASE SIZE TO SUIT AS NECESSARY.

c. PROVIDE RACEWAYS ONLY AS HEREIN SPECIFIED, EXCEPT AS NOTED. RACEWAYS SHALL BE RUN CONCEALED, EXCEPT AS NOTED.

PROVIDE RACEWAY SUPPORT UTILIZING CEILING TRAPEZE, STRAP HANGERS, OR WALL BRACKETS. PROVIDE U-BOLTS AT EACH FLOOR LEVEL OF RISER RACEWAYS AND CONNECTED TO ACCEPTABLE SUPPORTS. PROVIDE RISER CLAMPS AT EACH FLOOR LEVEL OF RISER RACEWAYS AND RESTING ON SLAB. FOR THROUGH-THE-FLOOR SYSTEMS, UTILIZE AN ASSEMBLY SIMILAR TO HUBBELL FIRE RATED POKE-THROUGH FLOOR BOX SYSTEM. FOR ABOVE FLOOR FITTINGS TELEPHONE SHALL BE BUSHED HOLE AND POWER SHALL BE DUPLEX RECEPTACLE OR OTHER AS NOTED. PROVIDE SEPARATION BARRIER BETWEEN POWER AND TELEPHONE COMPARTMENTS. PROVIDE JUNCTION BOX ON UNDERSIDE OF FLOOR. PACK FITTING TO RESTORE FIRE RATING OF FLOOR.

SECURE ALL RACEWAYS TO SUPPORTS WITH PIPE STRAPS OR U-BOLTS. SPACING OF SUPPORTS SHALL BE A MINIMUM OF 10 FT ON CENTER FOR METALLIC RACEWAY AND AS REQUIRED FOR NONMETALLIC RACEWAY. SPACING SHALL BE 5 FT ON CENTER FOR WIREWAYS AND PER CODE AND AS NOTED FOR OTHERS. MOUNT SUPPORTS TO STRUCTURE MASONRY WITH TOGGLE BOLTS ON HOLLOW MASONRY. EXPANSION SHIELDS OR INSERTS IN CONCRETE AND BRICK. MACHINE SCREWS ON METAL. BEAM CLAMPS ON FRAMEWORK. WOOD SCREWS ON WOOD. AND PAN THROUGH STRAPS IN METAL DECK. NAILS, RAWL PLUGS OR WOOD PLUGS SHALL NOT BE PERMITTED. WHERE REQUIRED BY STRUCTURE, FURNISH THROUGH BOLTS AND FISHPLATES.

EXPOSED RACEWAYS SHALL BE RUN PARALLEL WITH OR AT RIGHT ANGLES TO WALLS. PROVIDE CLEARANCE WITH WATER, STEAM OR OTHER PIPING (MINIMUM 3 IN. SEPARATION FROM STEAM AND HOT WATER PIPES, EXCEPT 1 IN. FROM PIPE COVER AT CROSSINGS AND 18 IN. FOR PARALLEL RUNS). FOR HUNG CEILING OUTLETS, RUN IN HUNG CEILING AND CONNECT TO CEILING SUPPORT CHANNELS. IN MASONRY AND POURED CONCRETE, RUN VERTICALLY ONLY.

MAINTAIN GROUNDING CONTINUITY OF INTERRUPTED METALLIC RACEWAYS WITH GROUND CONDUCTOR, AND IN FLEXIBLE CONDUIT FOR FEEDERS AND MOTOR TERMINAL CONNECTIONS.

EMPTY RACEWAYS OVER 10 FT LONG: PROVIDE FISH OR PULL WIRE, GALVANIZED OR NYLON ROPE.

RIGID STEEL CONDUIT SHALL BE PERMITTED FOR FEEDERS AND BRANCH CIRCUITS. PAINT MALE THREADS OF FIELD-THREADED CONDUIT WITH GRAPHITE-BASE PIPE COMPOUND AND BUTT CONDUIT ENDS. TOUCH UP MARRED SURFACES AND FIELD-CUT THREADS, CRC-COLD GALVANIZED. EMT SHALL BE PERMITTED FOR BRANCH CIRCUITS ONLY, IN DRY LOCATIONS, DRY WALLS, HUNG CEILINGS, HOLLOW BLOCK WALLS AND FURRED SPACES. EMT SHALL NOT BE PERMITTED IN RAISED FLOORS.

FLEXIBLE STEEL CONDUIT SHALL BE UTILIZED FOR SHORT CONNECTIONS WHERE RIGID CONDUIT IS IMPRACTICAL FROM OUTLET BOX TO RECESSED LIGHTING FIXTURE: PROVIDE MINIMUM 4 FT AND MAXIMUM 6 FT LENGTHS. FOR FINAL CONNECTION TO MOTOR TERMINAL BOX, TRANSFORMER AND OTHER VIBRATING EQUIPMENT: PROVIDE WITH POLYVINYL SHEATHING AND GROUND CONDUCTOR. MINIMUM LENGTH: 18 IN. WITH SLACK. CONNECT GROUND CONDUCTOR TO ENCLOSURE OR RACEWAY AT EACH END. FOR EXPANSION JOINT CROSSINGS, CROSS AT RIGHT ANGLES AND ANCHOR ENDS.

CUT CONDUIT ENDS SQUARE. REAM SMOOTH. PAINT MALE THREADS OF FIELD THREADED RACEWAYS WITH GRAPHITE BASE PIPE COMPOUND. DRAW UP TIGHT WITH RACEWAY COUPLING. ALL COUPLINGS SHALL BE COMPRESSION TYPE. NO SET SCREW FITTINGS.

EXPANSION FITTINGS SHALL BE INSTALLED AT RIGHT ANGLES WITH CLIP JOINT CENTERED IN EXPANSION JOINT. PROVIDE A LENGTH OF RUN IN ACCORDANCE MANUFACTURER'S RECOMMENDATIONS. PRESET FITTINGS SHALL ALLOW FOR TEMPERATURE VARIATION.

RACEWAYS PASSING THROUGH FIRE-RATED CONSTRUCTION: SEAL OPENING WITH FIRE SEALANT.

d. PROVIDE CABLE SUPPORTS IN ACCORDANCE WITH NATIONAL ELECTRIC CODE ARTICLE 300.19. CABLE SUPPORTS SHALL UTILIZE A ONE-PIECE PLUG WITH POZI-GRIP WEDGING PLUG AS MANUFACTURED BY OZ-GEDNEY. TYPE SF SHALL BE USED FOR ARMORED CABLE.

INSTALL CABLE SUPPORTS AT THE TOP OF A VERTICAL RISE AND PROVIDE INTERMEDIATE ADDITIONAL SUPPORTS AS REQUIRED TO LIMIT SUPPORTED CONDUCTOR LENGTHS TO NOT GREATER THAN THOSE SPECIFIED IN TABLE 300.19(A).

e. ERECT WALL AND SWITCH OUTLETS IN ADVANCE OF FURRING AND FIREPROOFING. OUTLET BOXES SHALL BE SET SQUARE AND TRUE WITH BUILDING FINISH. SECURE TO BUILDING STRUCTURE BY ADJUSTABLE STRAP IRON OR GROUT IN WITH MASONRY. VERIFY OUTLET LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL DRAWINGS OF INTERIOR DETAILS AND FINISHES. PROVIDE BARRIERS BETWEEN SWITCHES CONNECTED TO DIFFERENT PHASES FOR VOLTAGES EXCEEDING 150 VOLTS TO GROUND.

f. PANEL, JUNCTION AND PULL BOXES SHALL BE LOCATED CLEAR OF OTHER TRADES. CONCEAL JUNCTION AND PULL BOXES IN FINISHED SPACES. WHERE NECESSARY, REROUTE RACEWAYS OR MAKE OTHER ARRANGEMENTS FOR CONCEALMENT. BOXES SHALL BE ACCESSIBLE. SUPPORT BOXES FROM BUILDING STRUCTURE, INDEPENDENT OF CONDUIT. PROVIDE FLOOR-TO-CEILING CHANNELS FOR MOUNTING ON DRYWALL AND LIGHTWEIGHT CONSTRUCTION. OUTLET BOXES FOR FIXTURES RECESSED IN HUNG CEILINGS SHALL BE ACCESSIBLE THROUGH OPENING CREATED BY REMOVAL OF FIXTURE. SECURE TO BLACK IRON SUPPORT. MOTOR TERMINAL BOXES: COORDINATE WITH MOTOR BRANCH CIRCUIT CONDUIT AND WIRING; ADD BOX VOLUME WHERE REQUIRED.

g. FIRE SEALANTS: PROVIDE FOR RACEWAYS AND WIRE PASSING THROUGH FLOOR SLOTS, SLEEVES OR OPENINGS IN FIRE-PARTITIONS ROOMS.

h. PERFORM CONTINUITY TESTS OF RESISTANCE OF FEEDER CONDUITS FROM SERVICE TO POINT OF FINAL DISTRIBUTION USING 1 CONDUCTOR RETURN. MAXIMUM RESISTANCE SHALL BE 25 OHMS.

i. WIRE AND CABLE:

a. PROVIDE WIRE AND CABLE COMPLETE WITH ACCESSORIES. SIZE REFERENCE SHALL BE AWG EXCEPT AS NOTED.

b. CONDUCTORS SHALL BE COPPER, ASTM STANDARD SOLID (NO. 10 AND SMALLER) OR STRANDED (NO. 8 AND LARGER). GENERAL USE CABLING SHALL BE NO. 12 MINIMUM. AT 120 VOLTS AND OVER 100 FT CIRCUIT LENGTH PROVIDE NO. 10 MINIMUM. AT 265 VOLTS AND OVER 200 FT CIRCUIT LENGTH PROVIDE NO. 10 MINIMUM.

c. CONTROL AND ALARM CABLING, EXCEPT AS NOTED, SHALL BE NO. 14 MINIMUM. AT 120 VOLTS AND OVER 200 FT CIRCUIT LENGTH PROVIDE NO. 12 MINIMUM. OTHER VOLTAGES AND PHASES: ADJUST CABLE SIZING AS REQUIRED TO MAINTAIN VOLTAGE DROP. INCREASE RACEWAY SIZES FOR LARGER WIRE AS REQUIRED.

d. INSULATION SHALL BE RUBBER AND THERMOPLASTIC MEETING ASTM AND IPCA STANDARDS. TYPE THW OR THWN SHALL BE UTILIZED FOR FEEDERS AND BRANCH CIRCUITS EXCEPT AS NOTED. TYPE SFF-2 SHALL BE UTILIZED FOR BRANCH CIRCUITS LOCATED IN WIRING CHANNELS OF CONTINUOUS FLUORESCENT FIXTURES AND IN AMBIENT TEMPERATURES OVER 90 DEG C. FOR UNGROUNDED ISOLATED BRANCH CIRCUITS PROVIDE CROSS-LINKED POLYETHYLENE INSULATION (TYPE XHHW).

e. ARMORED CABLE (BX) SHALL BE UTILIZED FOR BRANCH CIRCUITS IN DRY HOLLOW LOCATIONS, HUNG CEILINGS, AND BLOCK WALLS.

f. COLOR CODING SHALL BE AS FOLLOWS:

- 120/208 VOLT SYSTEM: BLACK FOR A PHASE, RED FOR B PHASE, BLUE FOR C PHASE

1) NEUTRAL WIRE SHALL UTILIZE WHITE OUTER COVERING THROUGHOUT. EQUIPMENT GROUND WIRE SHALL UTILIZE GREEN OUTER COVERING THROUGHOUT.

WHERE COLOR-CODED CABLE IS NOT AVAILABLE, CERTIFY IN WRITING AND REQUEST PERMISSION TO OVERLAP CONDUCTORS WITH 8 IN. OF COLOR TAPING IN ACCESSIBLE LOCATIONS.

g. PROVIDE FLAMEPROOF LINEN OR FIBER TAGS IN ACCESSIBLE LOCATIONS. FOR FEEDERS INDICATE FEEDER NUMBER, SIZE, PHASE AND POINTS OF ORIGIN AND TERMINATIONS. FOR CONTROL AND ALARM WIRING INDICATE TYPE (CONTROL OR ALARM), SIZE OF WIRE, AND POINTS OF ORIGIN AND TERMINATIONS.

h. TERMINATIONS, SPLICES AND TAPS UNDER 600 VOLTS: COPPER CONDUCTORS NO. 10 AND SMALLER SHALL UTILIZE COMPRESSION-TYPE OF TWIST-ON SPRING-LOADED CONNECTORS AND CLEAR NYLON-INSULATED COVERING. COPPER CONDUCTORS NO. 8 AND LARGER SHALL UTILIZE MECHANICAL BOLTED PRESSURE OR HYDRAULIC COMPRESSION TYPE USING MANUFACTURER'S RECOMMENDED TOOLING. CABLE LUGS AND CONNECTORS SHALL UTILIZE COMPRESSION TYPE OF SAME METAL AS CONDUCTOR. PROVIDE TO MATCH CABLE, WITH MARKING INDICATING SIZE AND TYPE. COPPER LUG CONNECTIONS TO BUS BARS: USE ANTISEIZE COMPOUND ON TANG.

i. NOT MORE THAN 3 LIGHTING OR CONVENIENCE OUTLET CIRCUITS SHALL BE INSTALLED IN ONE CONDUIT UNLESS OTHERWISE INDICATED. PULL NO THERMOPLASTIC WIRE AT TEMPERATURES LOWER THAN 32 DEG F. PROVIDE SEPARATE RACEWAYS FOR CONDUCTORS OF 120/208 AND 265/460 VOLT SYSTEMS. EXCEPT 460 VOLT MOTOR BRANCH CIRCUIT WIRING AND RELATED 120 VOLT CONTROL WIRING. THERMOPLASTIC WIRES SHALL NOT BE INSTALLED IN COMPUTER AREA RAISED FLOORS.

j. LEAVE WIRES WITH SUFFICIENT SLACK TO PERMIT MAKING FINAL CONNECTIONS.

k. PERFORM CONTINUITY AND INSULATION TESTS. MEGGER TEST 100 PERCENT OF FEEDERS, 10 PERCENT OF BRANCH CIRCUITS AND ALL MOTOR BRANCH CIRCUITS OVER 25 HP.

PERFORM TESTS PRIOR TO CONNECTING EQUIPMENT AND IN PRESENCE OF AUTHORIZED REPRESENTATIVES. SUBMIT WRITTEN REPORT OF RESULTS. CORRECT OR REPLACE CABLE TESTING BELOW MANUFACTURER'S STANDARDS.

11. WIRING DEVICES:

a. WIRING DEVICES SHALL BE SPECIFICATION GRADE UNLESS OTHERWISE SPECIFIED AND SHALL HAVE THE TRIP RATINGS AND CHARACTERISTICS NOTED. PROVIDE COMPLETE MATERIAL AND ACCESSORIES AS NOTED.

b. LOCAL WALL SWITCHES SHALL BE ROCKER TYPE, QUIET OPERATING, RATED 20 AMP, 120/277 VOLT, AC. SIMILAR TO LEVITON DECORA SERIES A5621 (SINGLE POLE), A5623 (3-WAY) AND A5624 (4-WAY).

c. STRAIGHT BLADE RECEPTACLES SHALL BE COMMERCIAL SPECIFICATION GRADE DUPLEX CONVENIENCE 125 VOLTS, 2 POLE, 3 WIRE, U GROUND SLOT, DECORA SERIES BY LEVITON. GROUNDED, EXCEPT AS NOTED.

1) SINGLE GANG, RECESSED, DUPLEX RECEPTACLE, TAMPER RESISTANT, 2-POLE, 3-WIRE GROUNDING, 15A, 125V, NEMA 5-20R; LEVITON 689 SERIES (COLOR AS SPECIFIED BY ARCHITECT). 2) USB CHARGER/ DUPLEX TAMPER-RESISTANT RECEPTACLE: TAMPER RESISTANT.

d. INSERTION RECEPTACLES SHALL BE DUPLEX RECEPTACLE CONVENIENCE 125 VOLTS, 2 POLE, 3 WIRE, U GROUND SLOT. GROUNDED, EXCEPT AS NOTED.

1) HEALTH CARE FACILITIES:

- a) DUPLEX, 20 AMP, 125 VOLTS, 2 POLE, 3 WIRE, U GROUND SLOT: SIMILAR TO HUBBELL NO. 8300.
- b) SINGLE, 20 AMP, 125 VOLT, 2 POLE, 3 WIRE, U GROUND SLOT: SIMILAR TO HUBBELL NO. 8310.

e. DEVICE PLATES: SEE ARCHITECT FOR TYPE. FOR RECEPTACLES WITH OTHER THAN 120 VOLT, INSCRIBED VOLTAGE AVAILABLE.

f. COLORS: COORDINATE COLORS WITH ARCHITECT.

g. MOUNTING ORIENTATION OF RECEPTACLES (HORIZONTAL OR VERTICAL): COORDINATE WITH ARCHITECT.

12. LIGHTING FIXTURES:

a. FIXTURES TO BE AS SPECIFIED BY ARCHITECT AND SHALL BE COMPLETELY FACTORY ASSEMBLED, WIRED AND EQUIPPED WITH ALL NECESSARY SOCKETS, BALLASTS, SUPPORTING HARDWARE AND ACCESSORIES. REFER TO DRAWINGS FOR INDIVIDUAL FIXTURE DESCRIPTIONS.

b. FIXTURE CATALOG NUMBERS USED TO ILLUSTRATE EQUIPMENT TYPE DO NOT NECESSARILY DENOTE REQUIRED MOUNTING EQUIPMENT OR ACCESSORIES. PROVIDE ACCESSORIES TO SUIT.

c. BALLAST: CLASS P, HIGH POWER FACTOR, LOWEST AVAILABLE NEMA RATED NOISE LEVEL, E11 AND CBM APPROVED ENERGY SAVING TYPE. TRIGGER START FOR 24-INCH LAMPS AND RAPID START FOR 48-INCH, TWO LAMP BALLASTS; NO THREE LAMP BALLASTS. BALLASTS SHALL BE ADVANCE MAGNETEK, UNIVERSAL OR EQUAL.

d. LED DRIVERS SHALL BE ELECTRONIC TYPE, LABELED AS COMPLIANT WITH RADIO FREQUENCY INTERFERENCE (RFI) REQUIREMENTS OF FCC TITLE 47, PART 15 AND COMPLY WITH NEMA SSL 1 "ELECTRONIC DRIVERS FOR LED DEVICES, ARRAYS OR SYSTEMS". LED DRIVERS SHALL HAVE A SOUND RATING OF "A", HAVE A MINIMUM EFFICIENCY OF 85% AND BE RATED FOR A THD OF LESS THAN 20% AT ALL INPUT VOLTAGES.

e. DIMMABLE LED DRIVERS SHALL BE CAPABLE OF DIMMING WITHOUT LED STROBING OR FLICKER ACROSS THEIR FULL DIMMING RANGE. PROVIDE TYPE OF LED DRIVER AS PER LIGHTING FIXTURE SCHEDULE. DIMMABLE LED DRIVERS SHALL BE 0-10V WHERE NOT INDICATED.

f. CONTINUOUS ROW, TWO LAMP STRIP FIXTURES SHALL BE STAGGERED TYPE.

g. FLUORESCENT LIGHTING FIXTURES, INCLUDING GENERAL CONSTRUCTION, LAMPS AND BALLASTS SHALL CONFORM TO THE ENERGY EFFICIENCY REQUIREMENTS FOR EDISON CO. AND QUALITY FOR A UTILITY REBATE TO OWNER UNDER CON EDISON'S ENLIGHTENED ENERGY LIGHTING REBATE PROGRAM. CONTRACTOR SHALL COORDINATE REBATE PROGRAM WITH CON EDISON AND ARRANGE FOR CON EDISON TO PERFORM A SURVEY TO INVENTORY ALL EXISTING FIXTURES PRIOR TO DEMOLITION.

h. EXIT SIGNS SHALL BE PRECISION DIE-CAST ALUMINUM HOUSING WITH LASER-FORMED ACRYLIC LEGEND. EXIT SIGNS SHALL COMPLY WITH UL 924 AND BE MEA APPROVED FOR USE IN CITY. AC POWERED WITH PREMIUM LONG-LIFE NICKEL CADMIUM BATTERY WITH STANDARD UL LISTED 3-HOUR RUN TIME. PROVIDE WITH INTEGRAL AUTOMATIC CHARGER IN A SELF CONTAINED POWER PACK. LED INDICATOR WITH PUSH TO TEST SWITCH.

13. TELEPHONE CONDUIT SYSTEM:

a. PROVIDE COMPLETE SYSTEM OF: RACEWAYS AND ACCESSORIES, OUTLET BOXES, SLEEVES AND FISHWIRES.

b. EQUIPMENT SHALL CONFORM TO REQUIREMENTS OF TELEPHONE COMPANY.

c. OUTLETS SHALL BE:

- 1) WALL: 4 IN. SQUARE WITH BUSHED COVER PLATE.

d. PROVIDE FISHWIRES, IN RACEWAYS OVER 10 FT LONG.

e. CONDUIT SHALL BE 3/4 IN. MINIMUM. FURNISH EMPTY CONDUIT FROM OUTLET BOX TO BUSHED END THRU WALL 6" BELOW THE PLASTER CEILING.

f. FACE RACEWAYS IN ROOMS SHALL HUBBELL HBL500, HBL750 OR HBL2000 SERIES OR AS ACCEPTABLE.

14. GROUNDING AND BONDING:

a. PROVIDE GROUNDING SYSTEM IN ACCORDANCE WITH (2017 NATIONAL ELECTRICAL CODE WITH AMENDMENTS), AND THESE SPECIFICATIONS. THE WIRING SYSTEM SHALL BE INSTALLED AS REQUIRED TO PROVIDE A CONTINUOUSLY GROUNDED SYSTEM. WHERE FLEXIBLE CONDUIT IS USED FOR PART OF A CONDUIT RUN, EXCEPT LIGHTING BRANCH CIRCUITS, AN INSULATED GROUNDING CONDUCTOR SHALL BE PROVIDED IN THE CONDUIT AND CONNECTED TO GROUNDING BUSHINGS AT EACH END OF THE RUN.

b. USE EXOTHERMIC WELDING PROCESS FOR INACCESSIBLE CONNECTIONS.

c. EXTEND EXISTING SYSTEM GROUND TO INCLUDE ALL THE ELECTRICAL EQUIPMENT IN THE SCOPE OF WORK.

d. WHERE FLEXIBLE METALLIC CONDUIT IS USED AN INTERNAL BONDING CONDUCTOR SHALL BE INSTALLED.

e. IN ADDITION, FURNISH A SEPARATE INSULATED GREEN EQUIPMENT GROUND CONDUCTOR WHERE INDICATED ON DRAWINGS AND FOR THE FOLLOWING BRANCH CIRCUITS:

- 1) CIRCUITS SERVING ANY WALL BOX DIMMER.
- 2) CIRCUITS SERVING ANY ISOLATED GROUND RECEPTACLES. TERMINATE GROUND DIRECTLY AT AN EQUIPMENT GROUNDING CONDUCTOR TERMINAL OF THE SOURCE AT THE SOURCE, OR AS OTHER WISE NOTED ON DRAWINGS.
- 3) CIRCUITS SERVING ANY DUPLEX OR SIMPLEX COMPUTER RECEPTACLES.
- 4) ANY CIRCUIT SERVED VIA AN ISOLATION TRANSFORMER OR COMPUTER POWER DISTRIBUTION UNIT.

15. PANELBOARDS:

a. PANELBOARDS SHALL BE OF THE DEAD FRONT TYPE MANUFACTURED IN CODE GAUGE AND SIZE BOXES FOR MOUNTING AS INDICATED ON PLANS COMPLETE WITH TRIM, DOORS AND LOCKS. ALL LOCKS SHALL BE KEYS ALIKE.

b. CIRCUIT BREAKERS SHALL BE OF THE BOLT-ON THERMAL MAGNETIC TYPE. ALL DEVICES SHALL BE FLUSH MOUNTED, UNLESS NUMBER OF POLES SHOWN IN SCHEDULES ON THE CONTRACT DRAWINGS. FOR BLANK (SPACE) COMPARTMENTS, PROVIDE FULL RATED BUS. MINIMUM GUTTER SPACES SHALL BE 5-3/4" SIDES, TOP AND BOTTOM. INCREASE FOR THROUGH FEEDERS. PROVIDE 25% COPPER GROUND BUS AND 100% COPPER NEUTRAL BUS AND INCREASE NEUTRAL BUS INDICATED.

c. LOCKING TABS SHALL BE PROVIDED ON ALL CIRCUIT BREAKERS SERVING EMERGENCY LIGHTING, FIRE ALARM SYSTEM, SECURITY SYSTEMS AND OTHER EMERGENCY OR CRITICAL EQUIPMENT AND AS NOTED ON THE CONTRACT DRAWINGS. A TOTAL OF 5 SPARE LOCKING TABS SHALL BE FURNISHED TO THE OWNER.

d. BUSES SHALL BE HARD DRAWN COPPER OF 98 PERCENT CONDUCTIVITY AND SHALL HAVE CROSS SECTIONAL AREAS LARGE ENOUGH TO LIMIT THE TEMPERATURE RISE, WHEN CARRYING FULL LOAD, TO 35 DEGREES C ABOVE AN AMBIENT INSIDE THE ENCLOSURE OF 55 DEGREES C. AS DEFINED IN IEEE STANDARD RULES. MAIN BUS CAPACITY SHALL BE AS SHOWN ON THE CONTRACT DRAWINGS.

e. ENCLOSURES SHALL BE SURFACE OR FLUSH AS INDICATED. TRIMS SHALL BE SECURED TO PANEL WITH MACHINE SCREWS. COVERS SHALL BE HINGED DOOR-IN-DOOR CONSTRUCTION WITH CYLINDER LOCKS AND CATCHES. LOCKS MUST BE COMPATIBLE WITH BUILDING STANDARD KEY SYSTEM AND WHEN NONE EXISTS, THEY SHALL BE SIMILAR TO A YALE NO. 911 KEY.

f. DISTRIBUTION AND SUB-DISTRIBUTION PANELBOARD SHALL BE A MINIMUM OF 30" WIDE AND 10" DEEP.

g. ALL STANDARD PANELBOARDS SHALL BE A MINIMUM OF 20" WIDE AND 5 3/4" DEEP.

h. FURNISH ALL PANELBOARDS WITH FEED-THRU LUGS UNLESS OTHERWISE INDICATED ON THE DRAWINGS.

i. ALL NEW PANELBOARDS SHALL BE PROVIDED WITH AN ENGRAVED WHITE CORE LAMACOID NAMEPLATE, WITH 3/4 IN. WHITE LETTERING ON A BLACK BACKGROUND, WITH DESIGNATION LISTED (PANELBOARD NAME), FASTENED WITH EPOXY CEMENT OR OVAL HEAD CHROME PLATED MACHINE SCREWS.

j. THE CIRCUIT DIRECTORY SHALL BE TYPEWRITTEN AND PROVIDED INSIDE EACH PANEL DOOR TO INDICATE EQUIPMENT AND/OR AREA SERVED. DIRECTORY HOLDER SHALL BE METAL FRAME WITH CLEAR PLASTIC, TRANSPARENT COVER. THE TYPEWRITTEN LIST INDICATING CIRCUIT NUMBERS, OUTLETS SUPPLIED AND THEIR LOCATIONS SHALL BE PROVIDED.

k. TIE-BARS SHALL NOT BE USED TO CREATE MULTI-POLE CIRCUITS. MAXIMUM 42 CIRCUITS ALLOWED.

l. ONLY ONE WIRE SHALL BE INSTALLED UNDER EACH CIRCUIT BREAKER LUG.

m. SHORT CIRCUIT RATING OF PANELBOARDS SHALL NOT BE LESS THAN AS INDICATED ON THE CONTRACT DRAWINGS OR SPECIFIED HEREIN. WHERE NOT INDICATED OR SPECIFIED THE MINIMUM SHORT CIRCUIT RATING SHALL BE EQUAL TO THE INTERRUPTING CAPACITY OF THE LOWEST RATED CIRCUIT BREAKER IN THE PANELBOARD, BUT IN NO CASE LESS THAN 10,000 AMPERES R.M.S. SYMMETRICAL FOR 208Y/120 VOLT SYSTEM AND 14,000 AMPERES R.M.S. SYMMETRICAL FOR 480Y/277 VOLT SYSTEM. SERIES RATED PANELBOARDS SHALL BE USED TO ACHIEVE REQUIRED SHORT CIRCUIT RATINGS.

n. FOR ALL EXISTING PANELBOARDS, CONTRACTOR SHALL PROVIDE NEW CIRCUIT BREAKERS TO REPLACE EXISTING AS REQUIRED AS INDICATED ON DRAWINGS.

17. SMOKE ALARMS

a. PROVIDE SOLID STATE, PHOTOELECTRIC TYPE, HARD-WIRED SMOKE ALARM WITH 9V BATTERY BACKUP AND INTEGRAL TEMPORAL PATTERN EVACUATION HORN. EDWARDS 517 SERIES OR APPROVED EQUAL.

b. THREE POSITION TEST FEATURE THAT SIMULATES ACTUAL SMOKE CONDITIONS. SHALL CONTAIN MAINTENANCE INDICATOR.

c. PROVIDE WITH INTEGRAL 135 DEGREE F ISOLATED HEAT DETECTION OR INTEGRAL RELAY RATED 0.6A AT 125V AC., AS INDICATED ON THE PLANS AND DRAWINGS.

d. DEVICE SHALL BE RATED TO OPERATE AT A RANGE OF 40' TO 100'.

e. UL LISTED TO UL217 AND APPROVED FOR USE CITY.

18. INTERCOM CONDUIT SYSTEM:

a. PROVIDE COMPLETE SYSTEM OF: RACEWAYS AND ACCESSORIES, OUTLET BOXES, SLEEVES AND FISHWIRES.

b. EQUIPMENT SHALL CONFORM TO REQUIREMENTS OF INTERCOM MANUFACTURER.

c. OUTLETS SHALL BE:

- 1) WALL: 4 IN. SQUARE WITH SINGLE GANG COVER PLATE.

d. PROVIDE FISHWIRES, IN RACEWAYS OVER 10 FT LONG.

e. CONDUIT SHALL BE 3/4 IN. MINIMUM. FURNISH EMPTY CONDUIT FROM EACH APARTMENT TO MAIN INTERCOM CONTROLLER AT ENTRANCE.

SALT 2.0



LIGHTING SCHEDULE

CODE	DESCRIPTION	MANUFACTURER	PRODUCT	REMARK
INTERIOR				
L1	2X2 LAY-IN LED	LSI	SFP24-LED-50-UE-DIM-35	
L2	6" RECESSED DOWNLIGHT	HALO	HC61SD010-HM612830-61MDH	
L3	DRUM PENDANT	SATCO	NUVO 62-1458	MOUNTING HEIGHT @ 7'-0" A.F.F
L4	ORB PENDANT	INNOVATIONS LIGHTING	916-1P-BK-G202-6-LED	SEE A-3 FOR MOUNTING HEIGHTS
L5	3" TRACKHEAD	SOLAIS		MOUNTING HEIGHT @ 7'-0" A.F.F
L6	WALL SCONCE	SATCO	NUVO 62-1483	MOUNTING HEIGHT @ 7'-0" A.F.F
X	3" TRACKHEAD	SOLAIS		

LIGHTING SCHEDULE NOTES

1. PROVIDE ALL FIXTURES COMPLETE WITH LAMPS.
2. PROVIDE HOLD-DOWN CLIPS FOR EACH CORNER OF LED GRID TROFFERS.
3. COORDINATE AND VERIFY ALL FIXTURE INFORMATION, TYPE AND FINAL LOCATIONS WITH THE REFLECTED CEILING PLAN.
4. PROVIDE ALL REQUIRED MOUNTING OR HANGING HARDWARE.
5. ALL SUSPENDED FIXTURES AND SURFACE OR RECESSED FIXTURES IN SOFFITS/CEILING PAINTED [XX-XX] SHALL HAVE BLACK TRIM IN LIEU OF WHITE.



LIGHTING PLAN - GENERAL NOTES

- I. FOR EXACT LIGHTING FIXTURE DETAILS AND SELECTIONS COORDINATE WITH ARCHITECT/OWNER.

LIGHTING PLAN - KEYED WORK NOTES

- A. E.C. SHALL COORDINATE EXACT LOCATION OF THE LIGHTING CONTACTOR PANEL "LCP" WITH ARCHITECT/OWNER.
- B. CONNECT ALL EMERGENCY EGRESS AND NIGHT LIGHTING FIXTURES TO THE NEAREST LIGHTING BRANCH CIRCUIT AHEAD OF ALL SWITCHING AND CONTROLS PER STATE AND LOCAL CODES.
- C. VERIFY THE EXACT LOCATIONS OF SIGNS, AND FASCIA BOXES BEFORE INSTALLATION OF JUNCTION BOXES. E.C. SHALL VERIFY EXACT SIGN(S) WIRING REQUIREMENTS WITH THE SIGN SUPPLIER PRIOR TO SUBMITTING A BID FOR THE ELECTRICAL.
- D. PROVIDE A 30AMP DISCONNECT SWITCH WITH LOCK-OFF CAPABILITY FOR STOREFRONT SIGN. VERIFY EXACT LOCATION AND ELECTRICAL REQUIREMENTS CONNECTION TO STOREFRONT SIGN. VERIFY EXACT LOCATION OF POWER FEED AND PUNCH-THRU WITH SIGNAGE CONTRACTOR TO ENSURE NO EXCESSIVE CONDUIT IS RUN NEITHER INSIDE NOT OUTSIDE. TIE CIRCUIT INTO LIGHTING CONTROL SYSTEM FOR CONTROLS.
- E. TERMINATE SPEAKER WIRES AT VOLUME CONTROL. COORDINATE WITH ARCHITECT/OWNER.

CIRCUIT NUMBER NAMING:

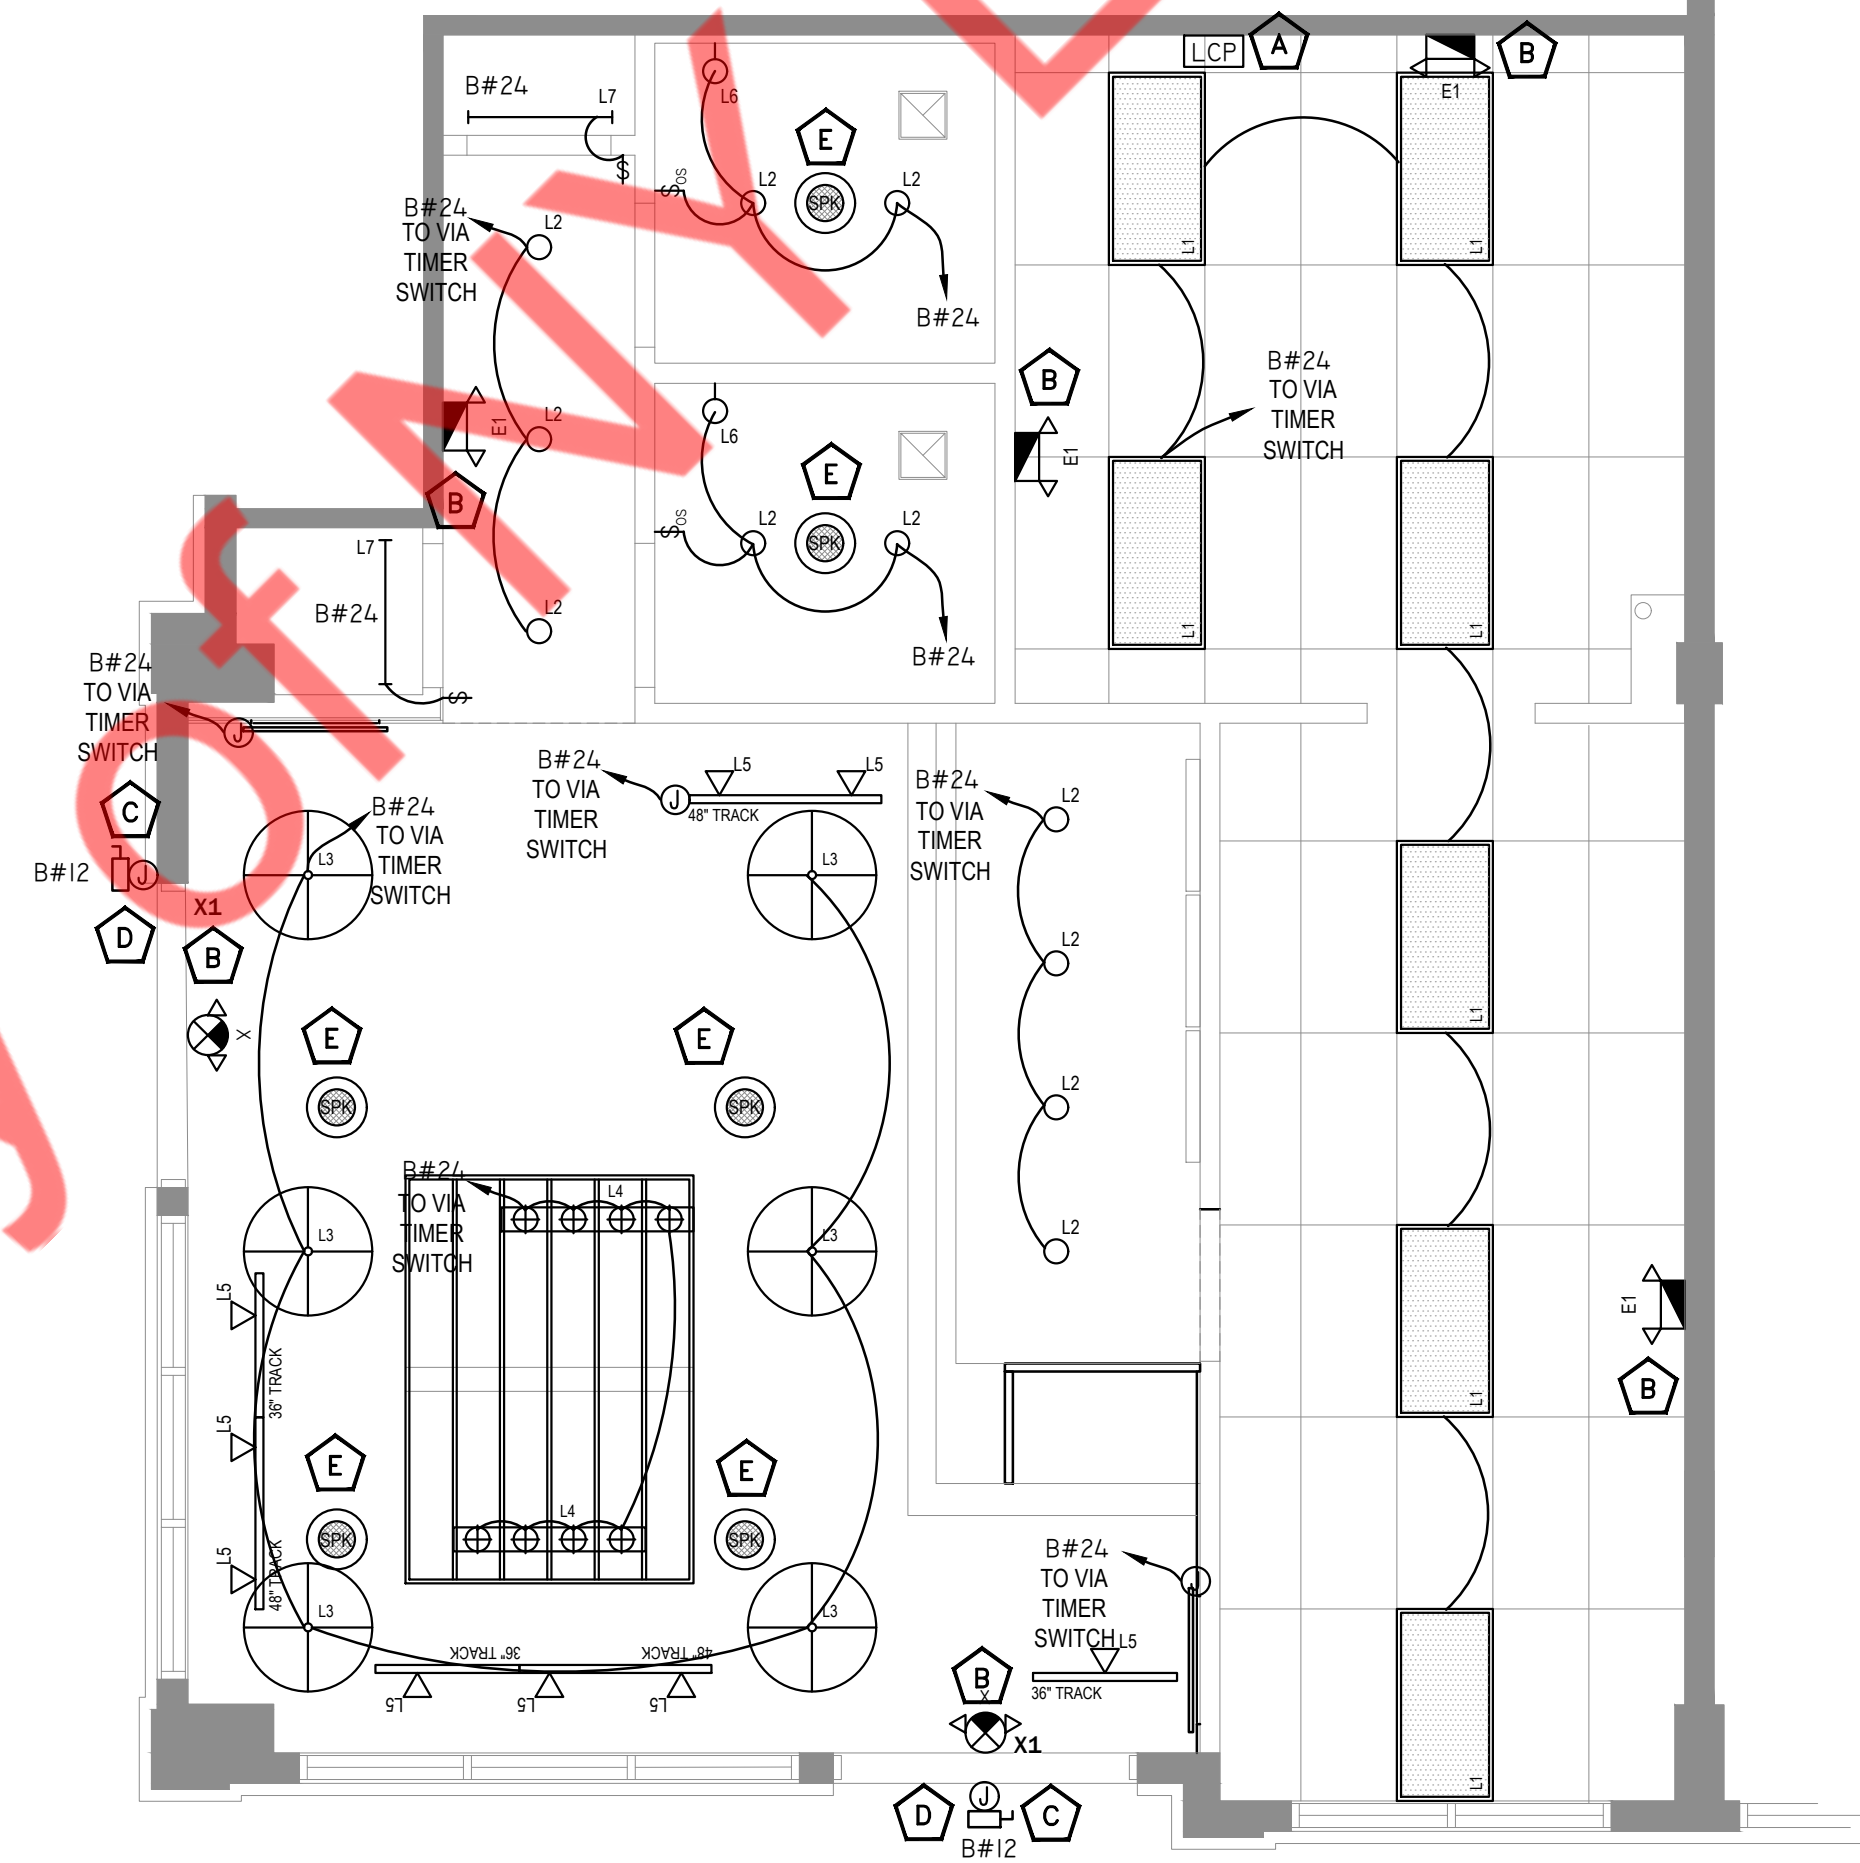

Property of SALTY Engineers

A1

ELECTRICAL LIGHTING PLAN

SCALE: 1/4" = 1'-0"

SALT 2.0

DWG TITLE:

ELECTRICAL LIGHTING PLAN

SHEET No.

E-4

EQUIPMENT SCHEDULE


TAG	QTY.	GENERAL EQUIPMENT INFORMATION DESCRIPTION	PLUMBING				ELECTRICAL					
			WATER		WASTE		REMARKS	LOAD VOLTS PHASE	AMPS	CIRCUIT SIZE	SUPPLIED W/ PLUG	RECEPT. SPEC. (NEMA)
H.W.	C.W. (F.W.)	DIR.	IND.									
101A	1	72" 3-Section Under Counter Refrigerator, 21.13 cu ft					115	1	2.8	15	Y	5-15
101B	1	60" 2-Section Under Counter Refrigerator, 17.2 cu ft					115	1	2.8	15	Y	5-15
101C	1	36" 2-Section Under Counter Refrigerator, 13.4 cu ft					115	1	2.3	15	Y	5-15
102A	1	72" 3-Section Sandwich/Salad Prep Refrigerator, 21.13 cu ft					115	1	2.8	15	Y	5-15
102B	2	48" 2-Section Sandwich/Salad Prep Refrigerator, 13.38 cu ft					115	1	2.3	15	Y	5-15
102C	1	27" 1-Section Sandwich/Salad Prep Refrigerator, 7.15 cu ft					115	1	2.3	15	Y	5-15
103	1	4-Well Electric Steam Table					120	1	16.7	20	Y	5-30
104	1	30" x 60" Work Table										
105	1	Reach-In Refrigerator					115	1	9.9	15		
106	1	Reach-In Freezer					115	1	11.9	15		
107	1	Stainless Steel 18"x18" 1-Compartment Sink, Right Drainboard	1/2"	1/2"	1-1/2"							
108	1	Wall Mount Hand Sink	1/2"	1/2"	1-1/2"							
109	1	Stainless Steel 3-Compartment Corner Sink	1/2"	1/2"	1-1/2"							
110	1	Rice Warmer					120	1	.88	15	Y	
111	1	Rice Cooker					208	1	10.8	15	Y	
112	1	Robot Coupe Food Processor, 3L					120	1	7	15	Y	5-15
113	1	Slim Jim Trash Can										
114	3	XpressChef Combination Oven, 3000W, .61 cu ft					208	1	28.6	30	Y	6-30
115	3	Microwave Oven, 1,000W, 1.2 cu ft					120	1	13	20	Y	5-15
116	3	Sandwich/Panini Grill					120	1	15	20	Y	5-15
117A	1	Soda Machine					115	1				
117B	1	Ice Machine	(1/2")		1/2"		115	1	8.8	15		
118	1	6" In-Counter Refrigerated Merchandiser					120	1	16	20	Y	5-20
119	2	18" x 48" Stainless Steel Overshelf										
120	2	24" x 36" Storage Rack										

POWER PLAN - GENERAL NOTES

- ALL 120V, 15A AND 20A RECEPTACLES IN KITCHEN AREA SHALL BE "GFCI" IN ACCORDANCE WITH NEC ARTICLE 210.8(B). PROVIDE GFI RATED BREAKER AT PANEL FOR KITCHEN EQUIPMENT.
- VERIFY MOUNTING HEIGHTS OF ALL RECEPTACLES WITH EQUIPMENT SUPPLIED PRIOR TO INSTALLATION.
- E.C. TO PROVIDE CORD & PLUG CONNECTIONS FOR EQUIPMENT AS REQUIRED.
- ALL CIRCUITS FOR P.O.S. (POINT OF SALE) EQUIPMENT SHALL BE CONNECTED TO THE SAME PHASE OF POWER IN THE PANEL. ALL BRANCH CIRCUIT BREAKERS SUPPLYING P.O.S. EQUIPMENT SHALL HAVE LOCKING HANDLES DEVICES.
- EACH RECEPTACLE TYPE (LOCKING OR STRAIGHT BLADE) SHALL MATCH THAT OF THE EQUIPMENT FURNISHED.
- EXISTING ELECTRICAL CONNECTION TO CONDENSATE PUMPS TO REMAIN. E.C. SHALL VERIFY THE OPERABLE CONDITION OF THE ELECTRICAL CONNECTION IN FIELD. REPLACE IF FOUND INOPERABLE.

POWER PLAN - KEYED WORK NOTES

- EXISTING 400A, 120/208V, 3-PHASE ELECTRICAL PANEL A TO REMAIN. E.C. SHALL VERIFY RATING, CONNECTION AND LOCATION OF PANEL IN FIELD. REPLACE IF INOPERABLE. BASE BID ACCORDINGLY.
- JUNCTION BOX FOR HAND DRYER. COORDINATE MOUNTING HEIGHT TO COMPLY WITH ADA.
- REFER TO EQUIPMENT SPECIFICATIONS FOR DATA AND POWER REQUIREMENTS AND LOCATIONS FOR ALL MENU BOARDS AND SIGNS.
- EXISTING ELECTRICAL CONNECTION TO UNIT CU-1 TO REMAIN. E.C. SHALL VERIFY THE OPERABLE CONDITION OF THE ELECTRICAL CONNECTION IN FIELD. REPLACE IF FOUND INOPERABLE. E.C. SHALL COORDINATE WITH OWNER/LANDLORD FOR LOCATION OF THE MECHANICAL UNIT.
- EXISTING ELECTRICAL CONNECTION TO UNIT G-1 TO REMAIN. E.C. SHALL VERIFY THE OPERABLE CONDITION OF THE ELECTRICAL CONNECTION IN FIELD. REPLACE IF FOUND INOPERABLE.
- E.C. SHALL COORDINATE WITH OWNER/LANDLORD FOR LOCATION OF THE MECHANICAL UNIT.
- NEW 125A, 120/208V, 3-PHASE ELECTRICAL PANEL B. E.C. SHALL COORDINATE WITH ARCHITECT/OWNER FOR LOCATION
- E.C. TO PROVIDE J-BOX AND RECEPTACLE OUTLET MOUNTED IN TOEKICK. E.C. TO COORDINATE WITH ARCHITECT FOR FINAL LOCATION OF RECEPTACLES.

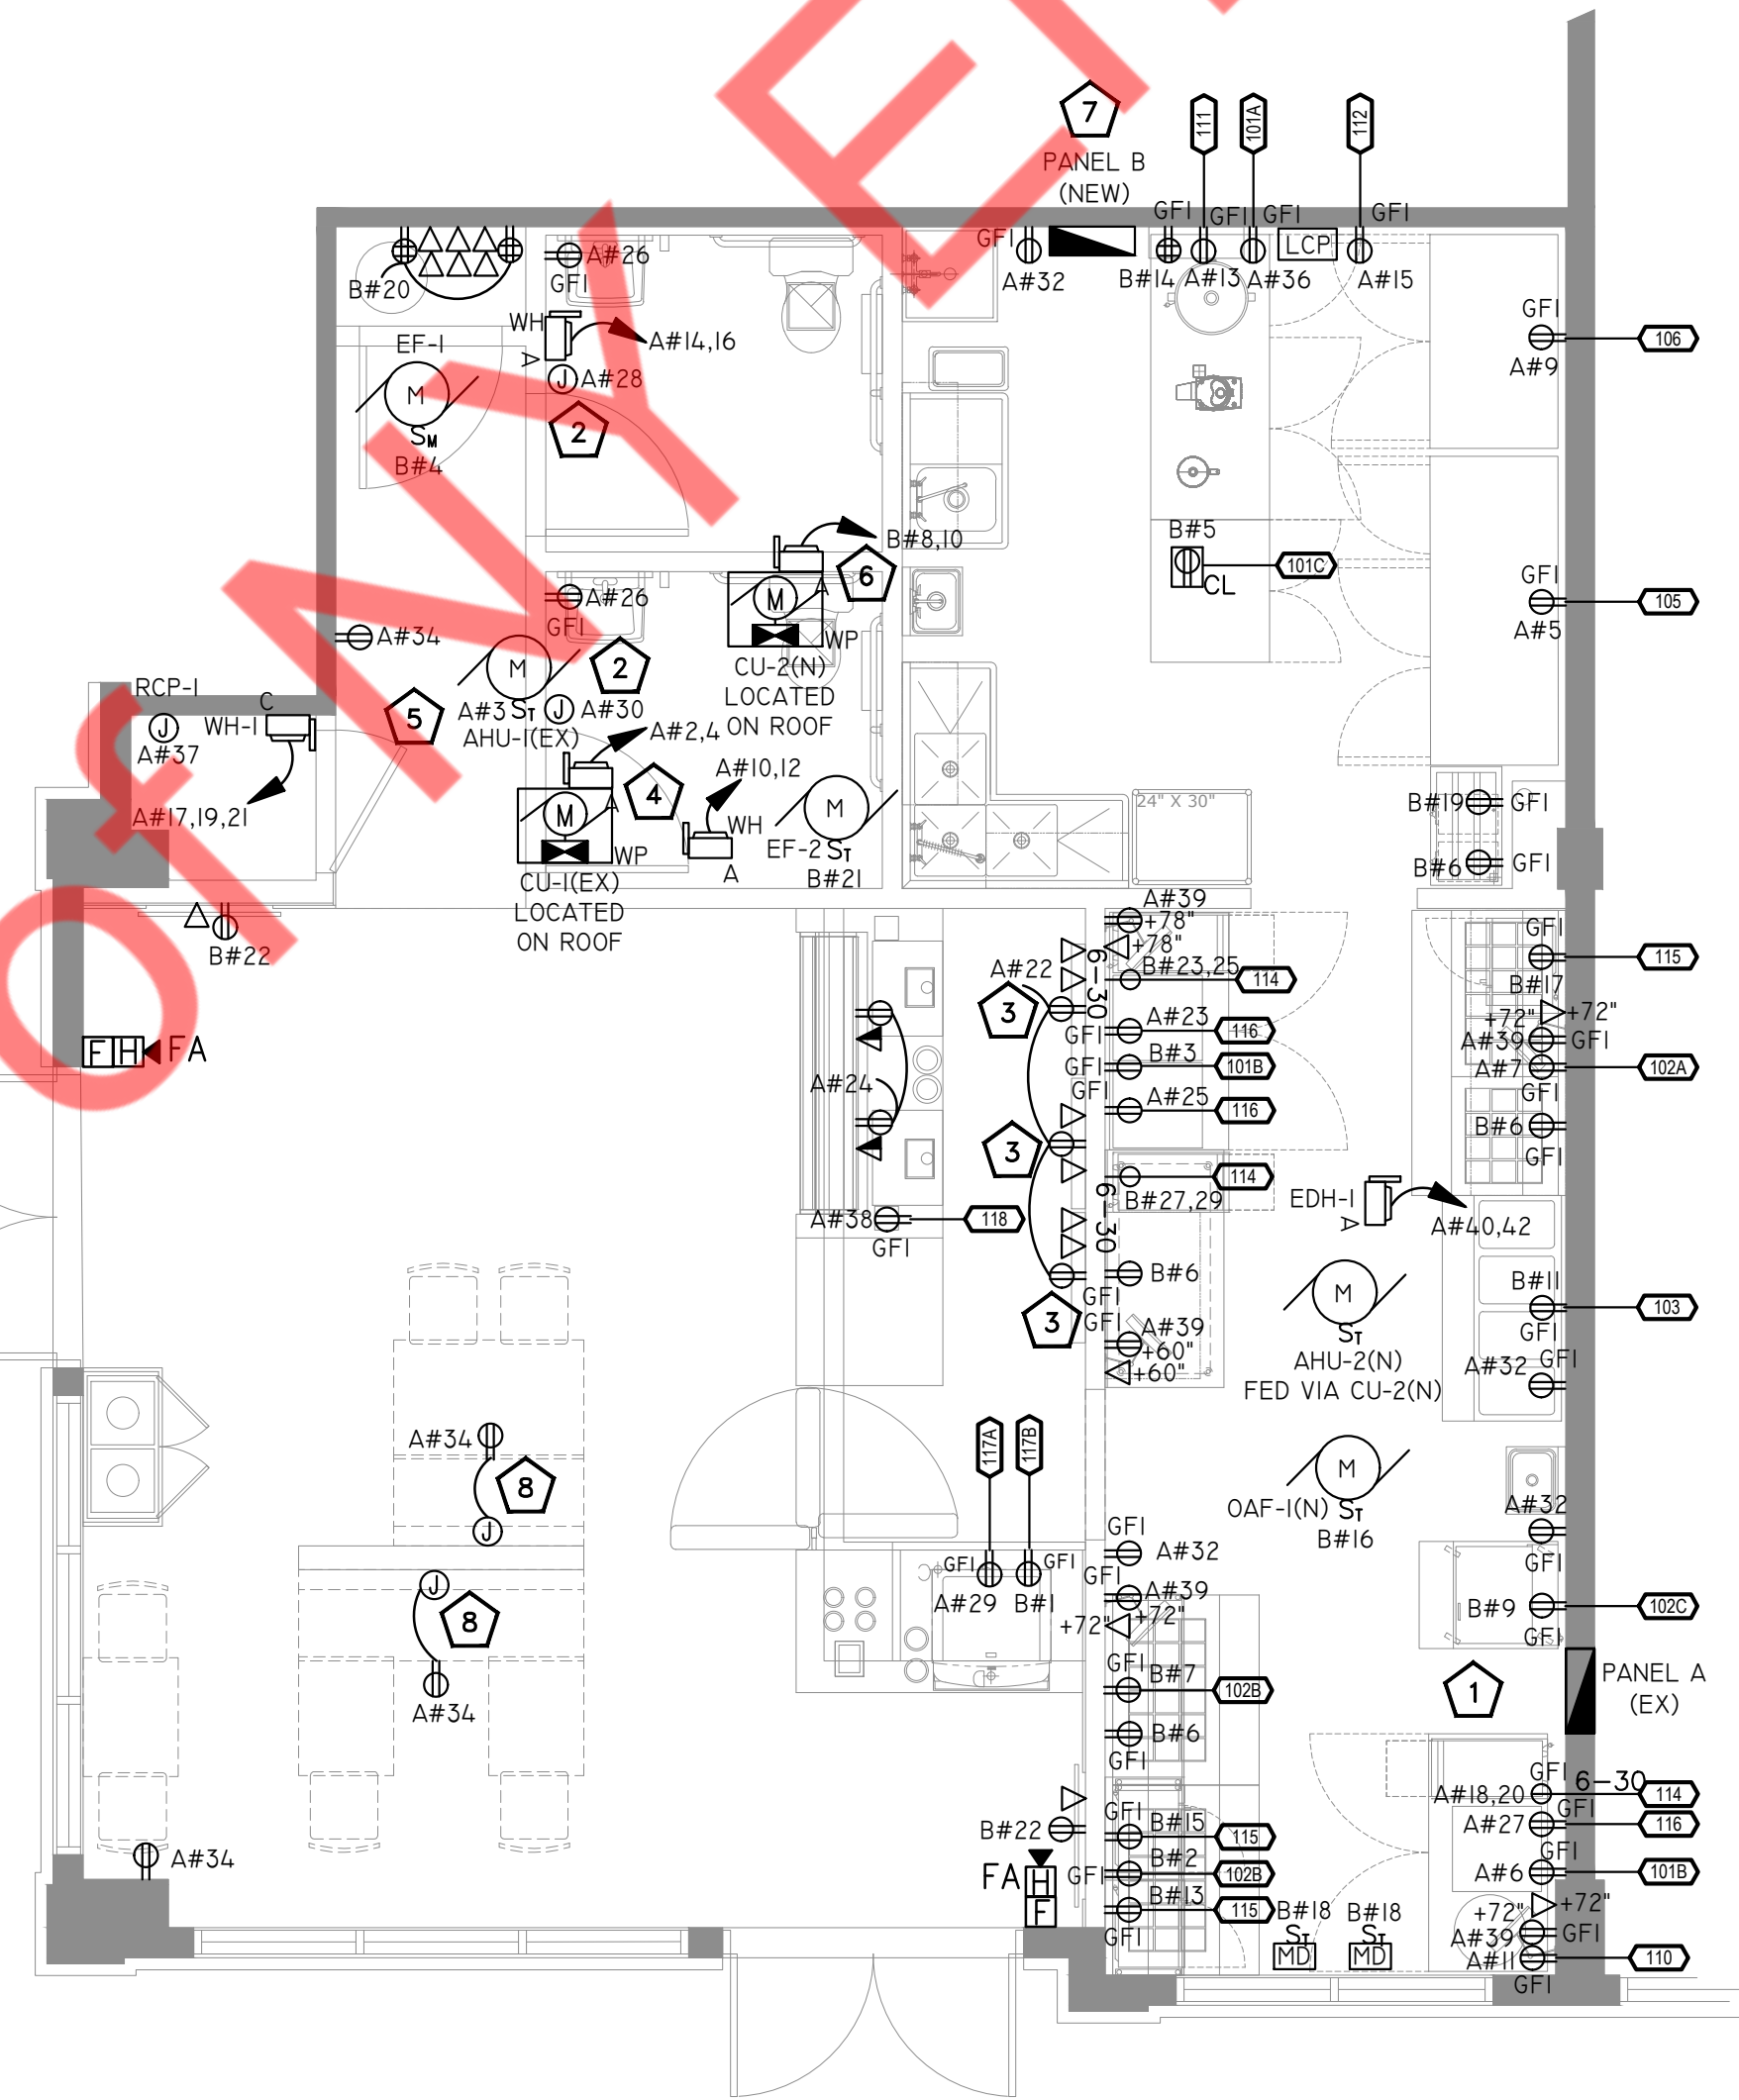

G1 ELECTRICAL POWER PLAN

SCALE: 1/4" = 1'-0"

SALT 2.0



DWG TITLE:

ELECTRICAL POWER PLAN


SHEET No.

E-5




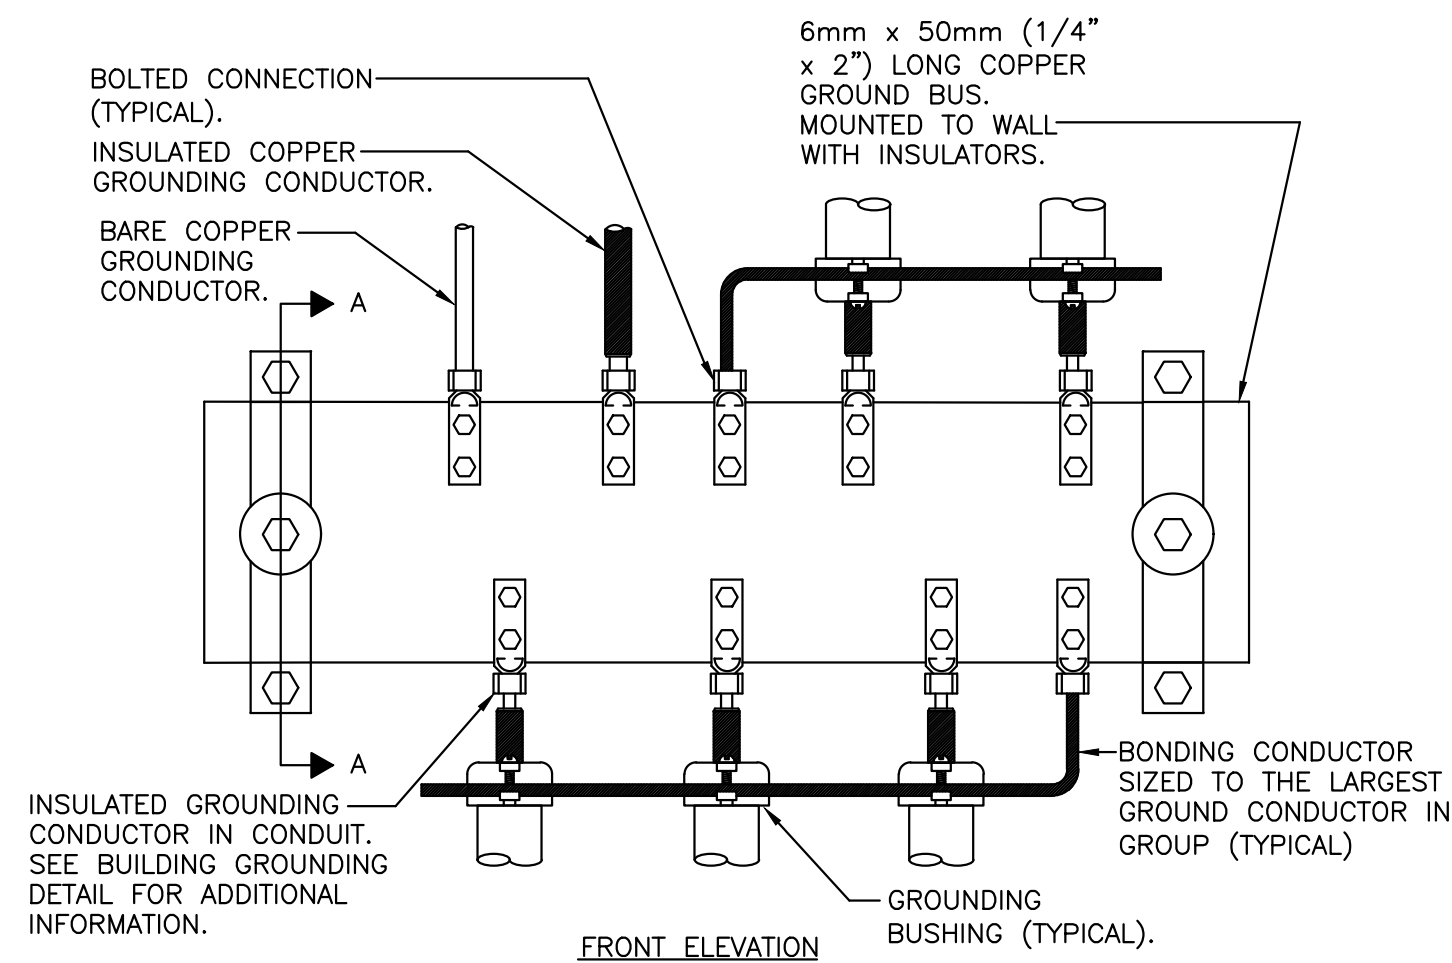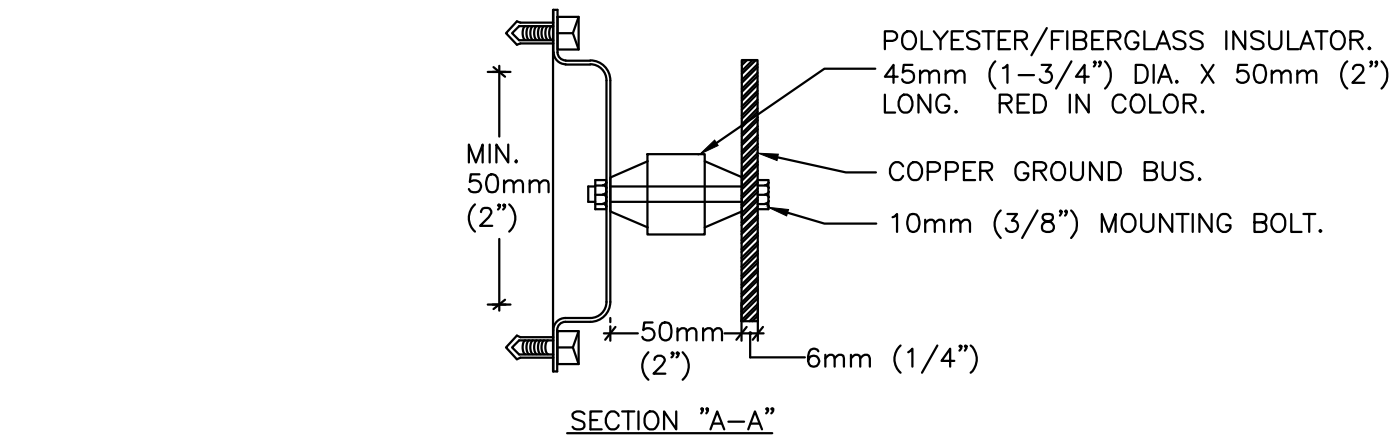

NOTES:  
1. REFER TO BUILDING GROUNDING ELECTRODE SYSTEM DETAIL FOR EXACT CONFIGURATION.

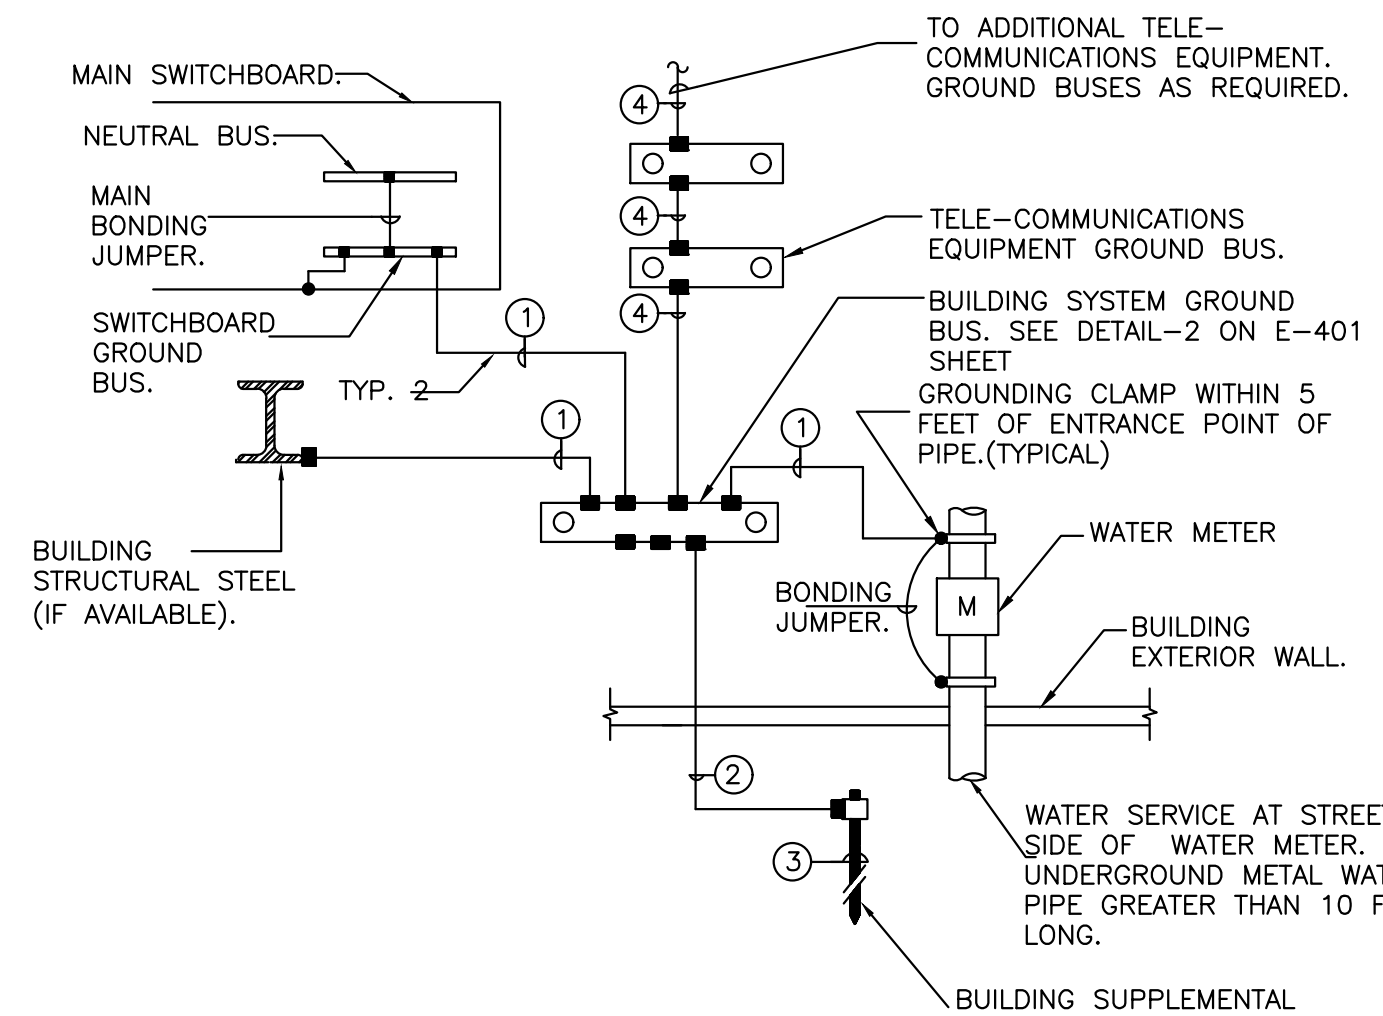

LEGEND:  
● INDICATES BOLTED CONNECTION.  
■ INDICATES EXOTHERMIC WELD CONNECTION, COMPATIBLE WITH MATERIALS BEING JOINED.  
① INSULATED COPPER GROUNDING ELECTRODE CONDUCTOR IN CONDUIT SIZED AS PER NEC ARTICLE 250.66.  
② 4/0 AWG BARE COPPER GROUND CONDUCTOR.  
③ 3/4" x 10'-0" LONG COPPER-CLAD GROUND ROD DRIVEN WITH TOP 12" BELOW GRADE.  
④ 2/0 AWG INSULATED COPPER GROUND CONDUCTOR IN 30mm CONDUIT.

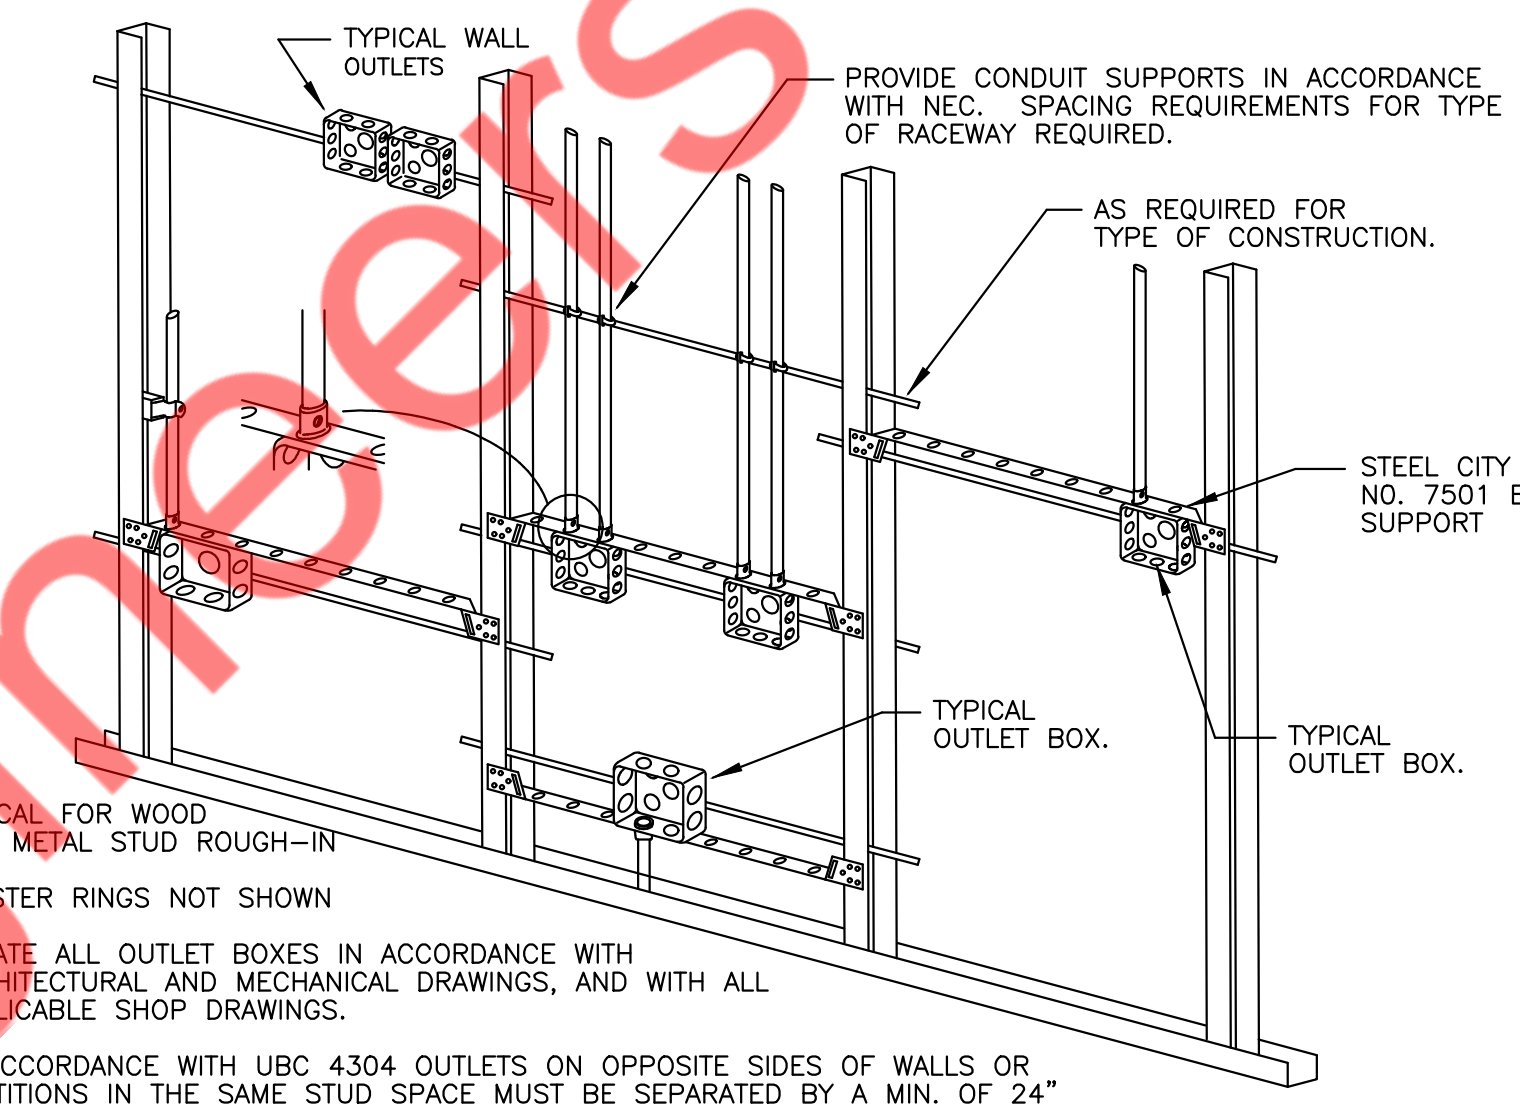

NOTES:  
① TYPICAL FOR WOOD AND METAL STUD ROUGH-IN  
② PLASTER RINGS NOT SHOWN  
③ LOCATE ALL OUTLET BOXES IN ACCORDANCE WITH ARCHITECTURAL AND MECHANICAL DRAWINGS, AND WITH ALL APPLICABLE SHOP DRAWINGS.  
④ IN ACCORDANCE WITH UBC 4304 OUTLETS ON OPPOSITE SIDES OF WALLS OR PARTITIONS IN THE SAME STUD SPACE MUST BE SEPARATED BY A MIN. OF 24" HORIZONTAL DISTANCE.

6 BUILDING ELECTRICAL SYSTEMS GROUND BUS  
E-5 N.T.S

4 BUILDING GROUNDING ELECTRODE SYSTEM  
E-5 N.T.S



2 DETAIL TYPICAL ROUGH-IN REQUIREMENTS  
E-5 N.T.S

**MANUAL MODE OPERATION:**  
1. PUSHBUTTON PRESS IS REQUIRED TO TURN LOAD ON.  
2. LOAD TURNS OFF WHEN SENSOR TIMES OUT OR BY PRESSING PUSH BUTTON.  
3. IF DAYLIGHT SENSOR IS ENABLED AND LIGHT LEVEL IS ABOVE SETPOINT, LOAD WILL NOT TURN ON.


**AUTOMATIC MODE OPERATION:**  
1. WHEN SENSOR ACTIVATES LOAD TURNS ON.  
2. PUSHBUTTON CAN BE USED TO TURN LOAD ON OR OFF. IF PUSHBUTTON IS USED TO TURN LOAD OFF, SENSOR MUST TIME OUT FIRST, BEFORE LOAD CAN TURN BACK ON AUTOMATICALLY.  
3. IF DAYLIGHT SENSOR IS ENABLED AND LIGHT LEVEL IS ABOVE SETPOINT, LOAD WILL NOT TURN ON.

SENSOR TYPES INCLUDE:  
ONW-D-1001-MV-N

① PROVIDE SENSING CONDUCTOR TAPPED AHEAD OF ANY SWITCHES WHERE SWITCH SERVES EMERGENCY FIXTURES.

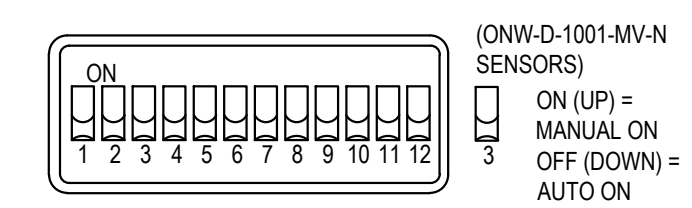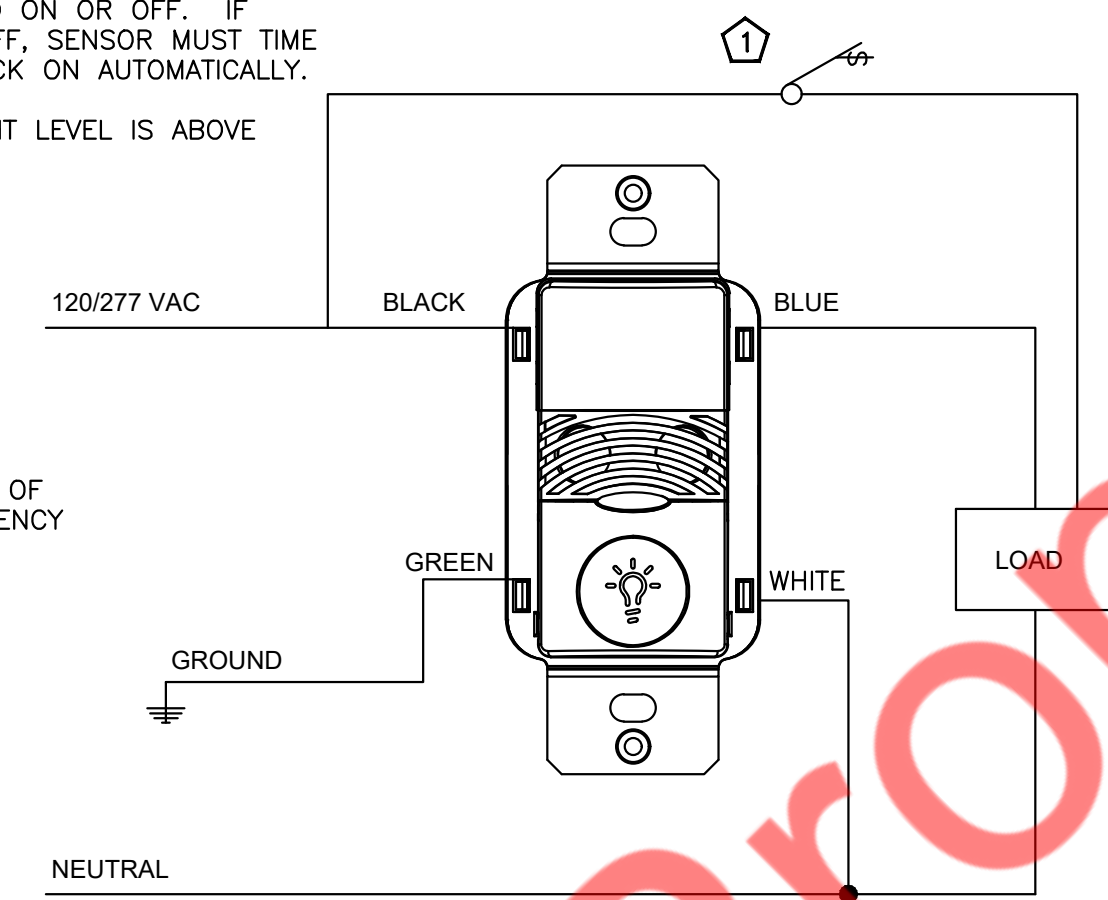

5 CONNECTION OCCUPANCY/VACANCY-SINGLE LEVEL WIRING DIAGRAM-LINE VOLTAGE WALL SWITCH SENSOR(NEUTRAL)  
E-5 N.T.S

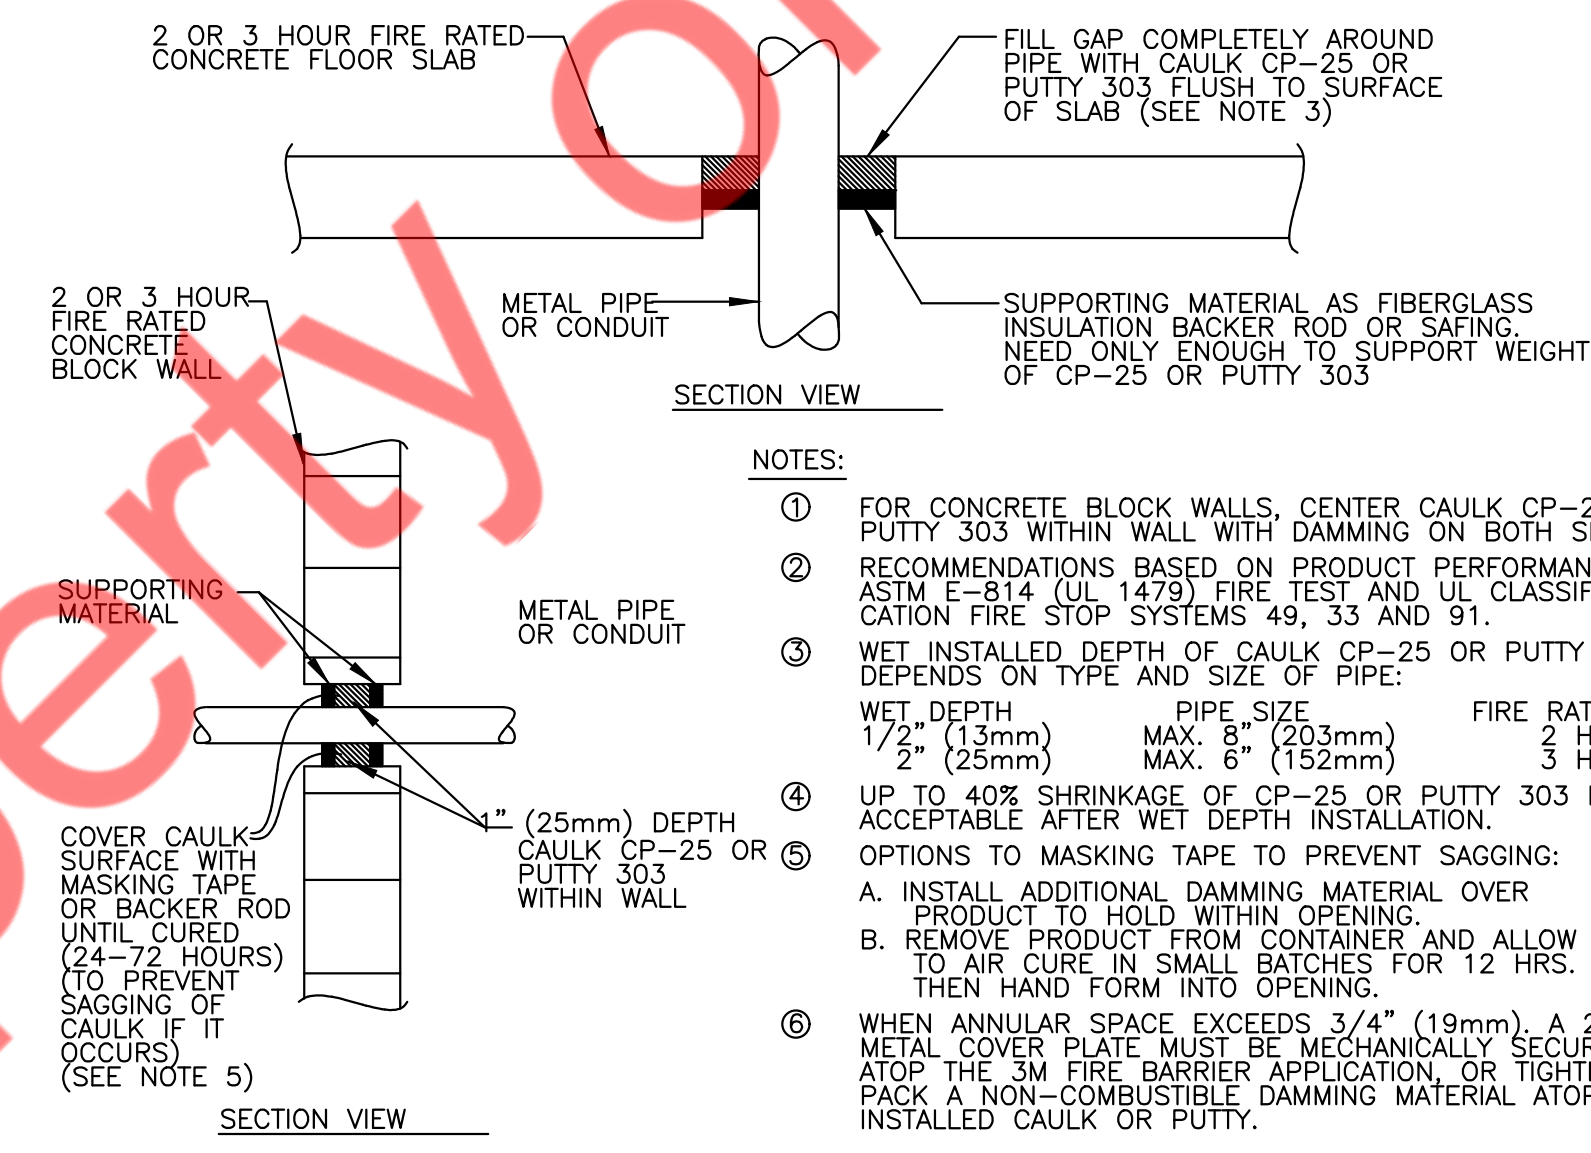

NOTES:  
① FOR CONCRETE BLOCK WALLS, CENTER CAULK CP-25 OR PUTTY 303 WITHIN WALL WITH DAMMING ON BOTH SIDES.  
② RECOMMENDATIONS BASED ON PRODUCT PERFORMANCE PER ASTM E-814 (UL 1479) FIRE TEST AND UL CLASSIFICATION FIRE STOP SYSTEMS 49, 33 AND 91.  
③ WET INSTALLED DEPTH OF CAULK CP-25 OR PUTTY 303 DEPENDS ON TYPE AND SIZE OF PIPE:  
WET DEPTH PIPE SIZE FIRE RATING  
1/2" (13mm) MAX. 8" (203mm) 2 HRS.  
3/4" (19mm) MAX. 6" (152mm) 3 HRS.  
④ UP TO 40% SHRINKAGE OF CP-25 OR PUTTY 303 IS ACCEPTABLE AFTER WET DEPTH INSTALLATION.  
⑤ OPTIONS TO MASKING TAPE TO PREVENT SAGGING:  
A. INSTALL ADDITIONAL DAMMING MATERIAL OVER PRODUCT TO HOLD WITHIN OPENING.  
B. REMOVE PRODUCT FROM CONTAINER AND ALLOW TO AIR CURE IN SMALL BATCHES FOR 12 HRS. THEN HAND FORM INTO OPENING.  
⑥ WHEN ANNULAR SPACE EXCEEDS 3/4" (19mm), A 28 AWG METAL COVER PLATE MUST BE MECHANICALLY SECURED ATOP THE 3M FIRE BARRIER APPLICATION, OR TIGHTLY PACK A NON-COMBUSTIBLE DAMMING MATERIAL ATOP INSTALLED CAULK OR PUTTY.


3 FIRE STOP DETAIL  
E-5 N.T.S

**AUTOMATIC MODE OPERATION**  
1. WHEN SENSOR ACTIVATES, LOAD TURNS ON.  
2. LOAD TURNS OFF, WHEN SENSOR TIMES OUT.

RECOMMENDED WIRE  
18-3 AWG STRANDED WIRE SHIELDED OR NON-SHIELDED

SENSOR TYPES INCLUDE  
OAC-DT-0501, OAC-DT-1000, OAC-DT-2000  
OAC-U-0501, OAC-U-1000, OAC-U-2000  
OAC-P-0500, OAC-P-1500

SWITCHPACK TYPE INCLUDES  
SP20-MV

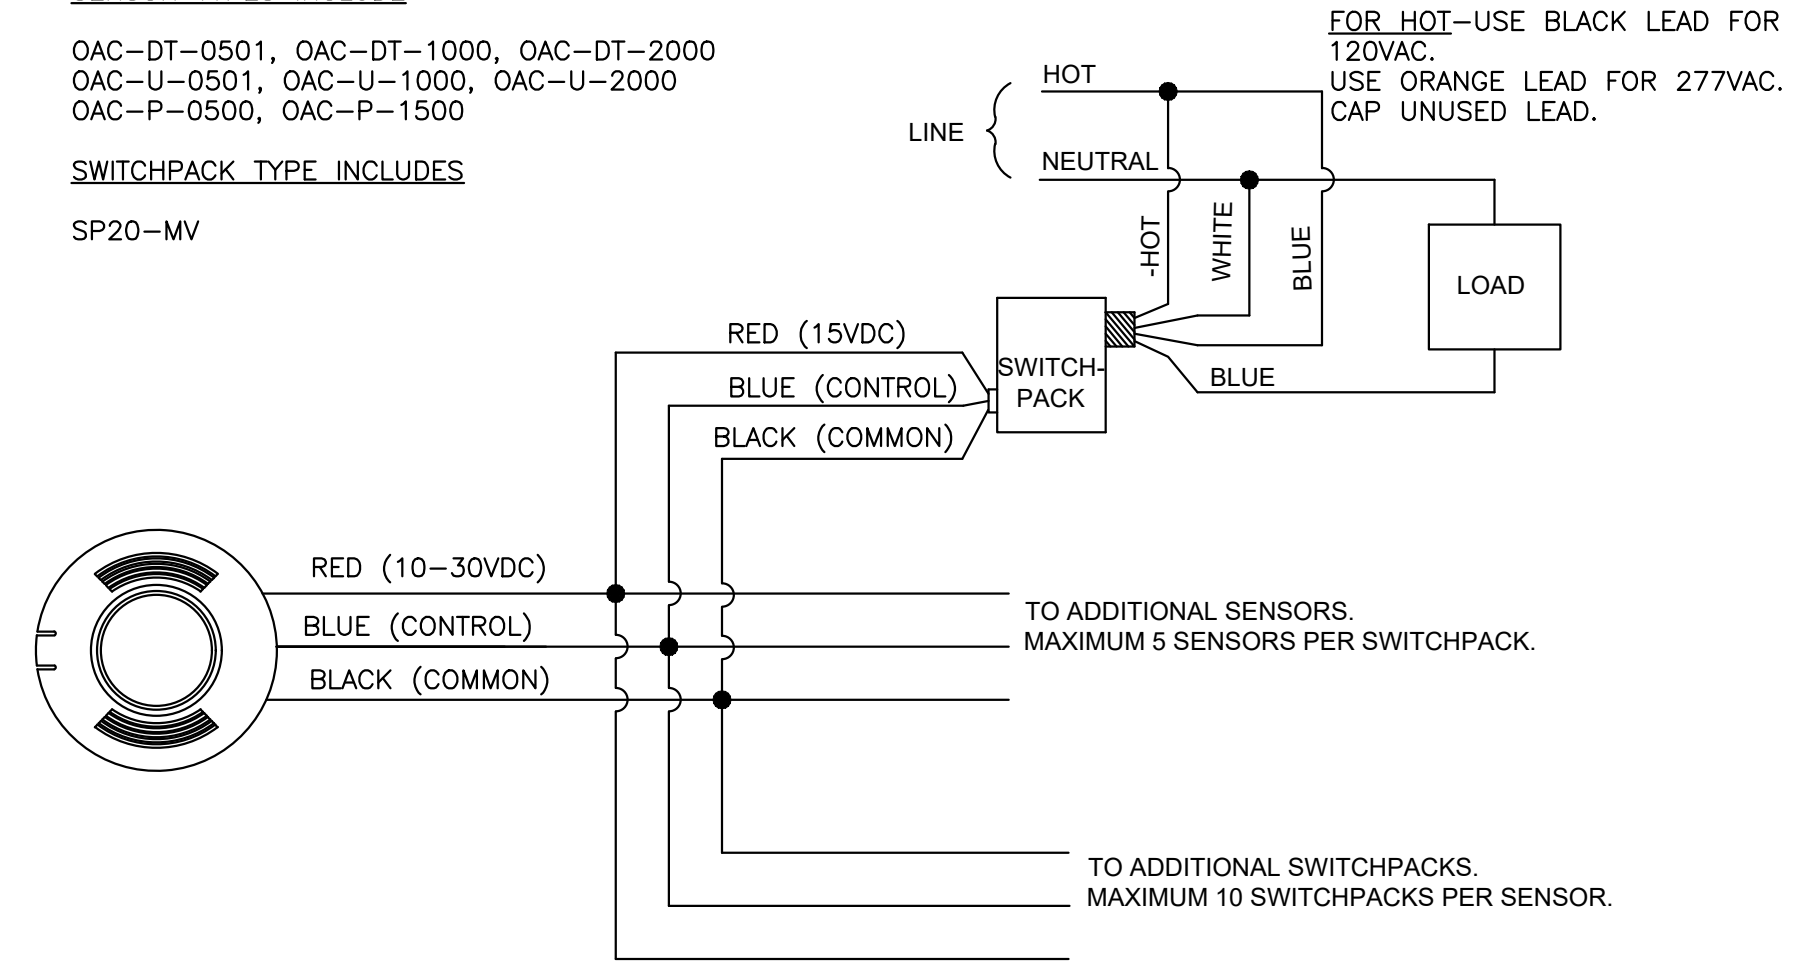

1 OCCUPANCY - AUTO ON/OFF WIRING DIAGRAM - LOW VOLTAGE CEILING SENSOR  
E-5 N.T.S

SALT 2.0

DWG TITLE:  
ELECTRICAL DETAILS

SHEET No.  
E-6



PANEL: A (EX)		MOUNTING: SURFACE												
208Y/120	VOLTS,	3	PHASE,	4	WIRE	PANEL LOCATION:								
MAIN CB:	MLO:	400 A	BUS:	400 A	MIN,	FED FROM:								
CKT NO.	TRIP AMPS	DESCRIPTION OF LOAD	LOAD TYPE	LOAD (KVA)	MINIMUM BRANCH CIRCUIT	PER PHASE (KVA)			MINIMUM BRANCH CIRCUIT	LOAD (KVA)	LOAD TYPE	DESCRIPTION OF LOAD	TRIP AMPS	CKT NO.
						A	B	C						
1	20	CONDENSATE PUMP (EX)	H	0.50	EXISTING	2.40			EXISTING	1.90	H	CU-1 (EX)	2P-30	2
3	20	AHU-1 (EX)	H	1.50	EXISTING		3.40			1.90	H			4
5	20	105 REACH IN COOLER	E	1.14	2#12, #12G, 3/4" C			1.46	2#12, #12G, 3/4" C	0.32	E	101B UNDERCOUNTER REFRIGERATOR	20	6
7	20	102A TOP REFRIGERATED TABLE	E	0.32	2#12, #12G, 3/4" C	0.32						SPARE	20	8
9	20	106 REACH IN FREEZER	E	1.40	2#12, #12G, 3/4" C		2.90		2#12, #12G, 3/4" C	1.50	H	WALL HEATER	2P-20	10
11	20	110 RICE WARMER	E	0.12	2#12, #12G, 3/4" C			1.62		1.50	H			12
13	20	111 RICE COOKER	E	1.80	2#12, #12G, 3/4" C	3.30			2#12, #12G, 3/4" C	1.50	H	WALL HEATER	2P-20	14
15	20	112 BOWL CUTTER	E	0.80	2#12, #12G, 3/4" C		2.30			1.50	H			16
17			H	6.00				9.00	2#10, #10G, 3/4" C	3.00	E	114 HIGH SPED OVEN	2P-30	18
19	3P-80	WH-1	H	6.00	4#4, #8G, 1" C	9.00				3.00	E			20
21			H	6.00			6.54		2#12, #12G, 3/4" C	0.54	R	MENU BOARD RECEPTACLES	20	22
23	20	116 PANINI PRESS	E	1.80	2#12, #12G, 3/4" C		2.16	2.16	2#12, #12G, 3/4" C	0.36	R	POS RECEPTACLES	20	24
25	20	116 PANINI PRESS	E	1.80	2#12, #12G, 3/4" C	2.16			2#12, #12G, 3/4" C	0.36	R	RESTROOM RECEPTACLES	20	26
27	20	116 PANINI PRESS	E	1.80	2#12, #12G, 3/4" C		2.80		2#12, #12G, 3/4" C	1.00	O	HAND DRYER	20	28
29	20	117A SODA MACHINE	E	0.69	2#12, #12G, 3/4" C			1.69	2#12, #12G, 3/4" C	1.00	O	HAND DRYER	20	30
31			O	9.63		10.35			2#12, #12G, 3/4" C	0.72	R	KITCHEN RECEPTACLES	20	32
33	3P-125	PANEL B (NEW)	O	9.63	4#1, #6G, 1 1/4" C		10.35		2#12, #12G, 3/4" C	0.72	R	FOH RRECEPTACLES	20	34
35			O	9.63				9.95	2#12, #12G, 3/4" C	0.32	E	101A UNDERCOUNTER REFRIGERATOR	20	36
37	20	RCP-1	M	0.10	2#12, #12G, 3/4" C	1.94			2#12, #12G, 3/4" C	1.84	E	118 COUNTER REFRIGERATOR MERCHENDIZER	20	38
39	20	RECEPTACLES FOR VDU	R	0.90	2#12, #12G, 3/4" C		3.40			2.50	H	EDH-1	2P-30	40
41	20	SPARE						2.50	2#10, #10G, 3/4" C	2.50	H			42
<b>TOTAL CONNECTED LOAD (KVA)</b>						<b>29.47</b>	<b>31.69</b>	<b>28.37</b>						

PANEL: B (NEW)		MOUNTING: SURFACE												
208Y/120	VOLTS,	3	PHASE,	4	WIRE	PANEL LOCATION:								
MAIN CB:	MLO:	125	BUS:	125 A	MIN,	FED FROM: PANEL A (EX)								
CKT NO.	TRIP AMPS	DESCRIPTION OF LOAD	LOAD TYPE	LOAD (KVA)	MINIMUM BRANCH CIRCUIT	PER PHASE (KVA)			MINIMUM BRANCH CIRCUIT	LOAD (KVA)	LOAD TYPE	DESCRIPTION OF LOAD	TRIP AMPS	CKT NO.
						A	B	C						
1	20	117B ICE MACHINE	E	1.70	2#12, #12G, 3/4" C	1.97			2#12, #12G, 3/4" C	0.27	E	102B SALAD PREP REFRIGERATED	20	2
3	20	101B UNDERCOUNTER REFRIGERATOR	E	0.32	2#12, #12G, 3/4" C		1.42		2#12, #12G, 3/4" C	1.10	M	EF-1	20	4
5	20	101C UNDERCOUNTER REFRIGERATOR	E	0.27	2#12, #12G, 3/4" C			0.99	2#12, #12G, 3/4" C	0.72	R	CONVENIENCE RECEPTACLE	20	6
7	20	102B SALAD PREP REFRIGERATED	E	0.27	2#12, #12G, 3/4" C	3.60				3.33	H	CU-2 (N)	2P-40	8
9	20	102C SALAD PREP REFRIGERATED	E	0.27	2#12, #12G, 3/4" C		3.60		2#8, #10G, 3/4" C	3.33	H			10
11	30	103 ELECTRIC STEAM TABLE	E	2.00	2#10, #10G, 3/4" C			3.60	2#12, #12G, 3/4" C	1.60	L	SIGNAGE	20	12
13	20	115 MICROWAVE	E	1.50	2#12, #12G, 3/4" C	1.86			2#12, #12G, 3/4" C	0.36	R	QUAD RECEPTACLE	20	14
15	20	115 MICROWAVE	E	1.50	2#12, #12G, 3/4" C		2.60		2#12, #12G, 3/4" C	1.10	M	OAF-1 (N)	20	16
17	20	115 MICROWAVE	E	1.50	2#12, #12G, 3/4" C			1.70	2#12, #12G, 3/4" C	0.20	M	MOTORIZED DAMPER	20	18
19	20	CARBONATOR SODA PUMP	E	0.30	2#12, #12G, 3/4" C	1.02			2#12, #12G, 3/4" C	0.72	R	TECH/MEDIA RACK	20	20
21	20	EF-2	M	1.00	2#12, #12G, 3/4" C		1.36		2#12, #12G, 3/4" C	0.36	R	RECEPTACLES FOR TV	20	22
23			E	3.00	2#10, #10G, 3/4" C			3.50	2#12, #12G, 3/4" C	0.50	L	LIGHTING ALL AREAS	20	24
25	2P-30	114 HIGH SPED OVEN	E	3.00		3.00						SPARE	20	26
27			E	3.00				3.00				SPARE	20	28
29	2P-30	114 HIGH SPED OVEN	E	3.00	2#10, #10G, 3/4" C			3.00				SPARE	20	30
<b>TOTAL CONNECTED LOAD (KVA)</b>						<b>11.45</b>	<b>11.98</b>	<b>12.79</b>						

**PANEL SCHEDULE GENERAL NOTES**

A. ALL CIRCUITING SHOWN IS FOR REFERENCE PURPOSE ONLY. E.C. SHALL VERIFY CIRCUITING OF THE EXISTING DEVICES IN FIELD AND INFORM ENGINEER FOR ANY DISCREPANCIES.

B. ELECTRICAL CONTRACTOR TO VERIFY THE EXACT PANEL SIZES AND INCOMING FEEDER SIZE.


C. ELECTRICAL CONTRACTOR SHALL VERIFY EXACT CIRCUIT NUMBER & BREAKER SIZE OF EXISTING DEVICES IN FIELD.

D. E.C. SHALL PROVIDE NEW CIRCUIT BREAKERS IN PLACE OF EXISTING CIRCUIT BREAKERS WHEREVER NECESSARY TO BE IN LINE WITH THE PANEL SCHEDULE.

E. E.C. SHALL VERIFY THE EXISTING EQUIPMENT LOAD & RATINGS IN FIELD AND ACCORDINGLY CONSIDER THE ELECTRICAL LOAD IN PANEL BOARD SCHEDULE.

**A3 PANEL SCHEDULES**

SCALE: N.T.S.

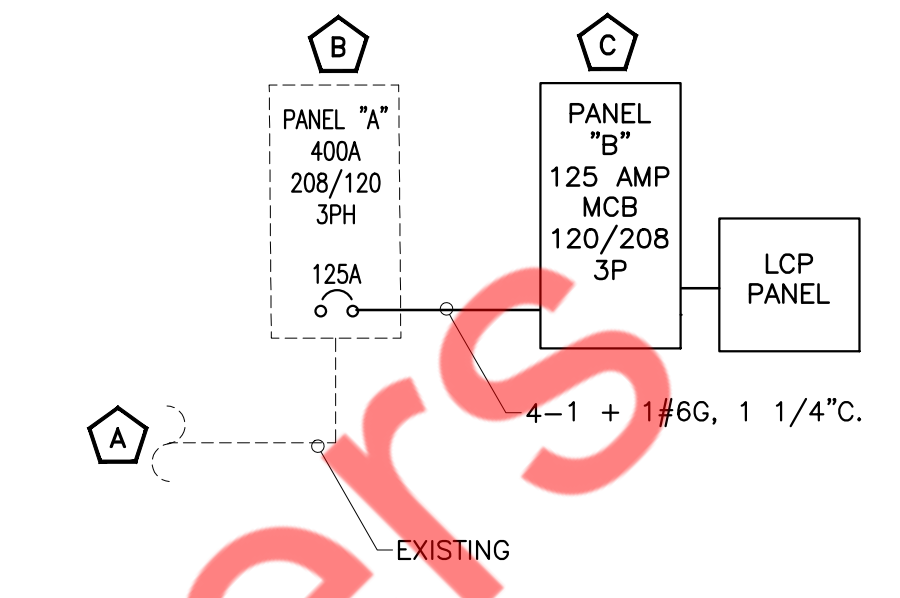

**INTERIOR FIRST FLOOR**

**ELECTRICAL RISER KEVED WORK NOTES:**


A. EXISTING 400 AMPS 208 VOLTS 3-PHASE SERVICE FOR THE SPACE FROM LANDLORD PANEL. E.C. SHALL FIELD VERIFY THE EXISTING POWER DISTRIBUTION AND CONNECTION IN FIELD. INFORM ENGINEER FOR ANY DISCREPANCY PRIOR COMMENCING ANY WORK.

B. EXISTING 400A 120/208V, 3-PHASE ELECTRICAL PANEL TO REMAIN. E.C SHALL VERIFY THE RATING AND CONNECTION IN FIELD. INFORM ENGINEER FOR ANY DISCREPANCY PRIOR COMMENCING ANY WORK.

C. 125A, 120/208V, 3-PHASE, NEW ELECTRICAL PANEL B. E.C SHALL COORDINATE WITH ARCHITECT/OWNER FOR LOCATION.

**NOTE:**

- E.C. SHALL VERIFY INCOMING SERVICE AMPERAGE, WIRE SIZING AND DISTRIBUTION.
- ELECTRICAL CONTRACTOR TO COORDINATE FAULT CURRENT (isc) RATING WITH UTILITY COMPANY AND AHJ PRIOR TO COMMENCING ANY WORK.

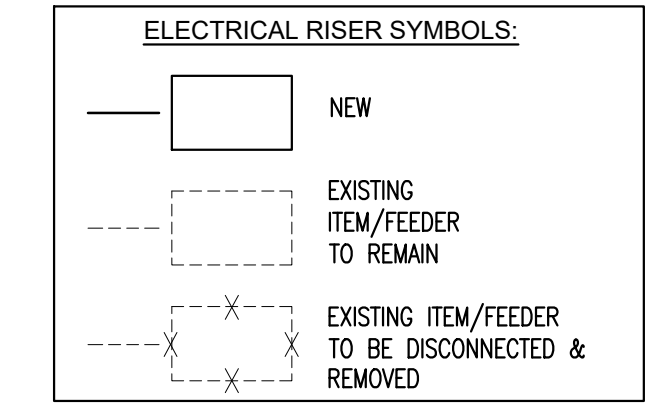

**L7 RISER DIAGRAM**

SCALE: N.T.S.

SALT 2.0

DWG TITLE:  
**ELECTRICAL RISER DIAGRAM & PANEL SCHEDULES**

SHEET No.  
**E-7**



## PLUMBING LEGEND

SYMBOL	DESCRIPTION
	SANITARY WASTE
	SANITARY SEWER (UNDERFLOOR)
	GREASE SANITARY SEWER (UNDERFLOOR)
	EXISTING SANITARY SEWER (UNDERFLOOR)
	EXISTING GREASE SEWER (UNDERFLOOR)
	VENT PIPING
	COLD WATER
	EXISTING COLD WATER
	HOT WATER
	CHECK VALVE
	FLOOR DRAIN
	PIPE UP OR DOWN
	PIPE UP
	UNION
	SHUT-OFF VALVE IN RISER
	CAP ON END OF PIPE
	CLEANOUT
	SOLENOID VALVE
	POINT OF NEW CONNECTION

## PLUMBING ABBREVIATIONS

CO	CLEANOUT
CODP	CLEAN OUT DECK PLATE
CW	COLD WATER
HW	HOT WATER
HWR	HOT WATER RETURN
SAN	SANITARY
S	SOIL
W	WASTE
LAV	LAVATORY
WC	WATER CLOSET
TYP.	TYPICAL
DN	DOWN
EXIST.	EXISTING
AFF	ABOVE FINISH FLOOR
FD	FLOOR DRAIN
SQ. FT.	SQUARE FEET
BFP	BACK FLOW PREVENTER
WH	HOT WATER HEATER
SV	SHUTOFF VALVE

## PLUMBING SPECIFICATIONS:

### 1. BASIC PLUMBING REQUIREMENTS, MATERIALS AND METHODS

#### 1.01 SCOPE

A. PROVIDE ALL MATERIAL, TOOLS, SUPERVISION AND LABOR INCLUDING ALL MISCELLANEOUS AND INCIDENTAL ITEMS REQUIRED FOR COMPLETE AND OPERABLE PLUMBING INSTALLATIONS AS SHOWN OR DESCRIBED ON THE DRAWINGS AND IN THESE SPECIFICATIONS.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING AND NEW CONDITIONS AND MATERIALS WITHIN THE CONSTRUCTION AREA. ANY DAMAGE CAUSED BY THE CONTRACTOR SHALL BE REPAIRED TO THE OWNER'S SATISFACTION.

C. OBTAIN ALL PERMITS, PAY ALL PERMIT FEES AND SCHEDULE ALL REQUIRED INSPECTIONS. COPIES OF ALL PERMITS AND INSPECTION CERTIFICATES SHALL BE FORWARDED TO THE OWNER FOR RECORD.

D. THE GENERAL CONDITIONS OF THE CONTRACT AND ALL DIVISION 1 REQUIREMENTS APPLY TO THE WORK OF THIS SECTION.

E. THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO SUBMITTING BID TO DETERMINE CONDITIONS AND THE EXTENT OF THE WORK. BY COMMENCING WORK, THE CONTRACTOR ACKNOWLEDGES HIS CONFIRMATION OF ALL CONDITIONS AS ACCEPTABLE WITH REFERENCE TO HIS CONTRACT, SCOPE OF WORK AND BID PRICE SUCH THAT NO ADDITIONAL COMPENSATION SHALL BE FORTHCOMING FOR UNFORESEEN EXISTING CONDITIONS.

F. IN ALL AREAS SUBJECT TO FREEZING CONDITIONS, THE CONTRACTOR SHALL PROVIDE FREEZE PROTECTION FOR ALL DOMESTIC WATER PIPING INSTALLED UNDER HIS CONTRACT.

G. ALL ELECTRICAL REQUIREMENTS SHALL BE COORDINATED WITH THE CONTRACTOR FOR ELECTRICAL WORK. THIS CONTRACTOR IS RESPONSIBLE FOR ALL LOW VOLTAGE WIRING FOR EQUIPMENT INSTALLED UNDER HIS CONTRACT. THE CONTRACTOR FOR ELECTRICAL WORK IS RESPONSIBLE FOR LINE VOLTAGE POWER WIRING ONLY.

H. COLOR AND FINISH SELECTIONS FOR ALL MATERIALS, INCLUDING PAINTING OF PIPING, SHALL BE AS DIRECTED AND/OR APPROVED BY THE ARCHITECT.

I. MINOR DETAILS NOT SHOWN OR SPECIFIED, BUT NECESSARY FOR THE PROPER AND ACCEPTABLE CONSTRUCTION, INSTALLATION OR OPERATION OF ANY PART OF THE WORK AS DETERMINED BY THE ENGINEER SHALL BE INCLUDED AS IF SPECIFIED OR INDICATED ON THE DRAWINGS.

J. THIS CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL REQUIREMENTS FOR THE INSTALLATION, CONNECTION, EXTENSION OR MODIFICATION TO ALL UTILITY SERVICES WITH RESPECTIVE PROVIDERS INCLUDING PAYMENT OF ALL ASSOCIATED FEES.

K. THE CONTRACTOR IS RESPONSIBLE FOR ALL PAINTING ASSOCIATED WITH CUTTING AND PATCHING. ALL PAINTING IN AREAS WITH COMPLETE FINISH RENOVATIONS SHALL BE PROVIDED BY THE GENERAL CONTRACTOR.

#### 1.02 SUBMITTALS

A. SUBMITTAL REQUIREMENTS SHALL BE COORDINATED WITH THE ARCHITECT AND AUTHORITIES HAVING JURISDICTION. UNLESS OTHERWISE DIRECTED, CONTRACTOR SHALL PROVIDE SUBMITTALS AS LISTED BELOW.

- PIPE AND FITTINGS
- VALVES
- HANGERS AND SUPPORTS
- PLUMBING PIPING LAYOUT
- TESTS
- PLUMBING FIXTURES
- WATER HEATERS & ACCESSORIES
- FLOOR DRAINS
- MIXING VALVES
- ALL SCHEDULED PLUMBING EQUIPMENT

B. SUBMITTALS FROM SUPPLIERS OR MANUFACTURERS WHICH DO NOT BEAR THE STAMP OF THE SUBMITTING CONTRACTOR INDICATING THAT THE CONTRACTOR HAS REVIEWED THE SUBMITTAL FOR CONFORMANCE WITH THE PROJECT REQUIREMENTS WILL BE RETURNED REJECTED.

C. THE ENGINEER'S REVIEW OF SUBMITTALS IS A COURTESY WHICH DOES NOT RELIEVE THE CONTRACTOR FROM CONFORMING WITH THE CONSTRUCTION DOCUMENTS, REGARDLESS OF THE ACTION INDICATED BY THE SHOP DRAWINGS STAMP.

D. SUBMIT PROOF OF APPROVAL AND/OR CONFIRMATION OF SATISFACTORY TEST RESULTS TO THE OWNER AND THE ARCHITECT.

E. SUBMIT TO THE OWNER'S MAINTENANCE PERSONNEL OPERATION AND MAINTENANCE DATA FOR ALL SYSTEM COMPONENTS, SERVICING REQUIREMENTS, INSPECTION DATA, REPLACEMENT PART NUMBERS AND AVAILABILITY AND CONTACT INFORMATION FOR SERVICE/SUPPLY COMPANY.

F. FOR ALL BELOW GRADE PIPING WHERE ACTUAL INSTALLATION DEVIATES FROM CONSTRUCTION DRAWINGS, THE CONTRACTOR SHALL PROVIDE AS-BUILT DRAWINGS INDICATING BELOW GRADE PIPE LOCATIONS DIMENSIONED TO NEAREST COLUMN LINES.

G. RECORD AS-BUILT DRAWINGS SHALL BE SUPPLIED TO THE OWNER/TENANT AFTER COMPLETION OF THE WORK SHOWING ANY ALTERATIONS, ADDITIONS AND/OR DELETIONS TO THE SYSTEM(S) INSTALLED.

#### 1.03 SUBSTITUTIONS

A. ALL EQUIPMENT SHALL BE PRODUCTS OF THE SPECIFIED MANUFACTURER OR MANUFACTURERS. ALL BIDS SHALL BE BASED ON THE SPECIFIED MANUFACTURER OR MANUFACTURER'S EQUIPMENT. FOR SUBSTITUTIONS OF OTHER MANUFACTURER'S EQUIPMENT TO BE CONSIDERED, THE SUBSTITUTION MUST BE INDICATED PRIOR TO BIDDING WITH THE REASON FOR THE PROPOSED SUBSTITUTION IDENTIFIED, AND THE PROPOSED CREDIT TO THE OWNER INDICATED. THE ENGINEER SHALL DETERMINE THE ACCEPTABILITY OF ANY PROPOSED SUBSTITUTIONS.

B. THE CONTRACTOR ASSUMES ALL RESPONSIBILITY FOR COORDINATING THE WORK OF OTHER TRADES WHICH MAY BE AFFECTED BY SUBSTITUTIONS, INCLUDING ALL RELATED COSTS.

#### 1.04 DEFINITIONS

A. FURNISH: TO PURCHASE, PROCURE, ACQUIRE AND DELIVER, COMPLETE WITH RELATED ACCESSORIES.

B. INSTALL: TO ERECT, MOUNT AND CONNECT, COMPLETE WITH RELATED ACCESSORIES.

C. PROVIDE: TO FURNISH AND INSTALL.

D. PLUMBING CONTRACTOR, THE CONTRACTOR, THIS CONTRACTOR: THE CONTRACTOR FOR PLUMBING WORK WHICH IS SPECIFIED HEREIN AND SHOWN ON THESE DRAWINGS.

E. REFER TO THE INTERNATIONAL PLUMBING CODE 2015 FOR ADDITIONAL DEFINITIONS.

#### 1.04 DRAWINGS

A. THE DRAWINGS ARE DIAGRAMMATIC AND ARE INTENDED TO ILLUSTRATE THE GENERAL ARRANGEMENT AND ROUTING OF PIPING AND GENERAL LOCATIONS OF EQUIPMENT. PRECISE LOCATIONS OF EQUIPMENT, RISERS AND STACKS, AND ROUTING AND ELEVATION OF ALL PIPING SYSTEMS SHALL BE COORDINATED IN THE FIELD WITH THE ARCHITECT, ARCHITECTURAL DRAWINGS, THE WORK OF OTHER TRADES, EXISTING AND NEW BUILDING CONDITIONS AND/OR THE PREFERENCES OF THE OWNER/TENANT AS CONSTRUCTION PROCEEDS. ALL PIPING SHALL BE INSTALLED CONCEALED IN FINISHED SPACES, UNLESS NOTED OTHERWISE.

B. PROVIDE ALL NECESSARY INCIDENTAL MATERIALS AND ACCESSORIES REQUIRED TO MAKE THE WORK COMPLETE IN ALL RESPECTS, EVEN IF NOT PARTICULARLY SHOWN OR SPECIFIED.

C. REFER TO PLUMBING EQUIPMENT/FIXTURE SCHEDULE ON THE DRAWINGS FOR ALL FIXTURE AND EQUIPMENT SPECIFICATIONS.

D. REFER TO FIXTURE CONNECTION SIZE SCHEDULE FOR ALL FIXTURE ROUGHING SIZE REQUIREMENTS.

E. VERIFY ALL INDICATED CONDITIONS BEFORE STARTING WORK AND REPORT ANY DISCREPANCIES. THE DRAWINGS REFLECT CONDITIONS WHICH CAN BE REASONABLY INTERPRETED FROM THE EXISTING VISIBLE CONDITIONS OR FROM DRAWINGS AND INFORMATION FURNISHED BY THE OWNER.

F. LOCATE ALL FIXTURES AND EQUIPMENT AS PER THE FINAL ARCHITECTURAL DRAWINGS.

#### 1.05 PRODUCTS

##### A. SANITARY AND VENT PIPING:

- ABOVE GRADE/ UNDERGROUND PIPING SHALL BE CAST IRON PIPE WHICH SHOULD COMPLY WITH ASTM A 74 STANDARD/CISPI 301.
- SLOPE OF DRAINAGE SYSTEM SHALL BE 1/8" PER FOOT OF RUN FOR PIPE OVER 3" (I.D.) AND 1/4" PER FOOT OF RUN FOR PIPE 3" AND SMALLER (I.D.). VENT PIPING SHALL BE PITCHED TO DRAIN.
- PVC OR OTHER COMBUSTIBLE PLASTIC PIPING SHALL NOT BE INSTALLED IN CEILING PLENUM SPACES.
- ALL CAST IRON SOIL PIPE AND FITTINGS SHALL BE MARKED WITH THE COLLECTIVE TRADEMARK OF THE CAST IRON SOIL PIPE INSTITUTE (CISPI) AND BE LISTED BY NSF INTERNATIONAL.

##### B. DOMESTIC WATER PIPING:

- ABOVE GRADE WATER PIPING SHALL BE TYPE 'L' HARD-DRAWN COPPER TUBE.
- FITTINGS IN DOMESTIC WATER PIPING SHALL BE COPPER OR COPPER ALLOY AS PER TABLE 605.5, 2015 INTERNATIONAL PLUMBING CODE.
- JOINTS SHALL BE MADE WITH LEAD-FREE SOLDER.
- THE ENTIRE DOMESTIC WATER DISTRIBUTION SYSTEM SHALL BE INSULATED INCLUDING ALL VALVES, FITTINGS, ETC.
- COMPLY WITH NSF 61 FOR MATERIALS FOR WATER-SERVICE PIPING AND SPECIALTIES FOR DOMESTIC WATER.
- ALL DOMESTIC WATER PIPING ABOVE GRADE SHALL BE INSULATED WITH FIRE-RETARDANT, FACTORY-APPLIED JACKET. PROVIDE COLD WATER PIPING WITH FACTORY-APPLIED VAPOR BARRIER. INSULATION REQUIREMENT SHOULD COMPLY WITH 2015 INTERNATIONAL ENERGY CONSERVATION CODE. REFER BELOW TABLE C403.2.10 FOR MINIMUM PIPE INSULATION THICKNESS.

FLUID OPERATING TEMPERATURE RANGE AND USAGE (°F)	INSULATION CONDUCTIVITY		NOMINAL PIPE OR TUBE SIZE (INCHES)			
	CONDUCTIVITY BTU-IN./ (H·FT <sup>2</sup> ·°F)	MEAN RATING TEMPERATURE, °F	<1	1 to < 1½	1½ to < 4	4 to < 8
105-140	0.21-0.28	100	1.0	1.0	1.5	1.5
40-60	0.21-0.27	75	0.5	0.5	1.0	1.0

7. WATER-HEATING EQUIPMENT AND HOT WATER STORAGE TANKS SHALL MEET THE MINIMUM PERFORMANCE REQUIREMENTS GIVEN IN THE IECC 2015, SECTION C404.2, TABLE C404.2. THE EFFICIENCY SHALL BE VERIFIED THROUGH DATA FURNISHED BY THE MANUFACTURER OF THE EQUIPMENT OR THROUGH CERTIFICATION UNDER AN APPROVED CERTIFICATION PROGRAM.

8. AS PER IECC 2015 EDITION, C404.7 WATER DISTRIBUTION SYSTEM HAVING ONE OR MORE RECIRCULATION PUMPS THAT PUMP WATER FROM A HEATED-WATER SUPPLY PIPE BACK TO THE HEATED-WATER SOURCE THROUGH A COLD-WATER SUPPLY PIPE SHALL BE A DEMAND RECIRCULATION WATER SYSTEM. PUMPS SHALL HAVE CONTROLS THAT COMPLY WITH BOTH OF THE FOLLOWING:

- THE CONTROL SHALL START THE PUMP UPON RECEIVING A SIGNAL FROM THE ACTION OF A USER OF A FIXTURE, SENSING THE PRESENCE OF A USER OF A FIXTURE OR SENSING THE FLOW OF HOT OR TEMPERED WATER TO A FIXTURE.
- THE CONTROL SHALL LIMIT THE TEMPERATURE OF THE WATER ENTERING THE COLD-WATER PIPING TO 104°F(40°C).

9. HW SYSTEM PIPING IS DESIGNED AS PER MAXIMUM ALLOWED PIPE LENGTH METHOD AS PER INTERNATIONAL ENERGY CONSERVATION CODE 2015 C404.5, THE HW PIPE LENGTH FROM THE NEAREST SOURCE OF HEATED WATER TO THE TERMINATION OF THE FIXTURE SUPPLY PIPE SHALL BE AS PER FOLLOWING TABLE.

NOMINAL PIPE SIZE (INCHES)	MIXIMUM PIPING LENGTH (FEET)	
	PUBLIC LAV	OTHER FIXTURES
½"	2'	43'
¾"	0.5'	21'
1"	0.5'	13'
1¼"	0.5'	8'
1½"	0.5'	6'
2" OR LARGER	0.5'	4'

10. AS PER IECC 2015, C404.6.1, CONTROLS ARE INSTALLED THAT LIMIT OPERATION OF A RECIRCULATION PUMP INSTALLED TO MAINTAIN TEMPERATURE OF A STORAGE TANK. SYSTEM RETURN PIPE IS A DEDICATED RETURN PIPE OR A COLD WATER SUPPLY PIPE.

11. AS PER IECC 2015, C404.6.3, THE CONTROLS ON A PUMP THAT CIRCULATE WATER BETWEEN A WATER HEATER AND A HEATED WATER STORAGE TANK SHALL LIMIT THE OPERATION OF THE PUMP FROM HEATING CYCLE STARTUP TO NOT GREATER THAN 5 MINUTES.

#### C. ELECTRIC WATER HEATER

1. TANKS SHALL 80 GALLONS CAPACITY AND SHALL HAVE 150 PSI WORKING PRESSURE AND BE EQUIPPED WITH EXTRUDED HIGH DENSITY ANODE.

2. ALL INTERNAL SURFACES OF THE HEATER(S) EXPOSED TO WATER SHALL BE GLASS-LINED WITH AN ALKALINE BORO SILICATE COMPOSITION THAT HAS BEEN FUSED-TO-STEEL BY FIRING AT A TEMPERATURE RANGE OF 1400°F TO 1600°F.

3. ELECTRIC HEATING ELEMENTS SHALL BE LOW WATT DENSITY GOLDENROD 1" SCREW-IN TYPE.

4. EACH ELEMENT SHALL BE CONTROLLED BY AN INDIVIDUALLY MOUNTED THERMOSTAT AND HIGH TEMPERATURE CUT-OFF SWITCH. ALL INTERNAL CIRCUITS SHALL BE FUSED. THE OUTER JACKET SHALL BE OF BAKED ENAMEL FINISH AND SHALL BE PROVIDED WITH FULL SIZE CONTROL COMPARTMENT FOR PERFORMANCE OF SERVICE AND MAINTENANCE THROUGH HINGED FRONT PANEL AND SHALL ENCLOSE THE TANK WITH FOAM INSULATION. ELECTRICAL JUNCTION BOX WITH HEAVY DUTY TERMINAL BLOCK SHALL BE PROVIDED. THE DRAIN VALVE SHALL BE LOCATED IN THE FRONT FOR EASE OF SERVICING.

#### D. MIXING VALVES

1. VALVE BODY SHALL BE MADE OF CAST BRASS. THE INTERNAL COMPONENTS SHALL BE MADE OF BRASS OR STAINLESS STEEL.

2. TYPES A, C & D VALVES: VALVE SHUTS OFF IN FULL COLD POSITION AND MUST PASS THROUGH COLD RANGE BEFORE DELIVERING WARM, AND/OR HOT WATER. TEMPERATURE LIMIT SET AT 105°F MAXIMUM DELIVERY TEMPERATURE. IF ONE SUPPLY SHOULD FAIL, THE OTHER WILL AUTOMATICALLY AND INSTANTLY SHUT DOWN. DELIVERY CAPACITY IS 5GPM @ 45 PSIG DIFFERENTIAL.

3. TYPES OF VALVES: TYPE A- THERMOSTATICALLY OPERATED BY MEANS OF BI-METALLIC STRIP, OR EXPANSION BELLOWS; TYPE B- SINGLE HANDLE MECHANICAL MIXER, OR INDIVIDUAL HOT AND COLD CONTROL VALVES; TYPE C- PRESSURE BALANCING SHOWER VALVE/PISTON OPERATED MIXING VALVE; TYPE D- BALANCED PRESSURE OPERATION, WITH INTEGRAL DIAL THERMOMETER INDICATING DELIVERED WATER TEMPERATURE.

4. EACH ELEMENT SHALL BE CONTROLLED BY AN INDIVIDUALLY MOUNTED THERMOSTAT AND HIGH TEMPERATURE CUT-OFF SWITCH. ALL INTERNAL CIRCUITS SHALL BE FUSED. THE OUTER JACKET SHALL BE OF BAKED ENAMEL FINISH AND SHALL BE PROVIDED WITH FULL SIZE CONTROL COMPARTMENT FOR PERFORMANCE OF SERVICE AND MAINTENANCE THROUGH HINGED FRONT PANEL AND SHALL ENCLOSE THE TANK WITH FOAM INSULATION. ELECTRICAL JUNCTION BOX WITH HEAVY DUTY TERMINAL BLOCK SHALL BE PROVIDED. THE DRAIN VALVE SHALL BE LOCATED IN THE FRONT FOR EASE OF SERVICING.

#### E. HANGERS AND SUPPORTS:

1. HANGERS SHALL BE STANDARD STEEL MALLEABLE OR WROUGHT IRON, AS MANUFACTURED BY GRINNELL OR APPROVED EQUAL, SUITABLE FOR THE TYPE OF CONSTRUCTION. PIPING SHALL NOT BE HUNG FROM OTHER PIPE.

2. SECTIONS OF INDIVIDUAL PIPE RUNS SHALL BE SUPPORTED BY CLEVIS HANGERS.

3. ALL EQUIPMENT SHALL BE PROVIDED WITH APPROVED SUPPORTS.

4. SUPPORTS SHALL BE PROVIDED IN STRICT ACCORDANCE WITH THE RECOMMENDATIONS OF THE PIPING MANUFACTURER.

## PLUMBING DRAWING LIST

- P1 PLUMBING SYMBOLS & ABBREVIATIONS
- P2 PLUMBING SPECIFICATIONS
- P3 SANITARY FLOOR PLAN
- P4 WATER FLOOR PLAN
- P5 PLUMBING DETAILS
- P6 PLUMBING RISERS AND SCHEDULES

## CODE COMPLIANCE

ALL WORK AND MATERIAL SHALL BE PERFORMED AND INSTALLED IN COMPLIANCE WITH THE FOLLOWING CODES AS ADOPTED AND AMENDED BY THE INSPECTING AUTHORITY. NOTHING IN THESE DRAWINGS IS TO BE CONSTRUCTED TO PERMIT WORK NOT CONFORMING TO THESE CODES OR OTHERS APPLICABLE TO THESE PROJECTS:

- INTERNATIONAL BUILDING CODE 2015
- INTERNATIONAL MECHANICAL CODE 2015
- INTERNATIONAL PLUMBING CODE 2015
- INTERNATIONAL ENERGY CONSERVATION CODE 2015
- NATIONAL ELECTRIC CODE 2017

SALT 2.0

#### REVISION

NO.	DATE	DESCRIPTION

DWG DATE: 03-31-2022  
 DRAWN BY: STAFF  
 PROJECT No.: 21166  
 DWG TITLE:

PLUMBING SYMBOLS AND ABBREVIATIONS

SHEET No.


PI







Property of M Engineers

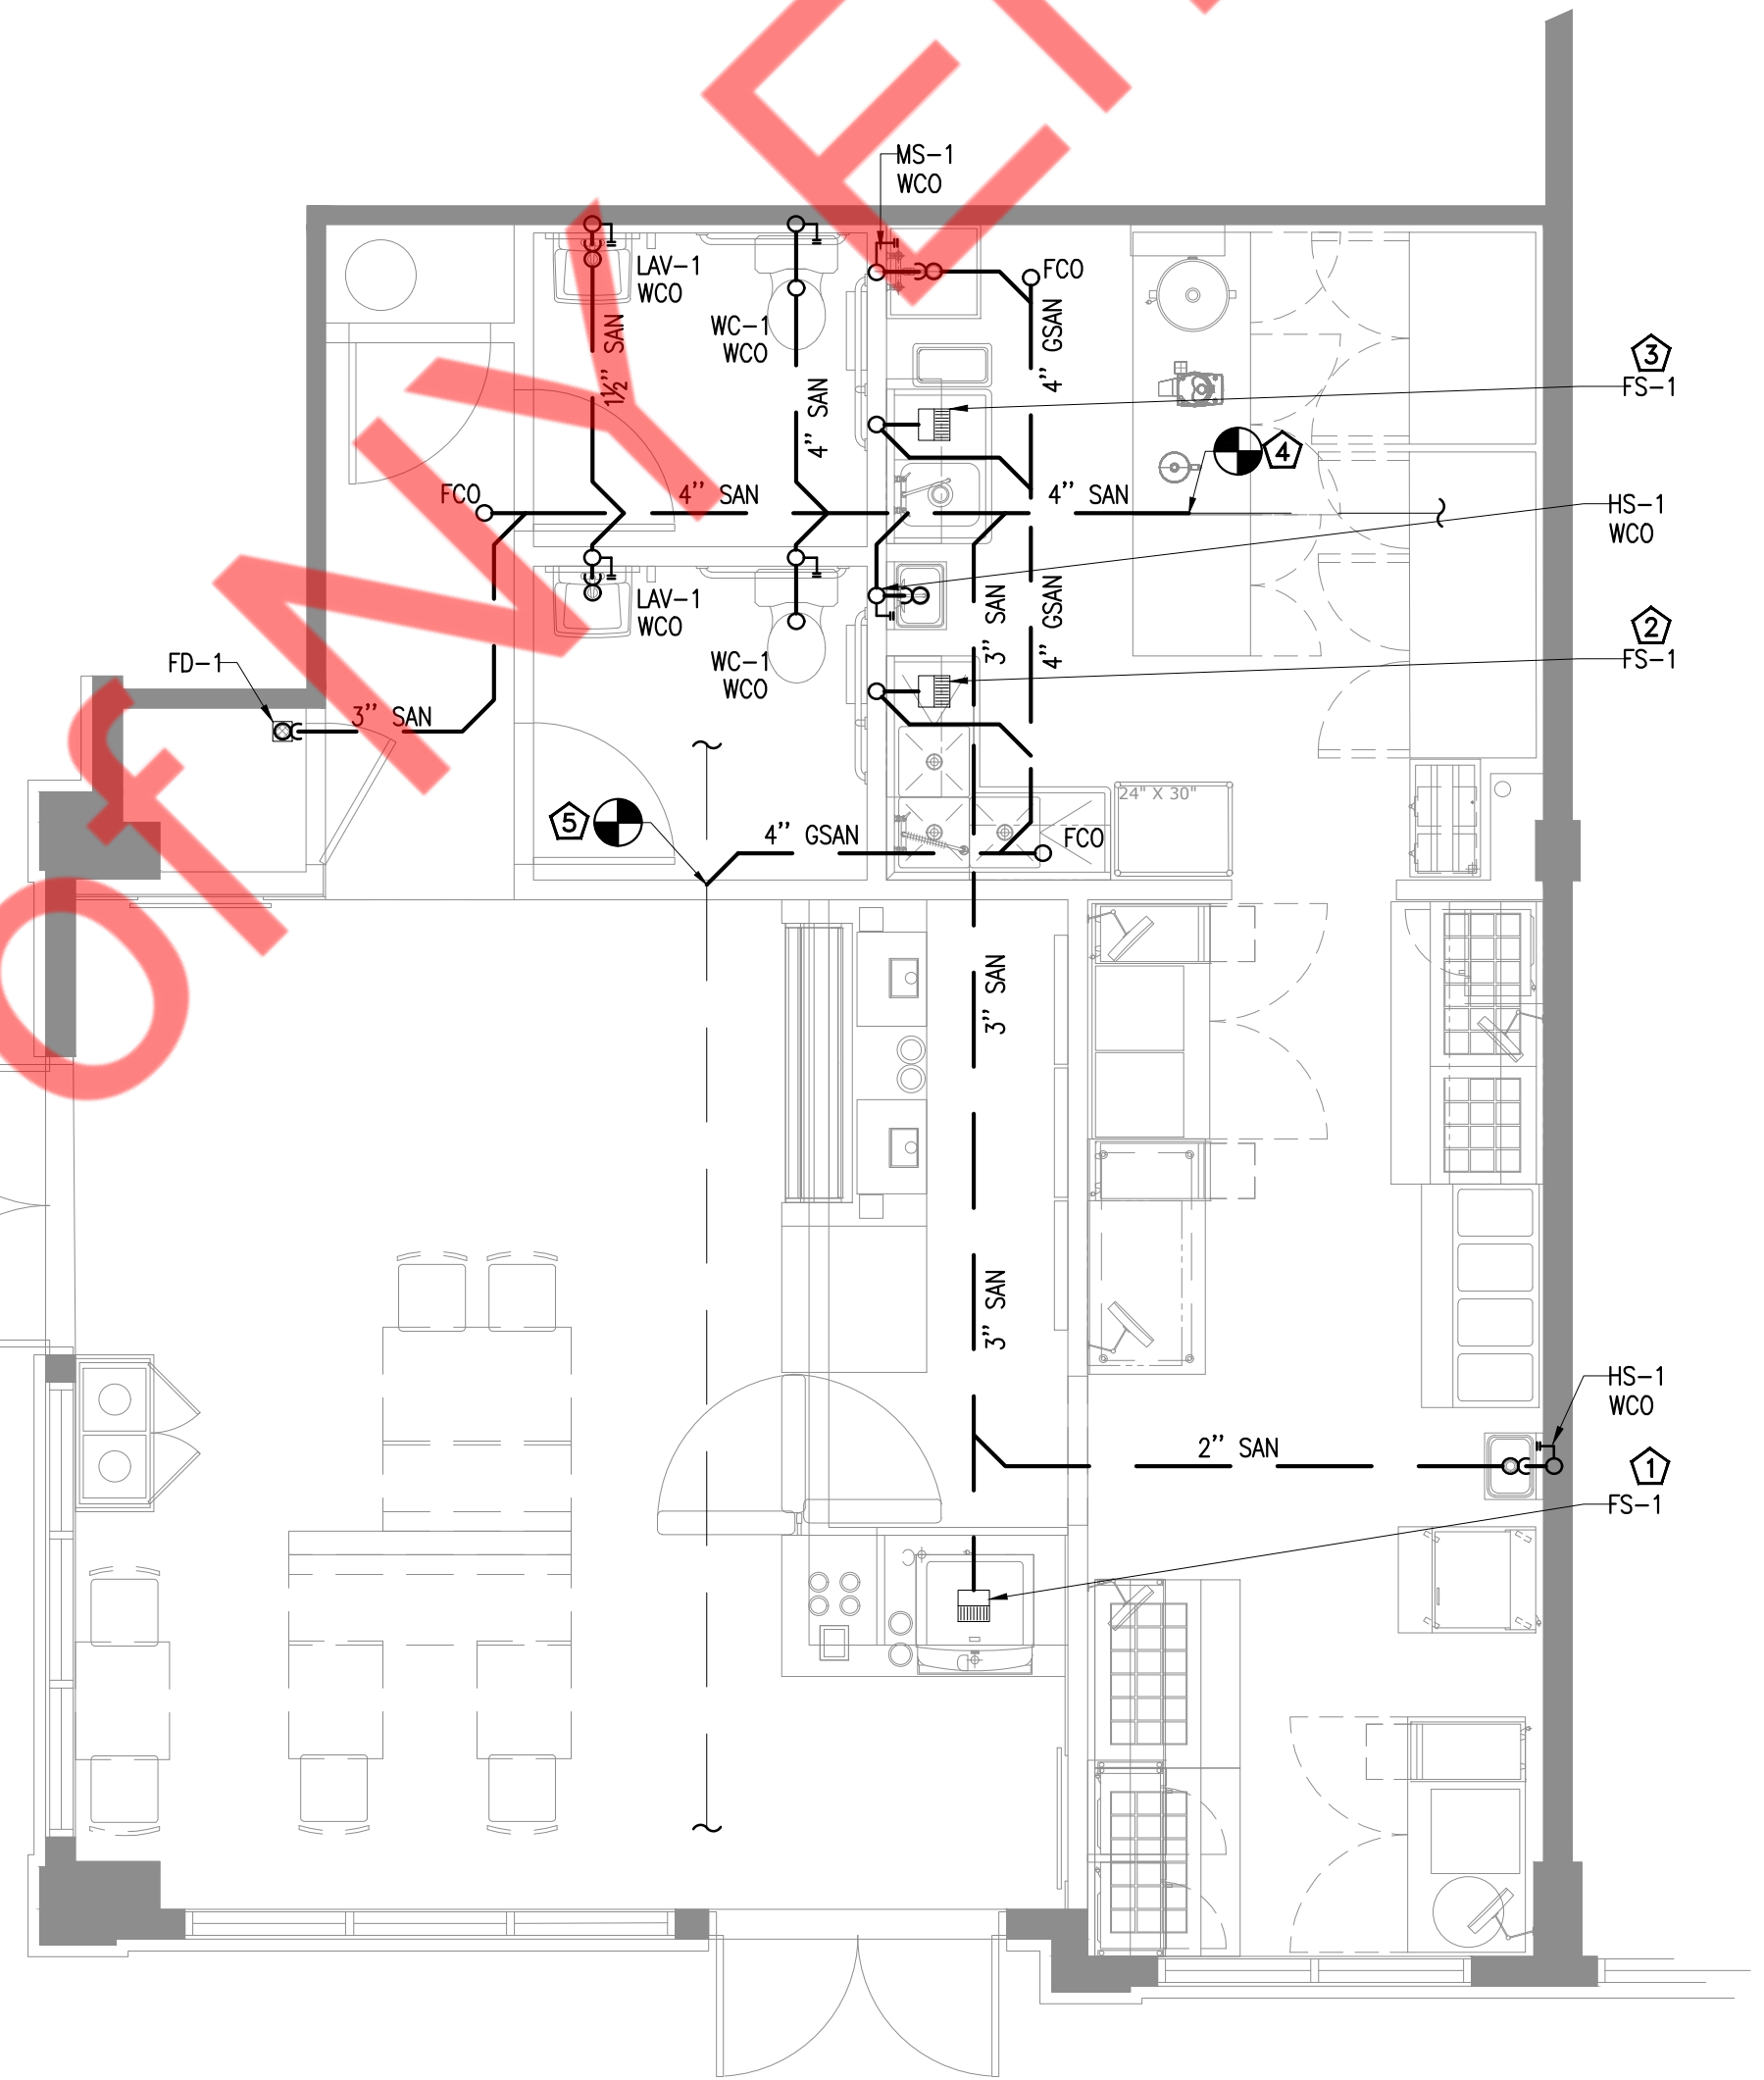

- SANITARY PLAN KEYED NOTES:**
- ① ROUTE INDIRECT WASTE FROM BEVERAGE STATION TO FLOOR SINK WITH APPROVED AIR GAP.
  - ② ROUTE INDIRECT WASTE FROM 3 COMP SINK TO FLOOR SINK WITH APPROVED AIR GAP.
  - ③ ROUTE INDIRECT WASTE FROM 1 COMP SINK TO FLOOR SINK WITH APPROVED AIR GAP.
  - ④ EXTEND AND CONNECT NEW 4" SANITARY PIPING TO EXISTING 4" SANITARY CONNECTION. CONTRACTOR SHALL VERIFY EXACT LOCATION.
  - ⑤ EXTEND AND CONNECT NEW 4" GREASE SANITARY PIPING TO EXISTING 4" GREASE SANITARY LINE FROM 2500 GALLON EXTERIOR GREASE INTERCEPTOR. CONTRACTOR SHALL VERIFY EXACT SIZE, INVERT & LOCATION OF EXTERIOR GREASE TRAP.


SALT 2.0																																				
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="3">REVISION</th> </tr> <tr> <th style="width: 5%;">NO.</th> <th style="width: 15%;">DATE</th> <th style="width: 80%;">DESCRIPTION</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table>	REVISION			NO.	DATE	DESCRIPTION																														
REVISION																																				
NO.	DATE	DESCRIPTION																																		
DWG DATE: 03-31-2022 DRAWN BY: STAFF PROJECT No.: 21166 DWG TITLE:																																				
SANITARY FLOOR PLAN																																				
SHEET No. <span style="font-size: 24px;">P3</span>																																				

G1 FLOOR PLAN - SANITARY SCALE: 1/4" = 1'-0"








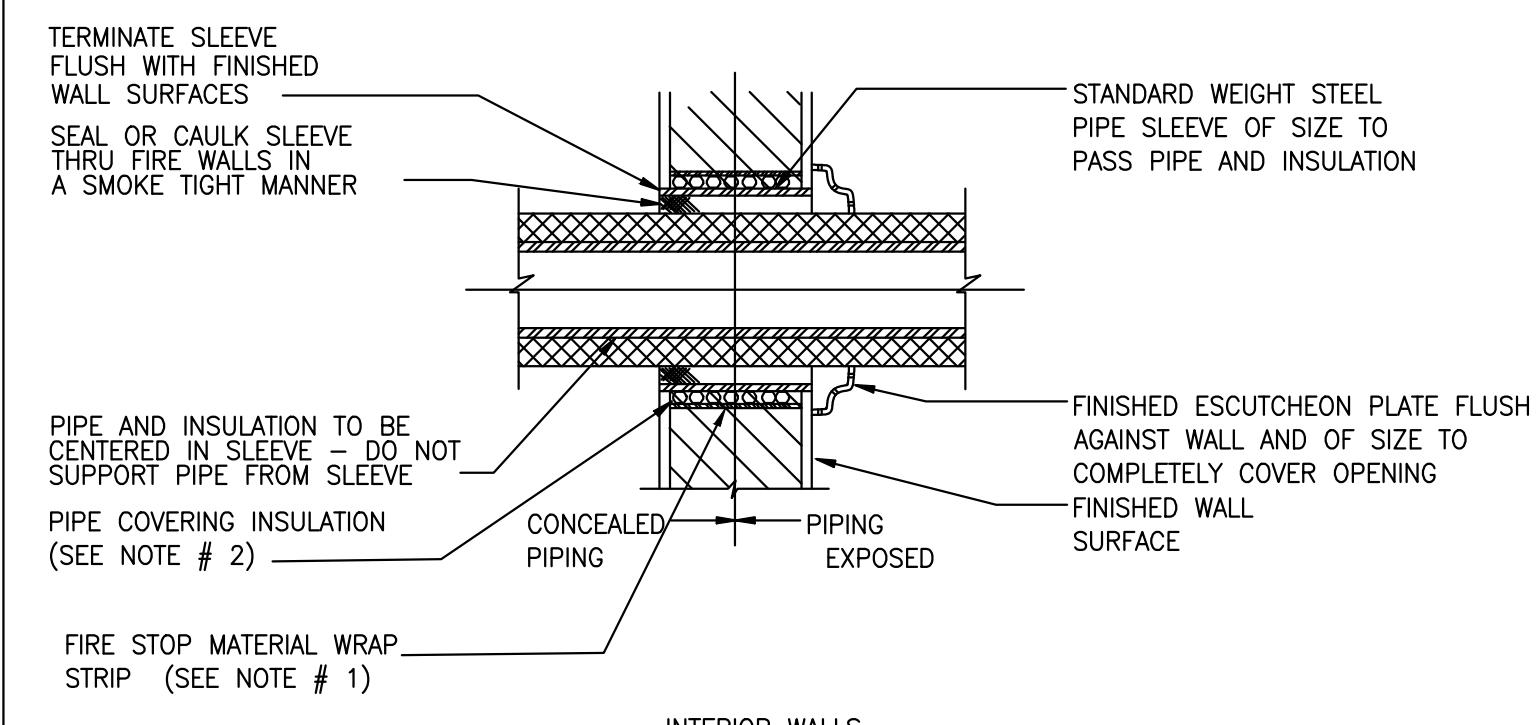


INTERIOR WALLS

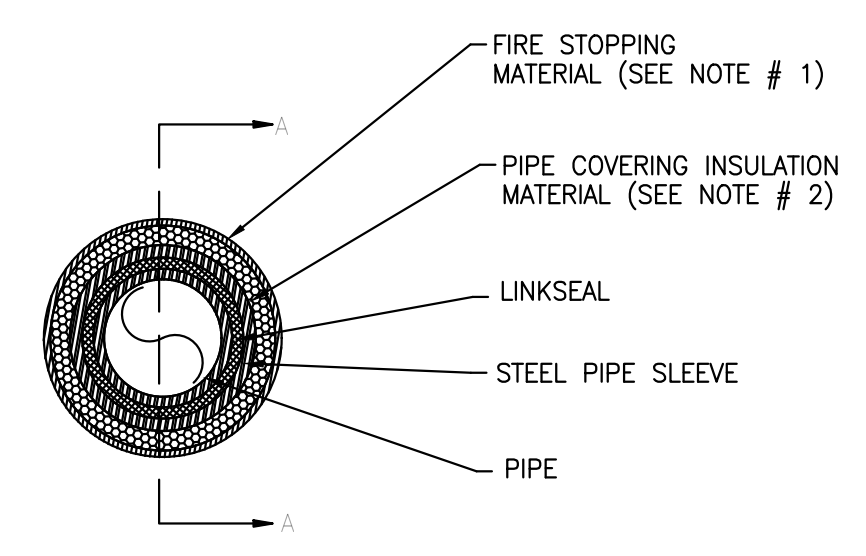

PIPE SLEEVE VIEW


- NOTES:
1. FIRESTOP MATERIAL WRAP STRIP SHALL BE 1/4" THICK INTUMESCENT ELASTOMERIC MATERIAL FACED ON ONE SIDE WITH ALUMINUM FOIL SUPPLIED IN 2 IN. WIDE STRIPS AND WRAP AROUND THE PIPE AS PER UL MATERIAL LISTED 3M COMPANY FS-195+ OR FILL CAVITY WITH CAULK OR SEALANT MIN. 1/4" DIA. CONTINUOUS BEAD APPLIED TO THE WRAP STRIP/WALL INTERFACE AND TO THE EXPOSED OF THE WRAP STRIP LAYER APPROX. 3/4" FROM WALL SURFACE. AS PER UL LISTED 3M COMPANY CP25WB+, IC 15WB+, FIRE DAM 150+CAULK.
  2. PIPE COVERING INSULATION SHALL BE 2" THICK HOLLOW CYLINDRICAL HEAVY DENSITY GLASS FIBER UNITS JACKETED ON THE OUTSIDE WITH AN ALL SERVICE JACKETED. AS PER UL CLASSIFICATION AND MARKING WITH A FLAME SPREAD INDEX OF 25 OR LESS AND A SMOKE DEVELOPED INDEX OF 50 OR LESS MAY BE USED.

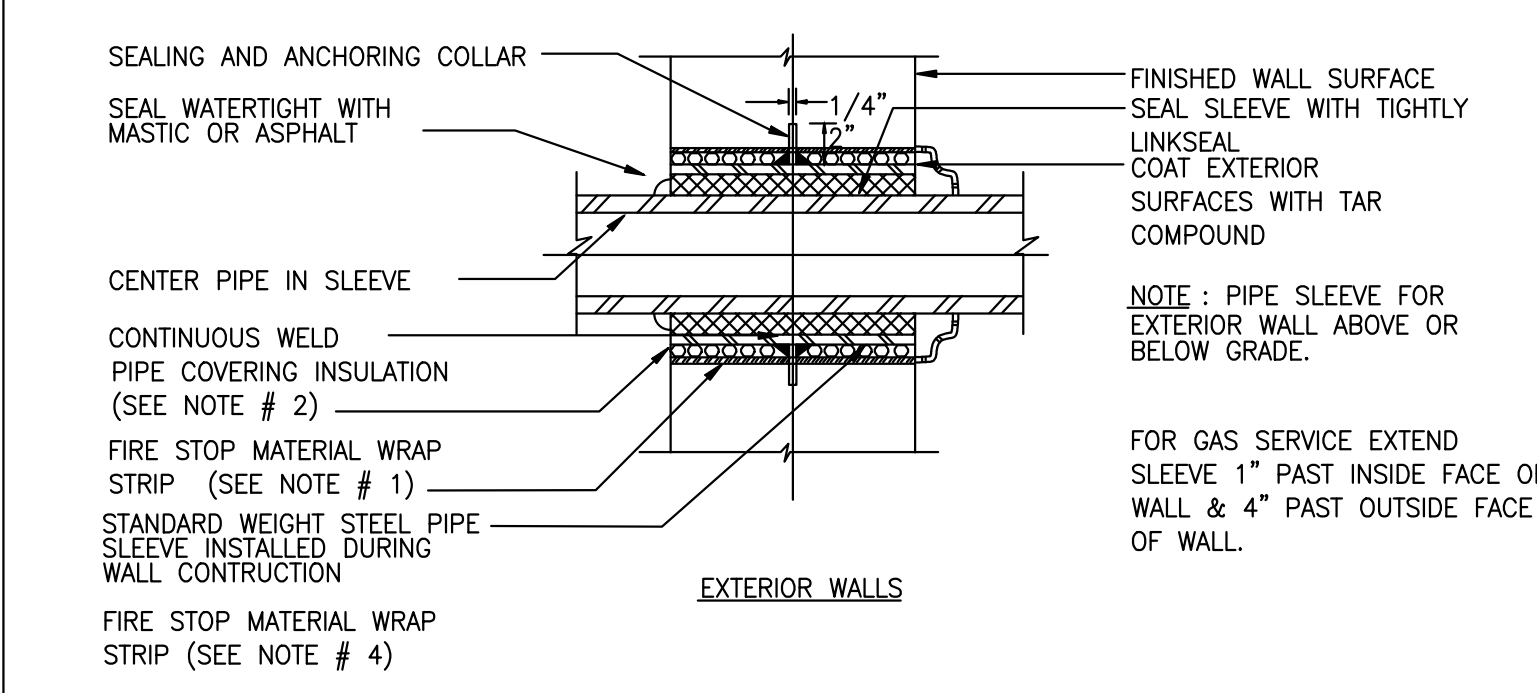

EXTERIOR WALLS


PIPE SLEEVE THRU WALL SECTION

1 PIPE SLEEVE THRU WALL SECTION  
P5 N.T.S

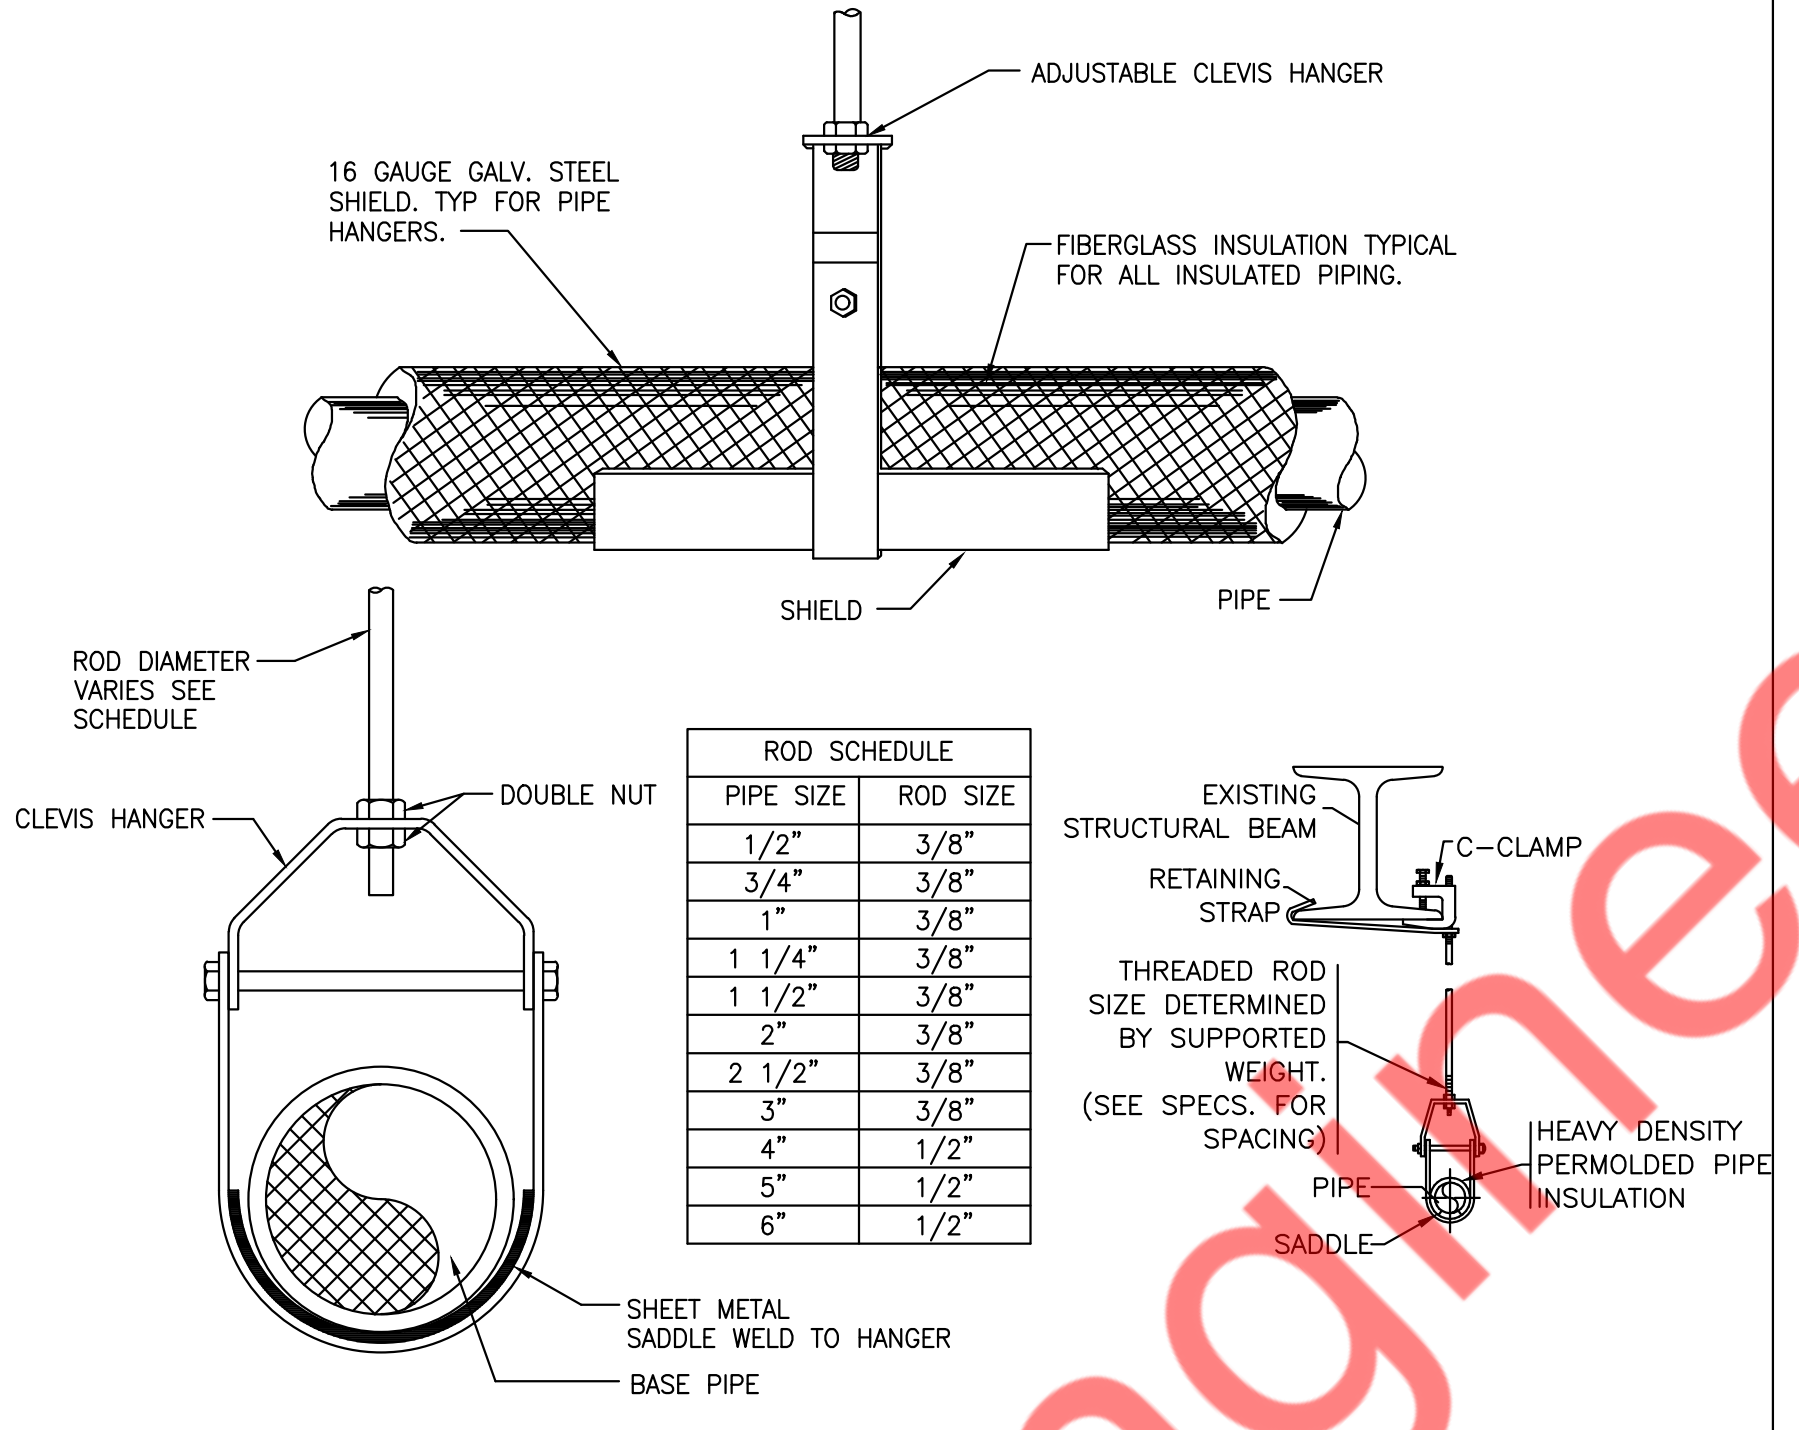

ROD SCHEDULE	
PIPE SIZE	ROD SIZE
1/2"	3/8"
3/4"	3/8"
1"	3/8"
1 1/4"	3/8"
1 1/2"	3/8"
2"	3/8"
2 1/2"	3/8"
3"	3/8"
4"	1/2"
5"	1/2"
6"	1/2"


2 HANGER DETAIL  
P5 N.T.S

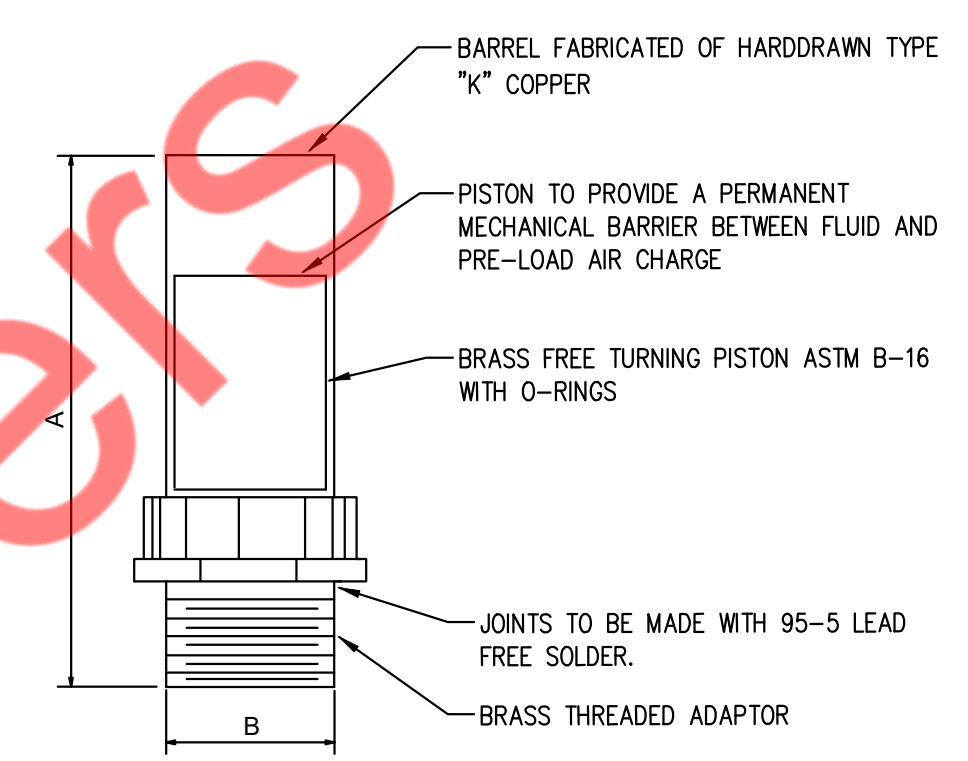

PIPE SIZE	P.D.I. SYMBOL	FIXTURE UNIT RATINGS	A SIZE	B SIZE
1/2"	A	1 - 11	5"	1 1/2"
3/4"	B	12 - 32	5"	3/4"
1"	C	33 - 60	7"	1"
1 1/4"	D	61 - 113	7"	1 1/4"
1 1/2"	E	114 - 154	9"	1 1/2"
2"	F	155 - 330	9"	2"


NOTE: LOCATE ONE FOR EACH BANK OF FLUSHMETER FIXTURES AT LAST FIXTURE PROVIDE A STAINLESS STEEL ACCESS DOOR FOR EACH SUFFICIENT IN SIZE TO ALLOW REPLACEMENT OF ARRESTOR AT A FUTURE DATE.

3 WATER HAMMER ARRESTOR DETAILS  
P5 N.T.S

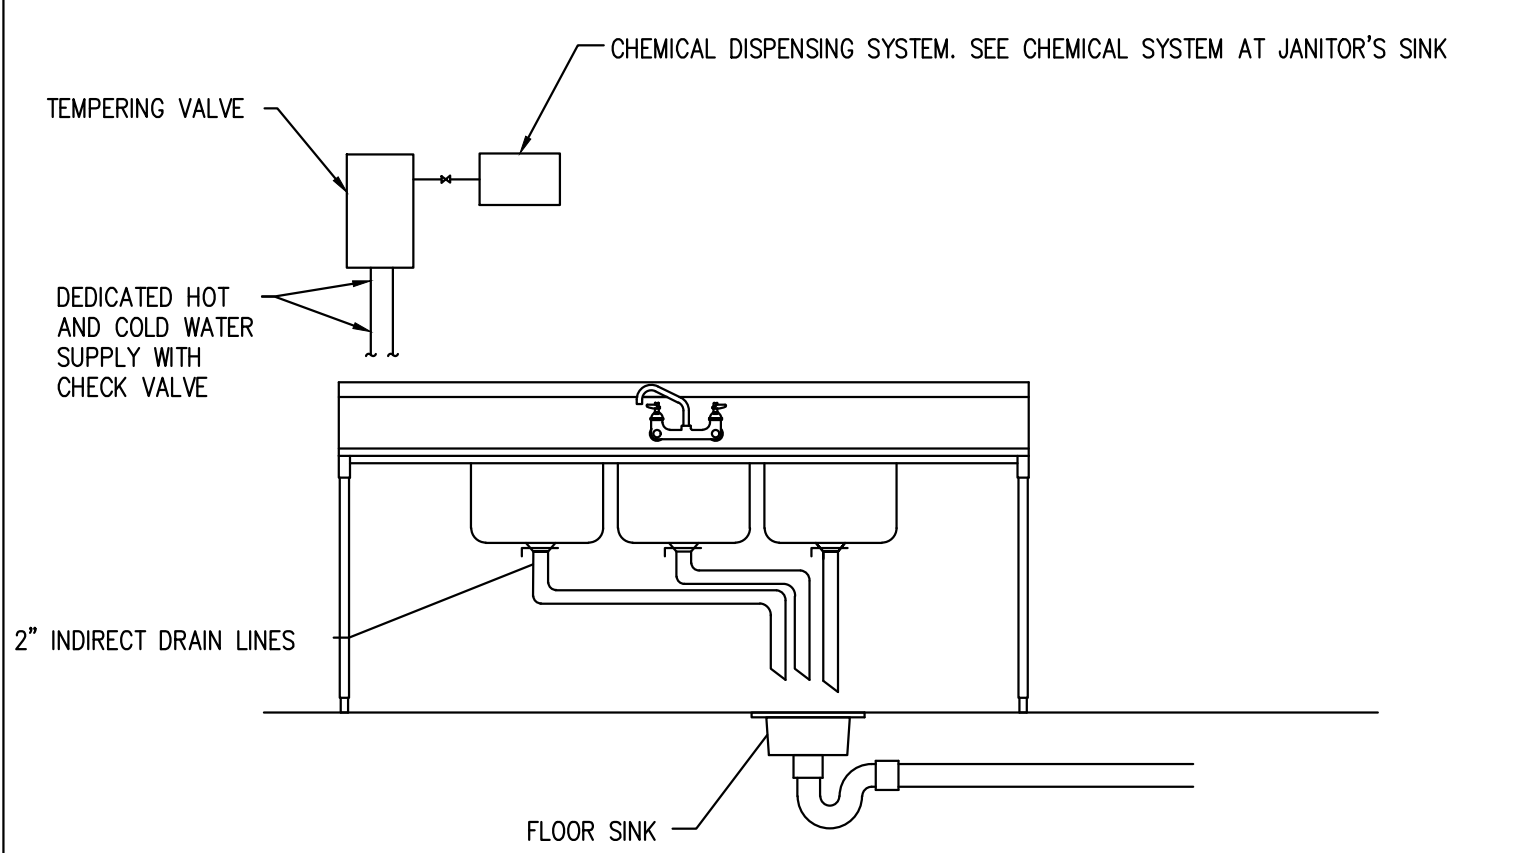


- COMMENTS:
1. CONNECT GREASE SANITARY LINE TO EXTERIOR GREASE TRAP LOCATED OUTSIDE. VERIFY IN FIELD EXACT LOCATION.
  2. ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS OR MEET LOCAL CODE REQUIREMENTS. HUBLESS CAST IRON PIPE, FITTINGS AND CONNECTORS ALL AROUND SINK AND TRAP.
  3. COORDINATE INDIVIDUAL BAY DRAINAGE, AIR GAP, & DRAIN FUNNEL WITH LOCAL CODE REQUIREMENTS.


4 3 COMPARTMENT SINK DETAILS  
P5 N.T.S

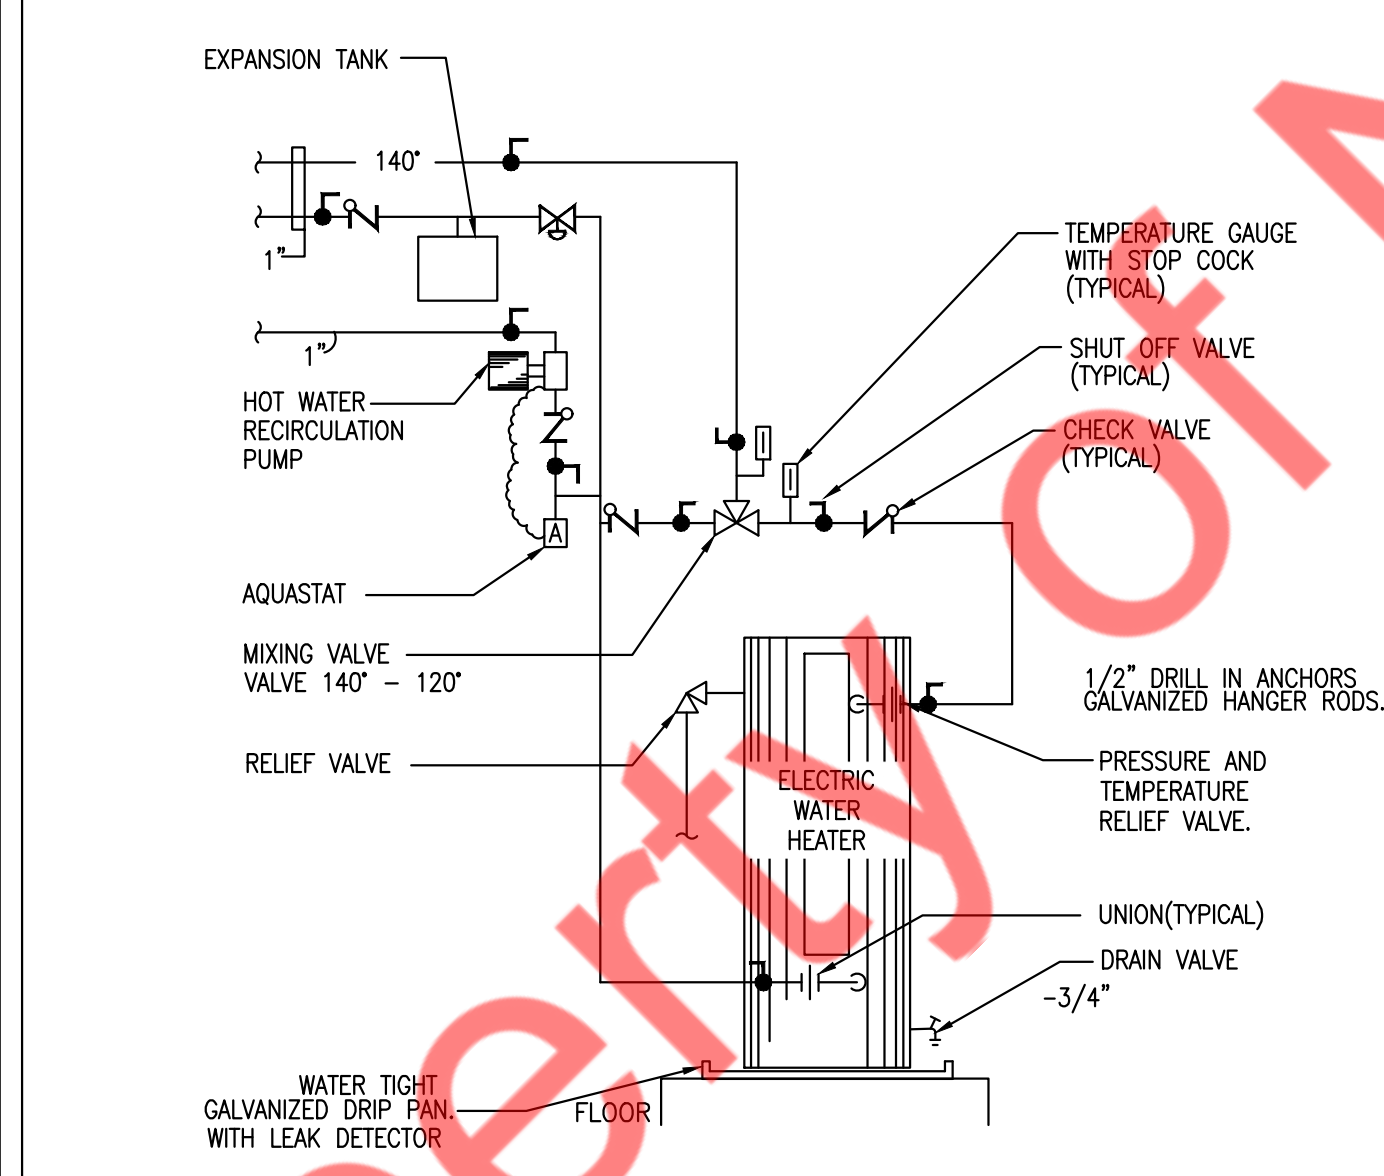


5 HOT WATER HEATER INSTALLATION DETAIL  
P5 N.T.S

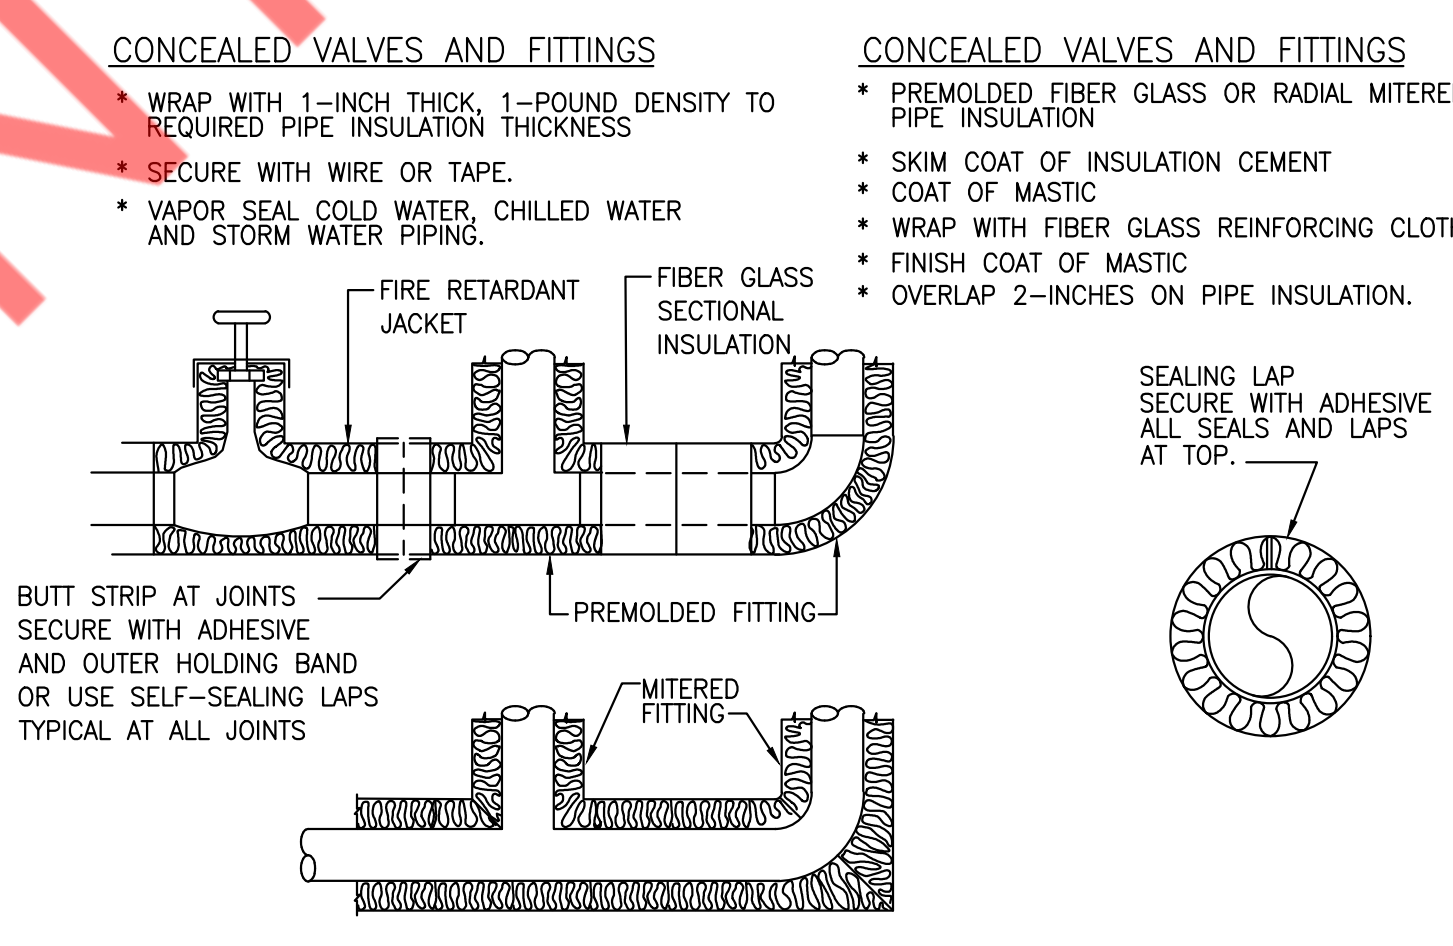

6 INSULATION OF PIPING, VALVES AND FITTINGS FOR EXPOSED AND CONCEALED LOCATIONS  
P5 N.T.S

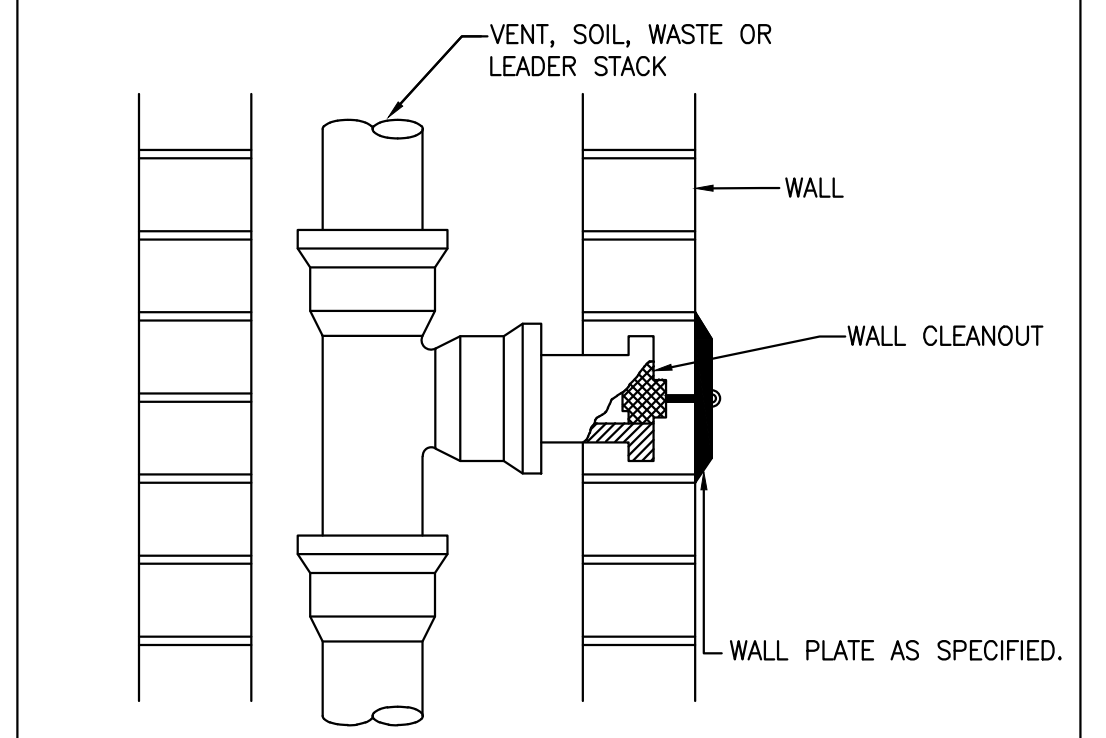

7 WALL CLEANOUT DETAILS  
P5 N.T.S

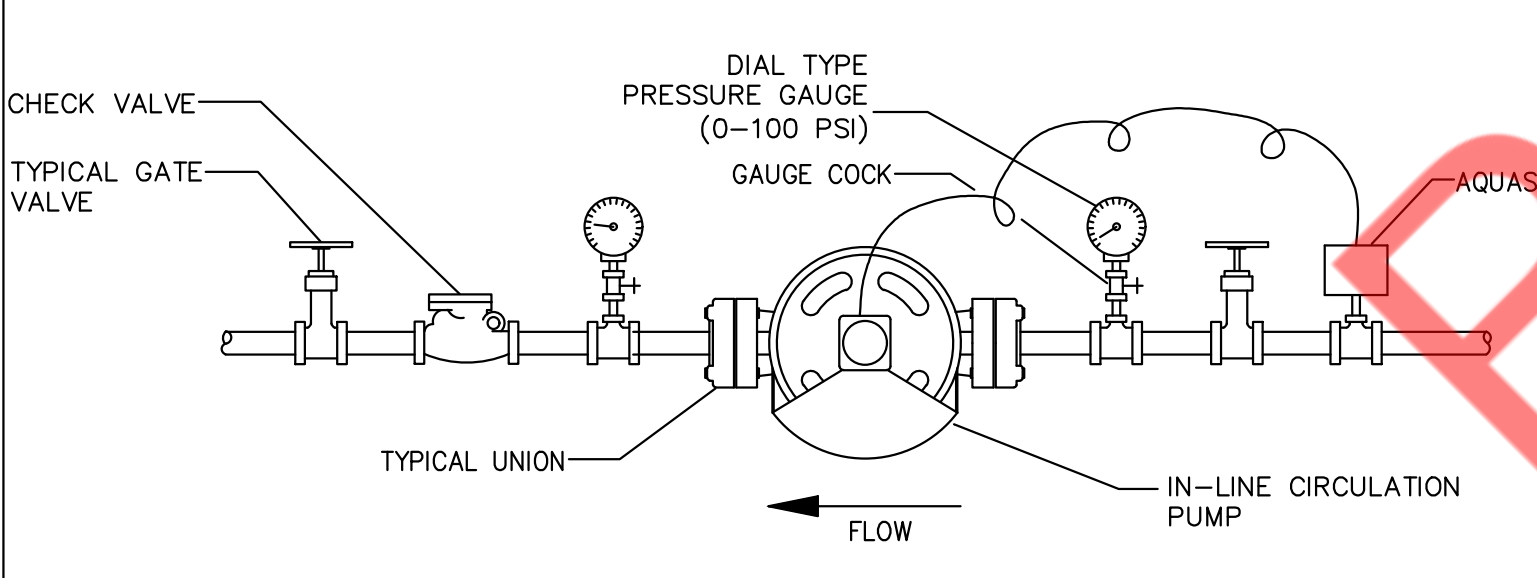

8 INLINE RECIRCULATING PUMP DETAIL  
P5 N.T.S

SALT 2.0

DWG TITLE:  
PLUMBING DETAILS

SHEET No.  
P5




PLUMBING FIXTURE SCHEDULE								
LEGEND	PLUMBING FIXTURE	CONNECTION SIZE -- INCHES						REMARKS
		TRAP	SOIL/WASTE	VENT	COLD WATER	HOT WATER	THERMOSTATIC MIXING VALVE	
WC-1	WATER CLOSET	-	4"	2"	3/4"	-	-	FLUSH TANK
LAV-1	LAVATORY	1 1/2"	1 1/2"	1 1/2"	1/2"	1/2"	PROVIDE	P-TRAP
MS-1	MOP SINK	3"	3"	2"	3/4"	3/4"	PROVIDE	P-TRAP
1CS	1-COMPARTMENT SINK	-	3"	2"	3/4"	3/4"	PROVIDE	I.W. FROM 1CS SPILLS INTO FLOOR SINK
3CS	3-COMPARTMENT SINK	-	3"	2"	3/4"	3/4"	PROVIDE	I.W. FROM 3CS SPILLS INTO FLOOR SINK
HS-1	HAND SINK	2"	2"	1 1/2"	3/4"	3/4"	PROVIDE	P-TRAP
FS-1	FLOOR SINK	3"	3"	2"	-	-	-	P-TRAP
FD-1	FLOOR DRAIN	3"	3"	2"	-	-	-	P-TRAP

NOTE: CONTRACTOR TO COORDINATE WITH ARCHITECTURAL DRAWINGS FOR ALL PLUMBING FIXTURES SPECIFICATIONS AND MOUNTING HEIGHT INSTALLATION.

HOT WATER HEATER											
TAG No.	NO. OF ELEMENTS	FIXTURES SERVING	STORAGE GALLONS	RECOVERY CAP. (GPM @ RISE)	TYPE	ELECTRICAL				MANUFACTURER & MODEL NO.	REMARKS
						VOLTS	PHASE	HERTZ	INPUT KW		
WH-1	3	1-COMPARTMENT SINK, 3-COMPARTMENT SINK, MOP SINK, HAND SINK LAVATORY.	80	74 GPH @ 100°F	ELECTRIC WATER HEATER (SIMULTANEOUS OPERATION)	208	3	60	18	A.O.SMITH DRE-80-18 (GOLD SERIES)	-DIMENSIONS 25.50"DIA X 60.25"H -HEATERS SHALL HAVE 150PSI WORKING PRESSURE.


RECIRCULATING PUMP SCHEDULE					
MARK	SERVICE	GPM	TOTAL HEAD FT.	MOTOR HP	MANUFACTURER & REMARKS
RCP-1	HW RECIRCULATION	2	10	0.115	GRUNDFOS UPS 15-18 BUCS W/AQUASTAT + TIMER

EXPANSION TANK SCHEDULE				
ITEM	SERVICE	GALLONS	MAKE	REMARKS
EXPANSION TANK (ET-1)	HOT WATER	3.2	AMTROL ST-8	DIMENSIONS- 15"(H)x9"(DIA.) SHIPPING WEIGHT- 7 LBS

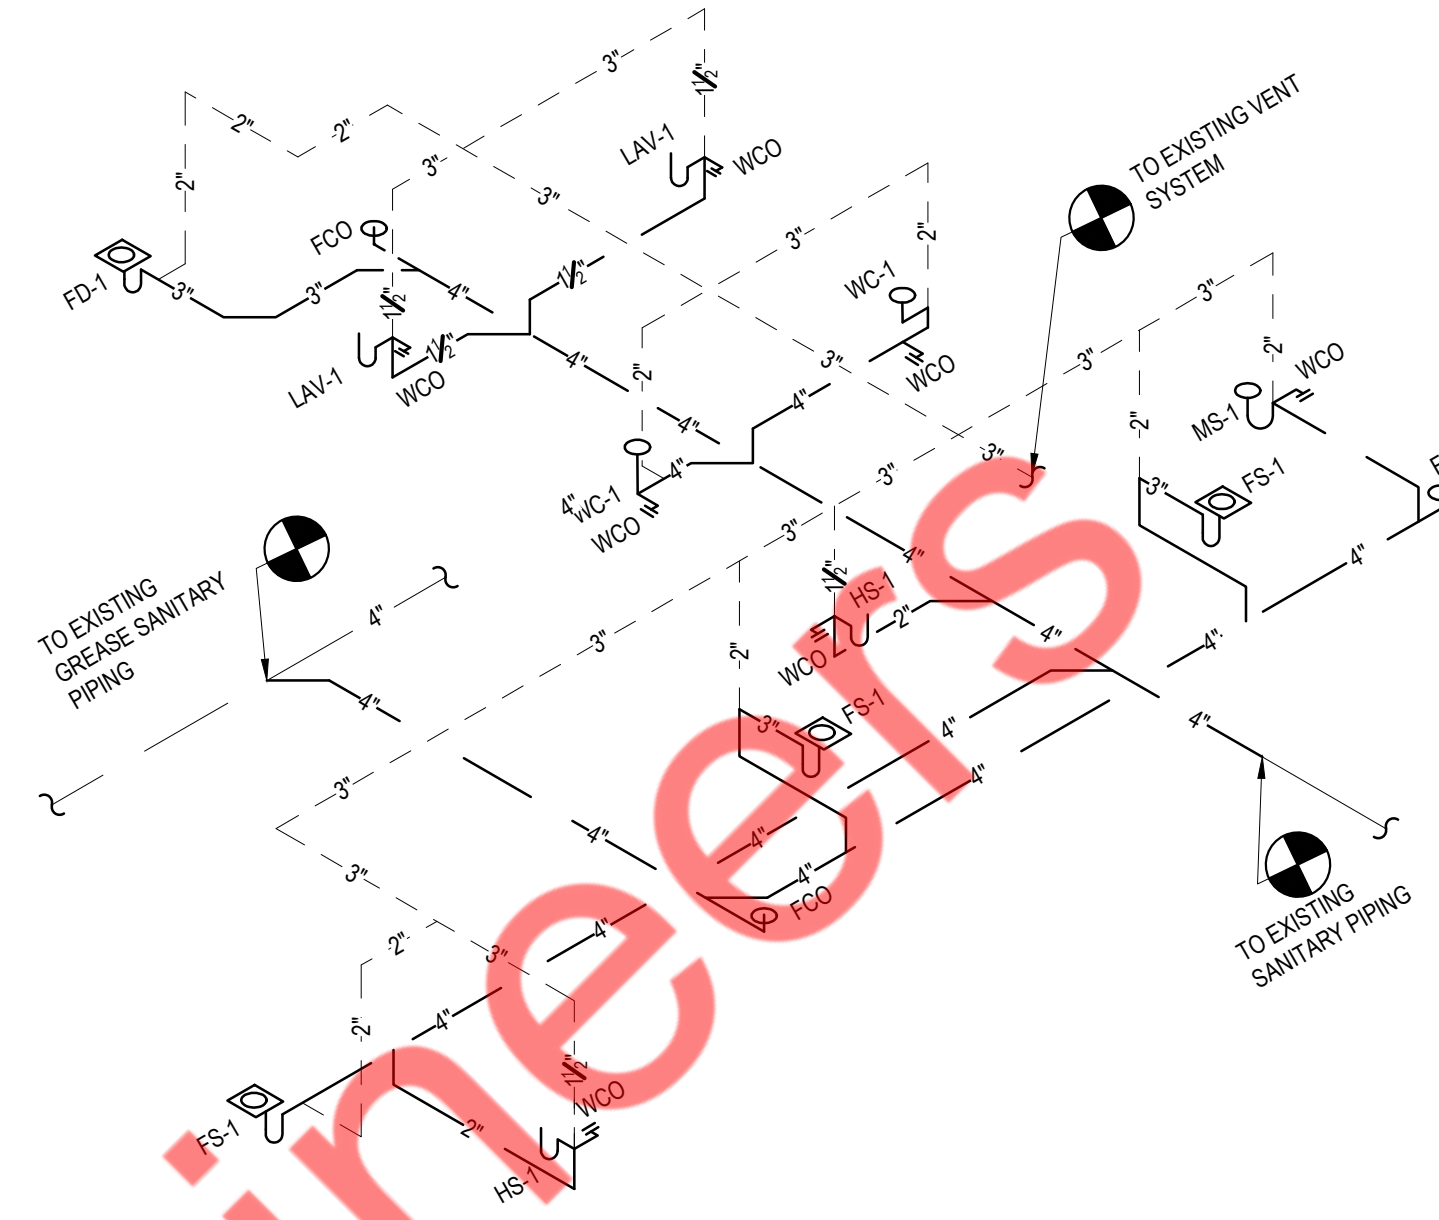

L9 PLUMBING RISER-WASTE AND VENT

SCALE: NTS

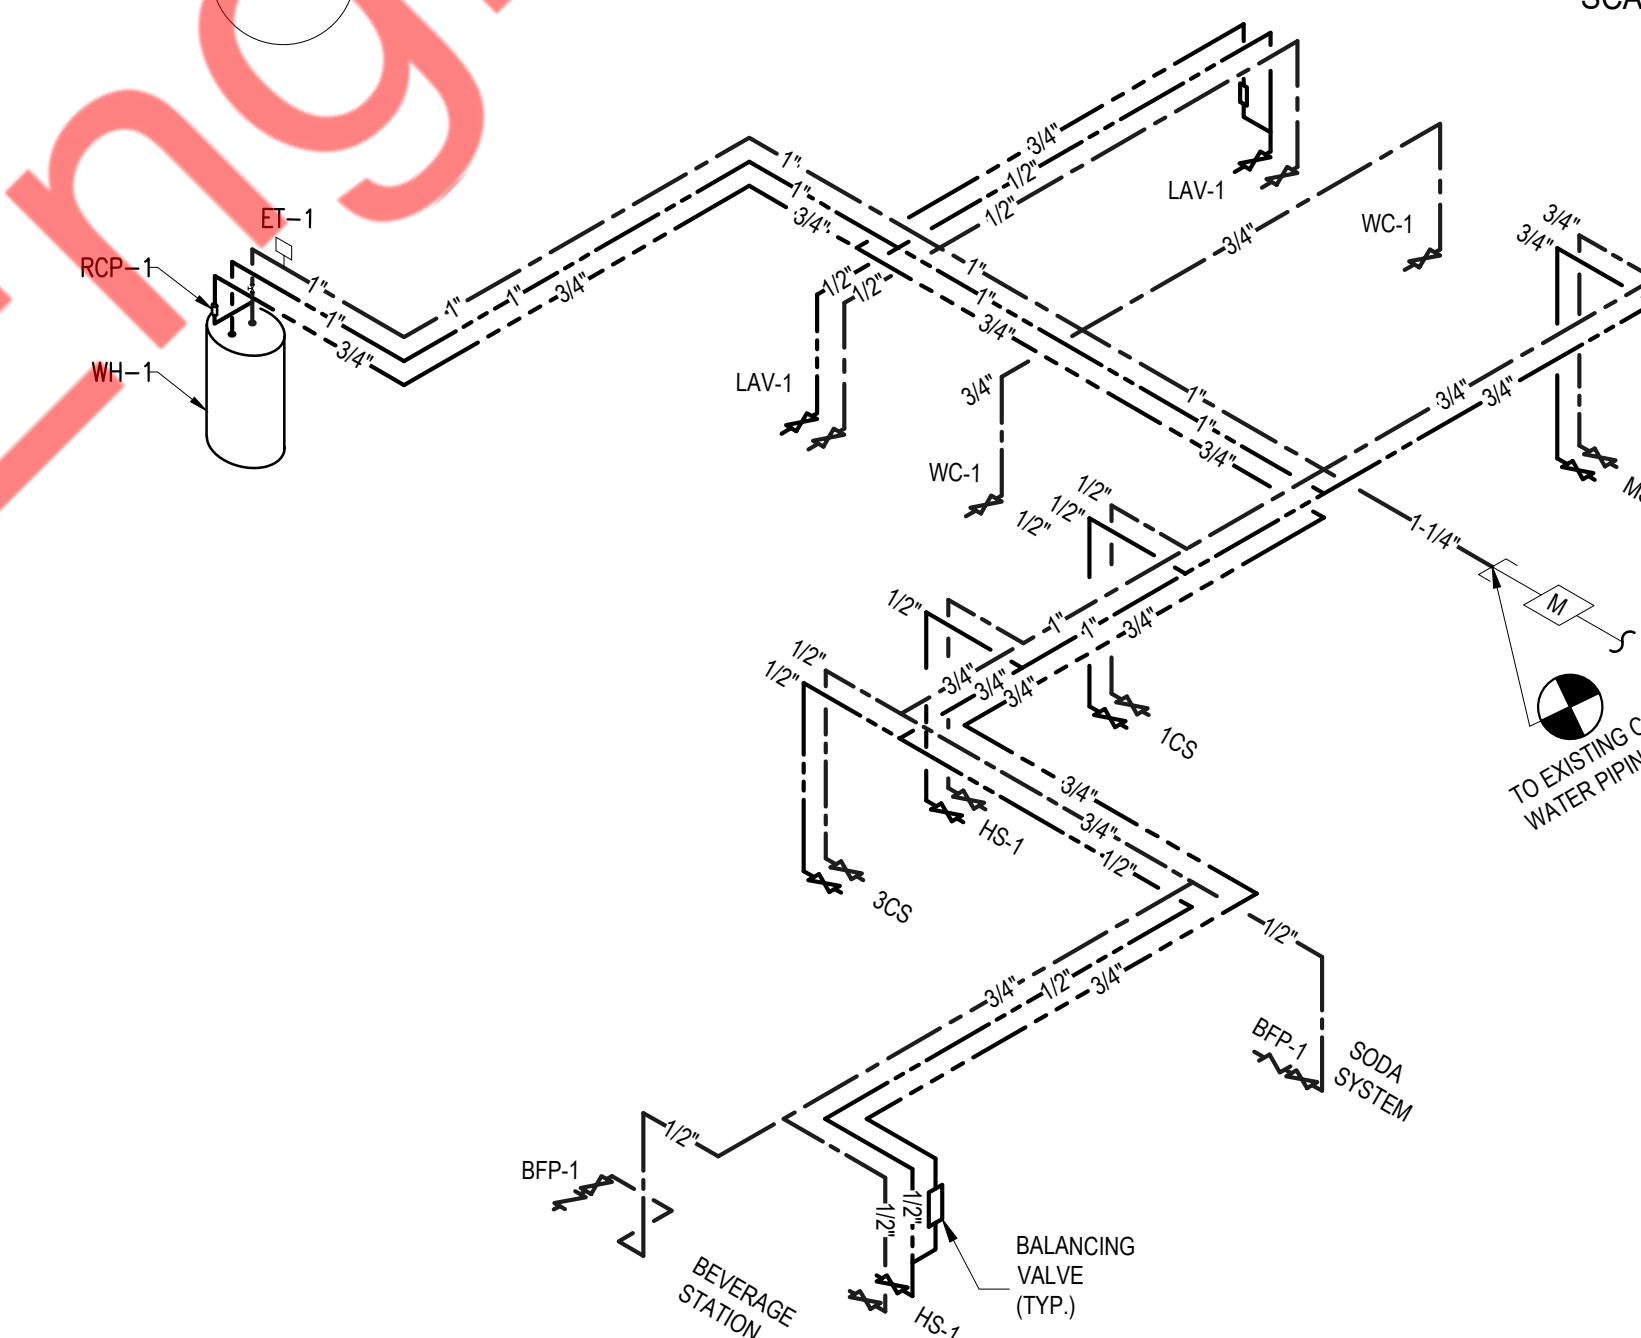

L5 PLUMBING RISER-DOMESTIC WATER

SCALE: NTS

SALT 2.0

DWG TITLE:

PLUMBING RISERS AND SCHEDULES

SHEET No.

P6